


24V POWER

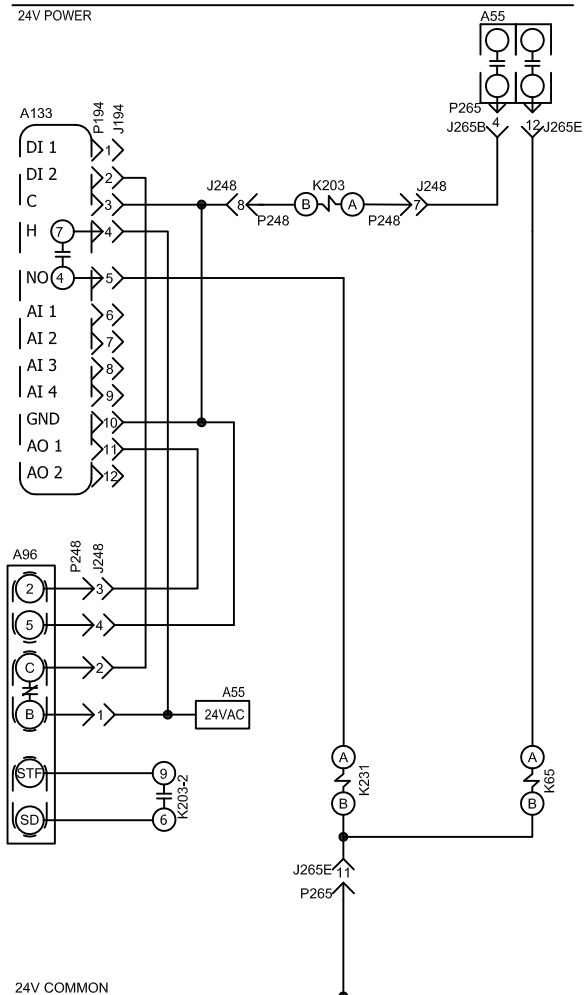


KEY	COMPONENT
A55	PANEL, MAIN CONTROL
A96	CONTROL, INVERTER
A133	CONTROL, GENERAL PURPOSE
B3	MOTOR, BLOWER
B10	MOTOR, EXHAUST FAN 1
B11	MOTOR, EXHAUST FAN 2
C6	CAPACITOR, EXHAUST FAN 1
C8	CAPACITOR, EXHAUST FAN 2
F6	FUSE, EXHAUST FAN
K65	RELAY, EXHAUST FAN
K203	RELAY, INVERTER START FWD ROTATION
K231	RELAY, EXHAUST FAN 2
S48	SWITCH, DISCONNECT
TB13	TERMINAL STRIP, POWER DISTRIBUTION

J/P	JACK/PLUG DESCRIPTION
18	POWER EXHAUST HARNESS
24	POWER, RELAY TO EXHAUST FANS
132	POWER TO EXHAUST FAN MOTOR 1
133	POWER TO EXHAUST FAN MOTOR 2
194	GP CONTROL INPUT, OUTPUT
246	POWER TO VFD
247	POWER, VFD TO MTR
248	VFD CONTROL
265	A55 TO CONTACTORS AND RELAYS

⚠ F6 FUSES ARE USED ON 240/300 Y-VOLT UNITS WITH FACTORY INSTALLED POWER EXHAUST

F6 FUSES ARE USED ON ALL Y-VOLT UNITS WITH FIELD INSTALLED POWER EXHAUST

24V COMMON

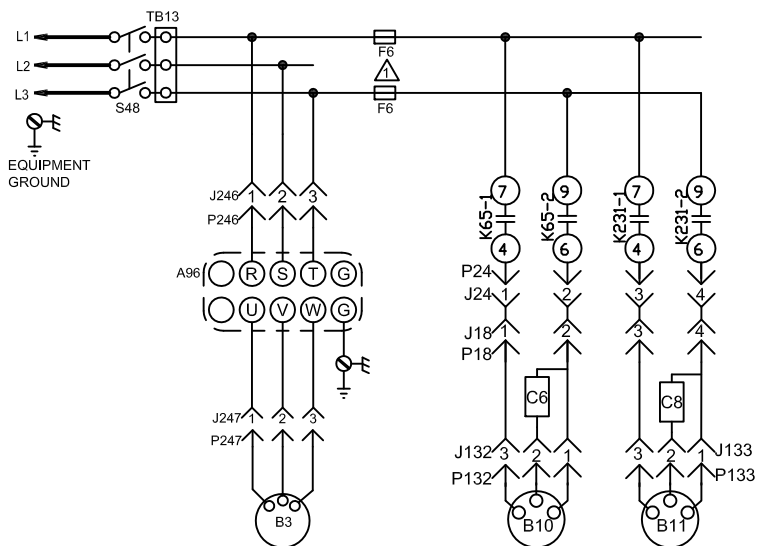

ENERGENCE C-BOX
WIRING DIAGRAM

06/11

COOLING

MSAV BLOWER - NO BYPASS

SECTION B3

REV 0

Supersedes

New Form No.

537390-01

© 2011

Lennox Commercial