


24V POWER

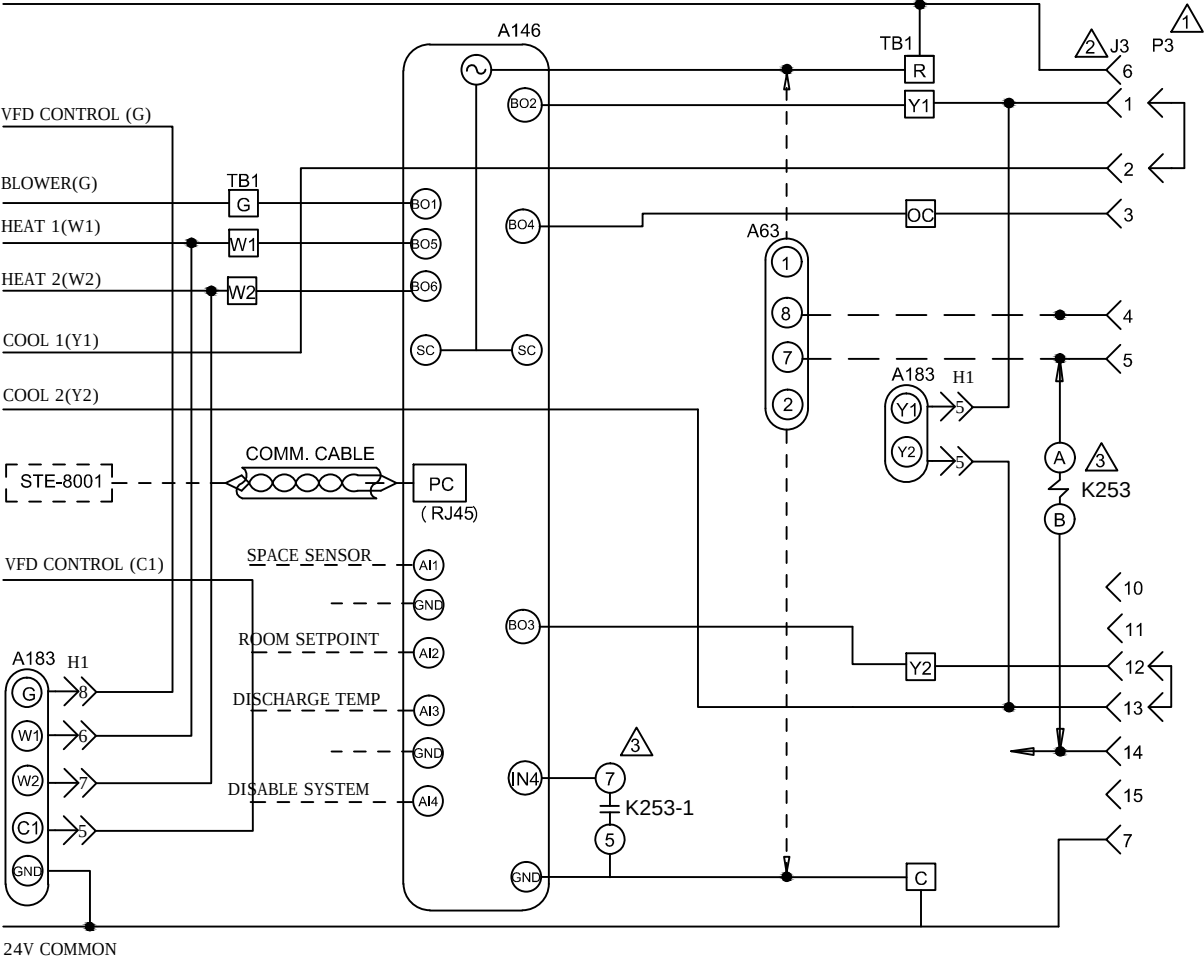

KEY	COMPONENT
A146	CONTROL, BACNET
A63	SENSOR, CO2
A183	CONTROL, VFD BOARD
H1	HEADER 1 ON VFD BOARD
J3/P3	JACK/PLUG, ECONOMIZER OR BYPASS
K253	RELAY, ECON FDD
R1	SENSOR, MIXED AIR OR SUPPLY AIR
TB1	TERMINAL STRIP, CLASS II VOLTAGE

- 1 REMOVE P3 WHEN ECONOMIZER IS USED, ONLY ON KCA, KGA AND KHA 180 THROUGH 300 UNITS.
- 2 J3 MAXIMUM LOAD 20VA 24VAC CLASS II
- 3 ONLY USED ON UNITS WITH JADE (W7220) ECONOMIZER CONTROL

— — — — — DENOTES OPTIONAL COMPONENTS
— — — — — CLASS II FIELD WIRING

10/17



WIRING DIAGRAM

10/17

537932-01

CONTROLS

CONTROL FOR BACNET MODULE - ELA UNIT

SECTION C

REV 1

Supersedes

New Form No.
537932-01