


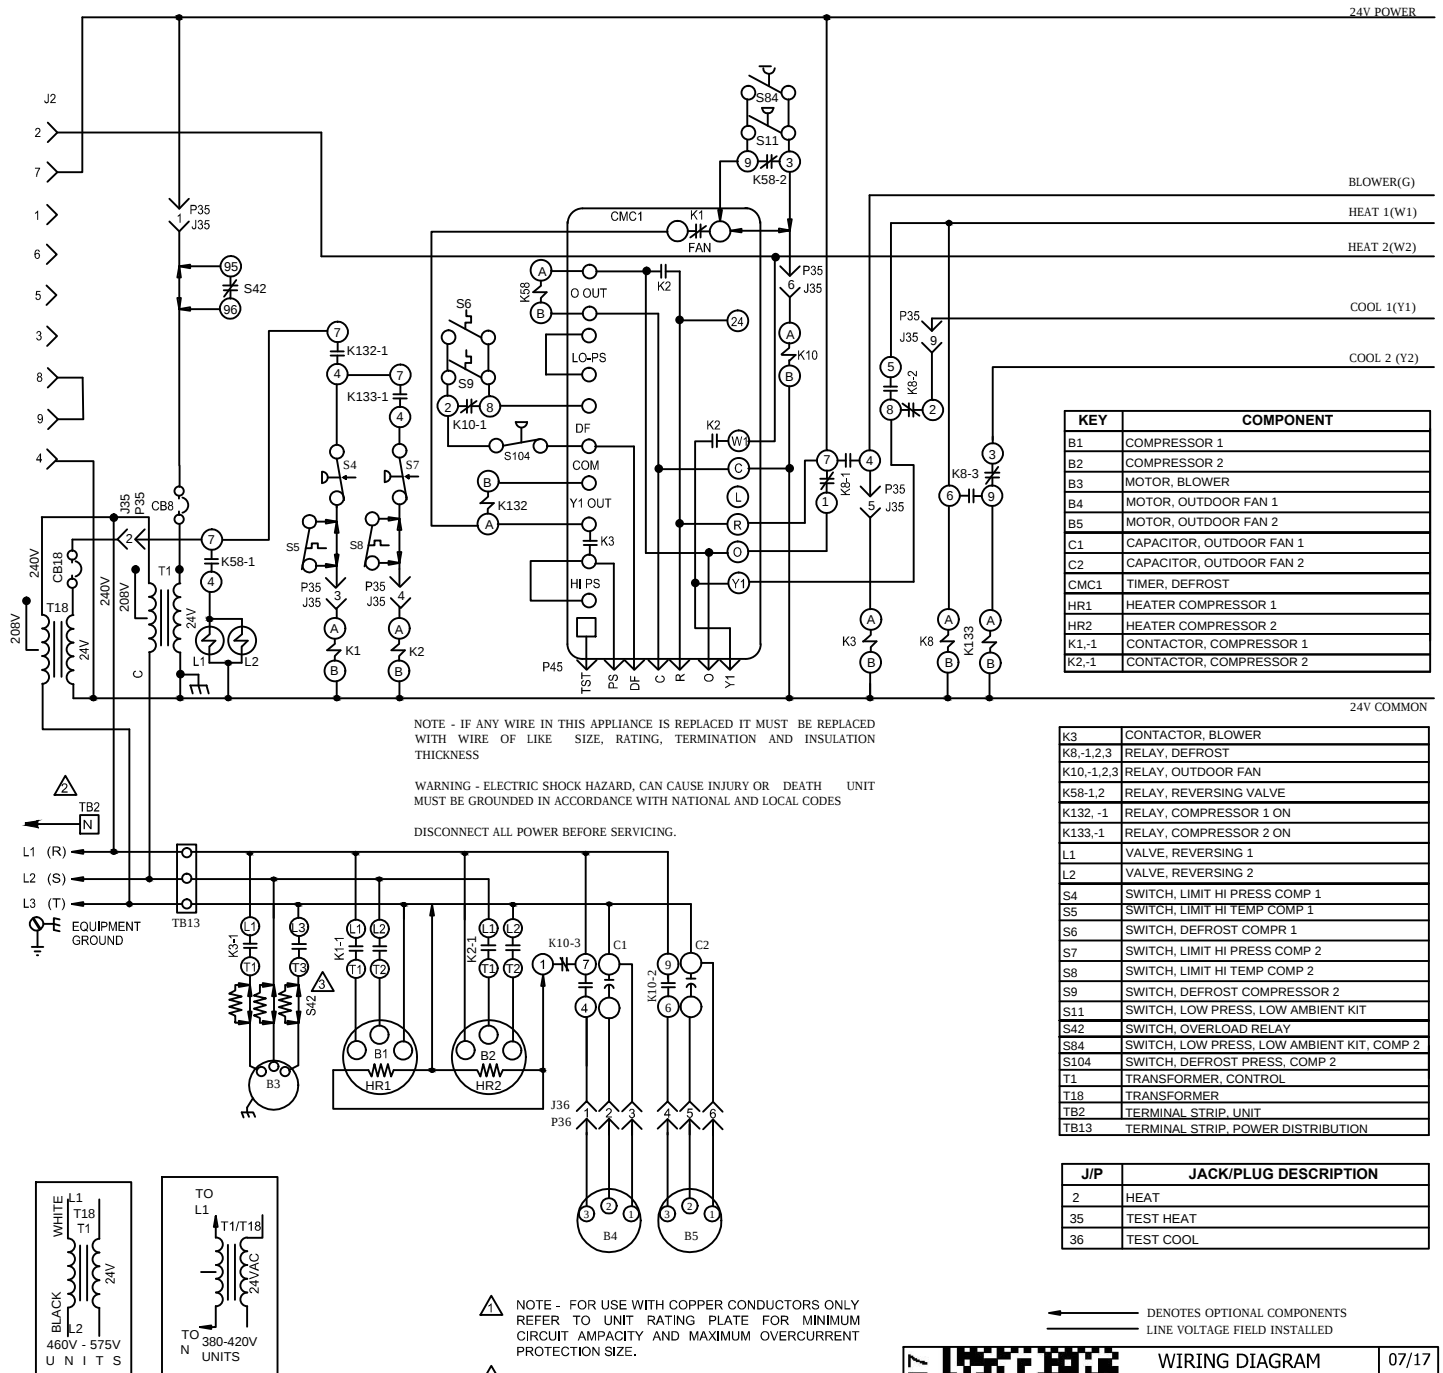

⚠ NOTE - FOR USE WITH COPPER CONDUCTORS ONLY
REFER TO UNIT RATING PLATE FOR MINIMUM
CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT
PROTECTION SIZE.

 TB2 IS USED ON "M" VOLTAGE UNITS ONLY

3 IMPORTANT: TO PREVENT MOTOR BURNOUT, NEVER CONNECT MORE THAN ONE MOTOR LEAD TO ANY ONE CONNECTION. TAPE UNUSED MOTOR LEADS

 DENOTES OPTIONAL COMPONENTS
 LINE VOLTAGE FIELD INSTALLED

07/17		WIRING DIAGRAM	07/17
		537672-01	
HEAT PUMP - CAV			
ZH* - 092, 102, 120 - G, J, M, Y			
SECTION B			REV. 1
Supersedes		New Form No. 537672-01	