


IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING

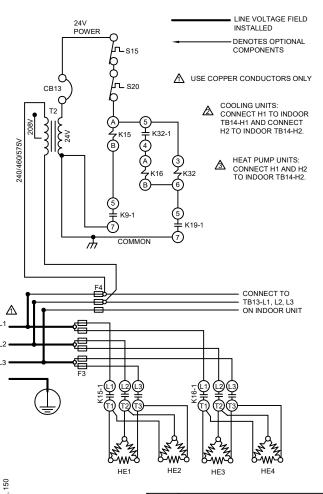

120							
990,	372	KW	UE1	HE2 6.25	UE2	ПΕΛ	
$\ddot{-}$	_	. KVV	UEI	C OF	0.05	6.25	
ı	Ц	25	0.25	6.25 8.3	0.25	0.25 8.3	
_		_33	0.3	0.5	0.3	0.5	

KEY	COMPONENT
CB13	CIRCUIT BREAKER, TRANSFORMER T2
F3	FUSE-ELECTRIC HEAT
F4	FUSE-UNIT
HE1	ELEMENT-ELECTRIC HEAT 1
HE2	ELEMENT-ELECTRIC HEAT 2
HE3	ELEMENT-ELECTRIC HEAT 3
HE4	ELEMENT-ELECTRIC HEAT 4
K9,-1	RELAY-HEAT
K15,-1	CONTACTOR-ELECTRIC HEAT 1
K16,-1	CONTACTOR-ELECTRIC HEAT 2
K19,-1	RELAY-STAGE TWO HEAT
K32,-1	RELAY-SEQUENCER ELECT HT 2
S15	SWITCH-LIMIT, PRIMARY, ELECT HT
S20	SWITCH-LIMIT, SECONDARY ELECT HT
T2	TRANSFORMER-ELECTRIC HEAT

2/01	W	IRING DIAGRAM	01/25				
702	<b>6.61</b> 53	8601-01					
HEATING - ELECTRIC							
	ELEH - ELITE 072 - 150 UNITS - Y						
	25,35 kW						
	SECTION B3		REV 0				
Supersedes New Form No.							
		538601-01					
© 2025		Lennov	Commercia				