


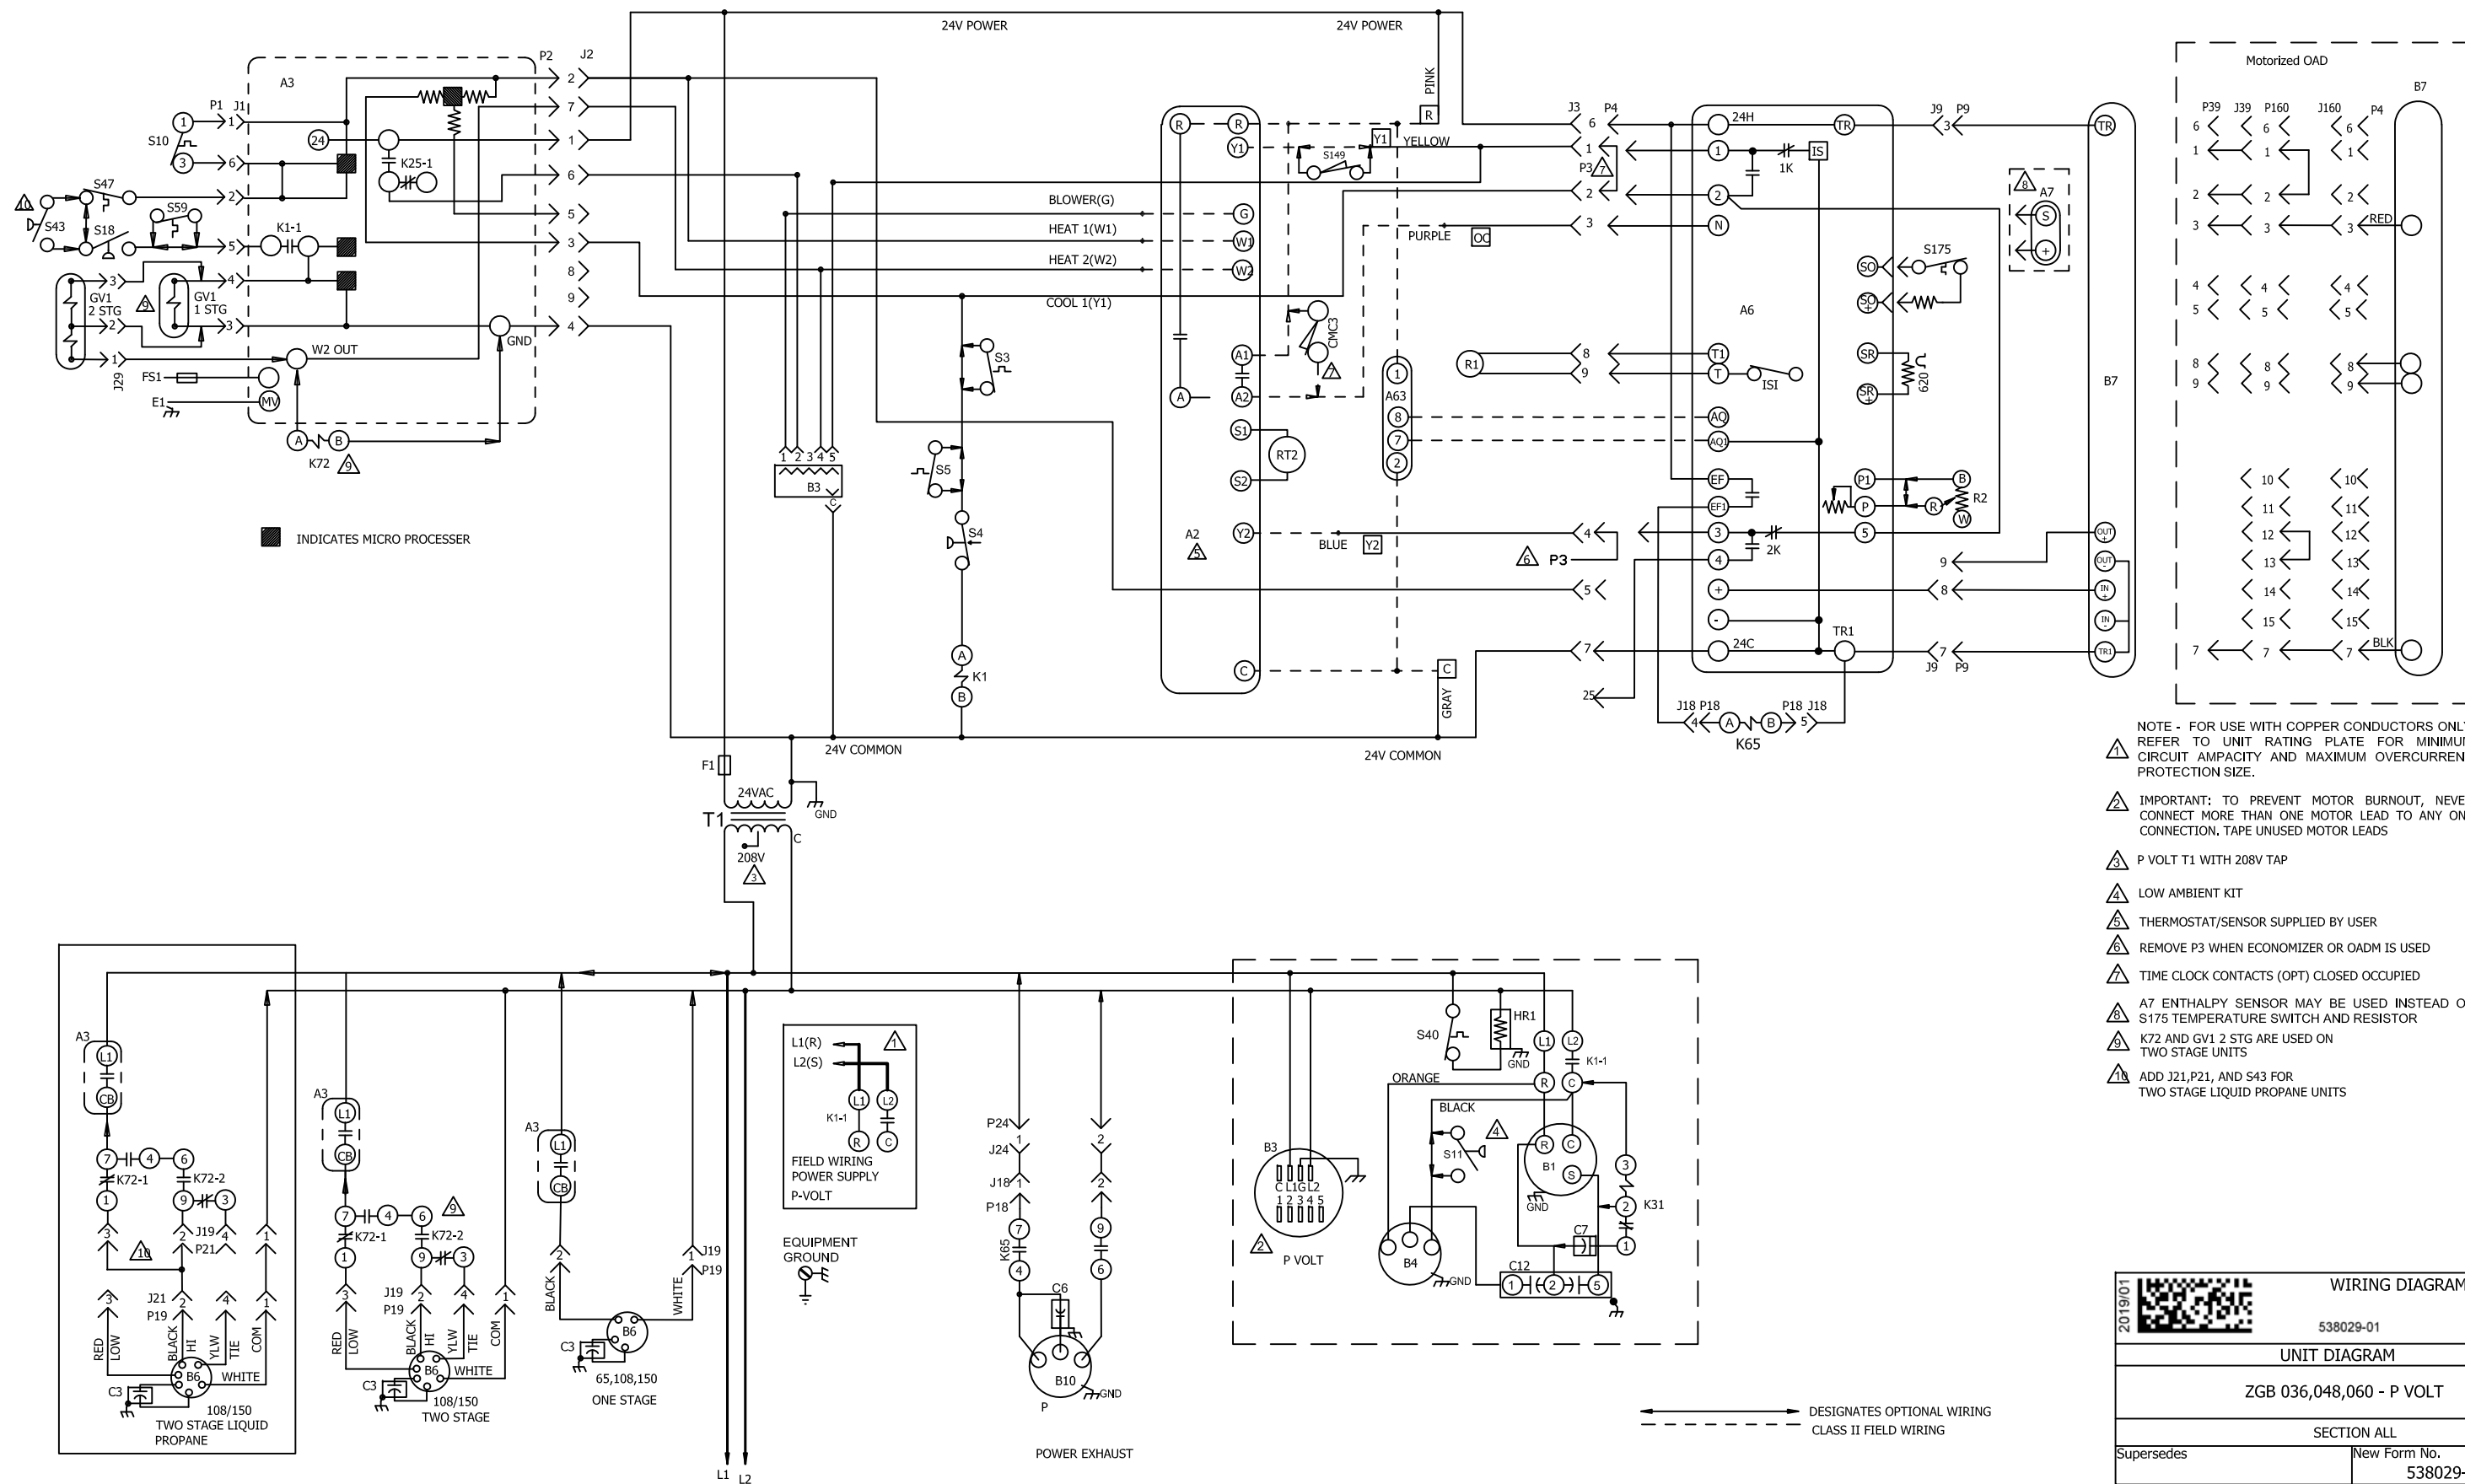

NOTE - FOR USE WITH COPPER CONDUCTORS ONLY
REFER TO UNIT RATING PLATE FOR MINIMUM
CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT
PROTECTION SIZE.

2 IMPORTANT: TO PREVENT MOTOR BURNOUT, NEVER CONNECT MORE THAN ONE MOTOR LEAD TO ANY ONE CONNECTION. TAPE UNUSED MOTOR LEADS

3 P VOLT T1 WITH 208V TAP

4 LOW AMBIENT KIT

5 THERMOSTAT/SENSOR SUPPLIED BY USER

 REMOVE P3 WHEN ECONOMIZER OR OADM IS USED

 TIME CLOCK CONTACTS (OPT) CLOSED OCCUPIED

 A7 ENTHALPY SENSOR MAY BE USED INSTEAD OF S175 TEMPERATURE SWITCH AND RESISTOR

 K72 AND GV1 2 STG ARE USED ON TWO STAGE UNITS

10 ADD J21,P21, AND S43 FOR
TWO STAGE LIQUID PROPANE UNITS

2019/01		WIRING DIAGRAM 538029-01	01/19
	UNIT DIAGRAM		
	ZGB 036,048,060 - P VOLT		
SECTION ALL		REV. 0	
Supersedes		New Form No. 538029-01	