

Job: _____
Location: _____
Schedule No.: _____
System Designation: _____

Engineer: _____
Architect: _____
Location: _____
Date: _____
For: ☐ Reference ☐ Approval ☐ Review ☐ Construction

Floor **Standing** Indoor Unit (**Exposed**)

FEATURES

- Easy Maintenance
- Advanced Commissioning and Service
- Refrigerant R-410A
- Five Capacity Sizes from 7,600 to 24,000 Btu/h

WARRANTY

- 10-year limited warranty.*See warranty for details.

SPECIFICATIONS

PERFORMANCE

Cooling Capacity ¹ (Btu/h)	18,000
Heating Capacity ¹ (Btu/h)	20,000
Airflow (CFM)	Low/Medium/High 390/495/550
External Static Pressure (in. w.g.)	-
Sound (dBA)	Low/Medium/High 32/36/40

ELECTRICAL DATA

Power Supply (Volts/Hertz/Phase)	208-230/60/1
Cooling Power Input (W)	110
Cooling Rated Current (A)	0.53
Heating Power Input (W)	110
Heating Rated Current (A)	0.53
Fan Motor Output (W)	10 x 1

DIMENSIONS

Unit Dimensions (in)	Width	57.05
	Height	23.62
	Depth	8.66
Liquid Pipe Connection (in) (I.D.)		1/4
Gas Pipe Connection (in) (I.D.)		1/2
Net Weight (lb)		69.4
Shipping Weight (lb)		80.5

OPTIONAL ACCESSORIES

VSTAT02P-1 Touch Screen Wired Controller	37P79
VSTAT04P-1 Individual Wired Controller	37Y74
VSTAT01P-1 Wireless Remote Controller	37Y73




NOTES

- Nominal capacity are based on (Refrigerant Piping : 25ft , Level Differences : 0ft);
.Cooling : Indoor temperature : 80°F DB, 67°F WB / Outdoor temperature : 95°F DB, 75°F WB
.Heating : Indoor temperature : 70°F DB, 60°F WB / Outdoor temperature : 47°F DB, 43°F WB
- Sound pressure was acquired in a dead room. Thus actual noise level may be different depending on the installation conditions.
- Specifications are subject to change without prior notice for product improvement.




DIMENSIONAL DRAWINGS - MM (IN.)

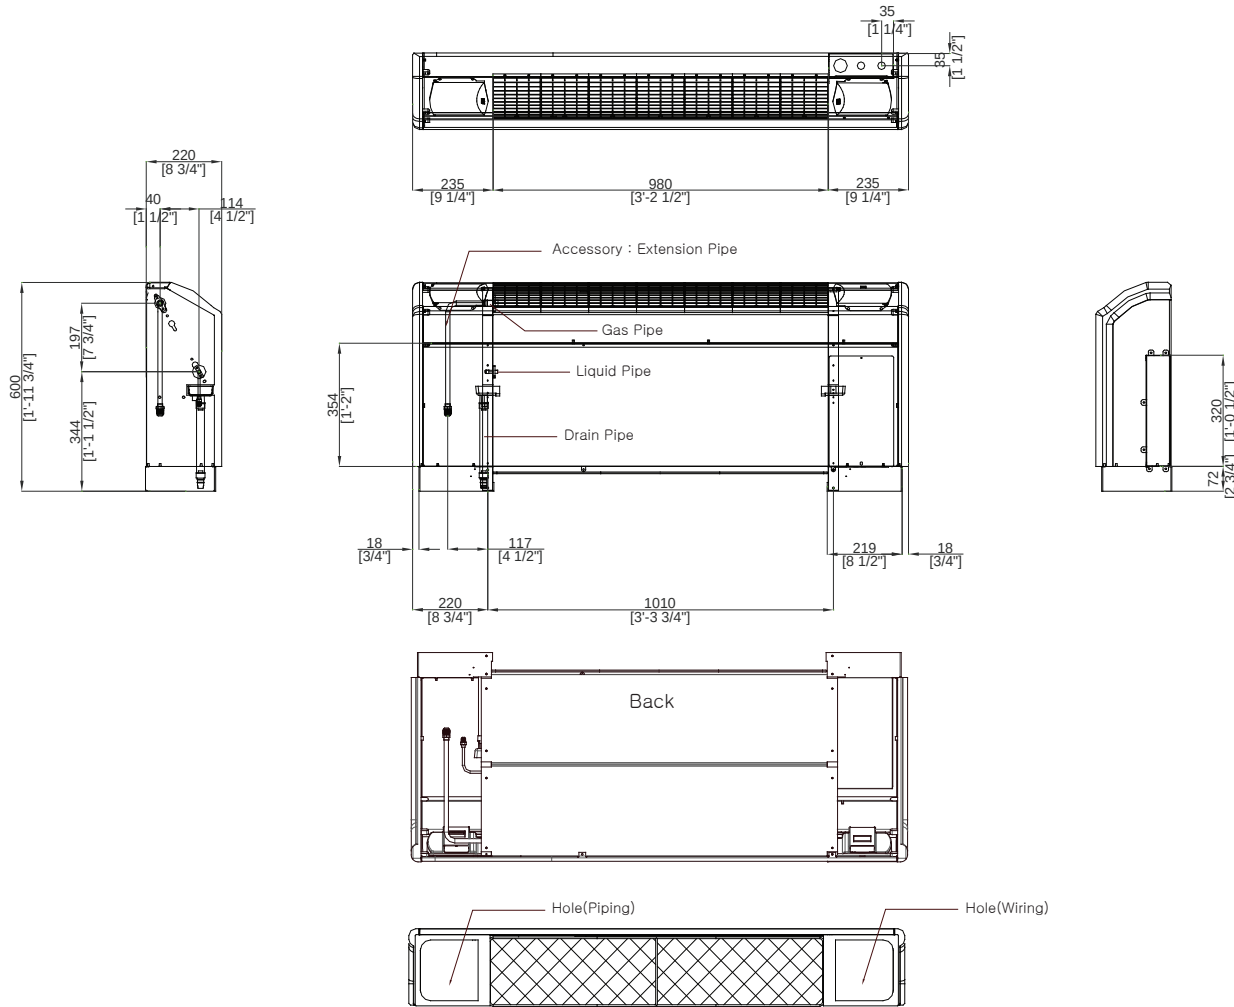

* Installation Guide

Unit: inch (mm)

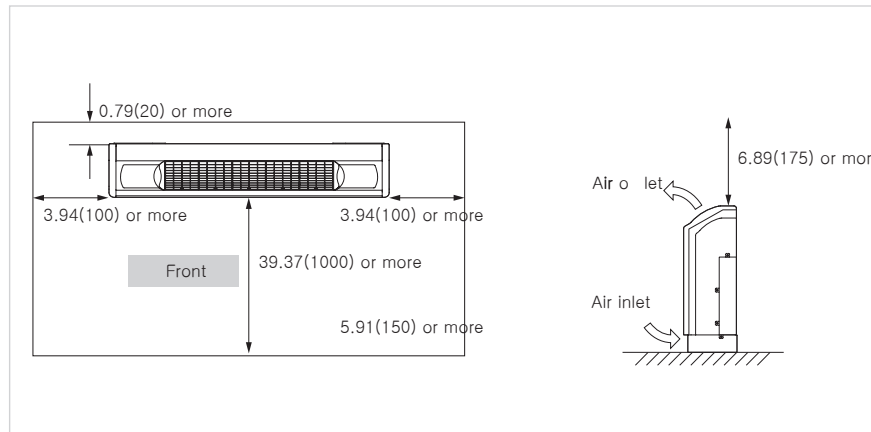

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

496290 (202412)

©2024 Lennox Industries Inc.