




CUT SIZE: 4" W x 7-5/8" H

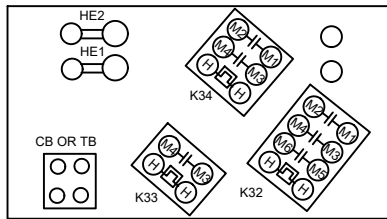

KEY	DESCRIPTION	COMPONENT
CB1	CIRCUIT BREAKER-ELECT HEAT	
HE1	ELEMENT-ELECTRIC HEAT 1	
HE2	ELEMENT-ELECTRIC HEAT 2	
K32	RELAY-ELECTRIC HEAT	
K33	RELAY-ELECTRIC HEAT	
K34	RELAY-ELECTRIC HEAT	
P2	PLUG-ELECTRIC HEAT	
S15	SWITCH-LIMIT PRIMARY ELECT HEAT	
S20	SWITCH-LIMIT SECONDARY ELECT HEAT	
TB2	TERMINAL STRIP-UNIT	

NOTE: USE COPPER CONDUCTORS ONLY

- REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
- CONNECT POWER WIRES FROM UNIT LABELED L1 AND L2 TO TB2 TERMINAL STRIP ON HEATER PLATE
- EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

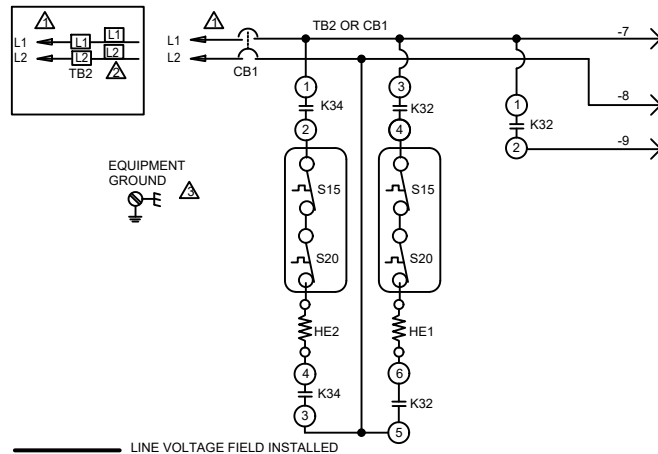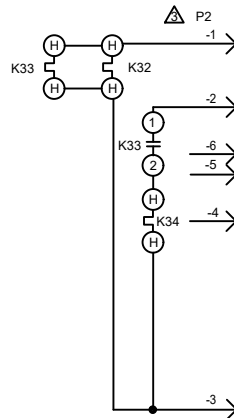


LINE VOLTAGE FIELD INSTALLED

HEATING UNITS-ELECTRIC	
ECB47-9-P,9CB-P	
Supersedes	
03/24	Form No. 538455-01

© 2011



Litho U.S.A.

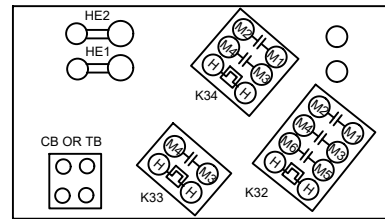

KEY	DESCRIPTION	COMPONENT
CB1	CIRCUIT BREAKER-ELECT HEAT	
HE1	ELEMENT-ELECTRIC HEAT 1	
HE2	ELEMENT-ELECTRIC HEAT 2	
K32	RELAY-ELECTRIC HEAT	
K33	RELAY-ELECTRIC HEAT	
K34	RELAY-ELECTRIC HEAT	
P2	PLUG-ELECTRIC HEAT	
S15	SWITCH-LIMIT PRIMARY ELECT HEAT	
S20	SWITCH-LIMIT SECONDARY ELECT HEAT	
TB2	TERMINAL STRIP-UNIT	

NOTE: USE COPPER CONDUCTORS ONLY

- REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
- CONNECT POWER WIRES FROM UNIT LABELED L1 AND L2 TO TB2 TERMINAL STRIP ON HEATER PLATE
- EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

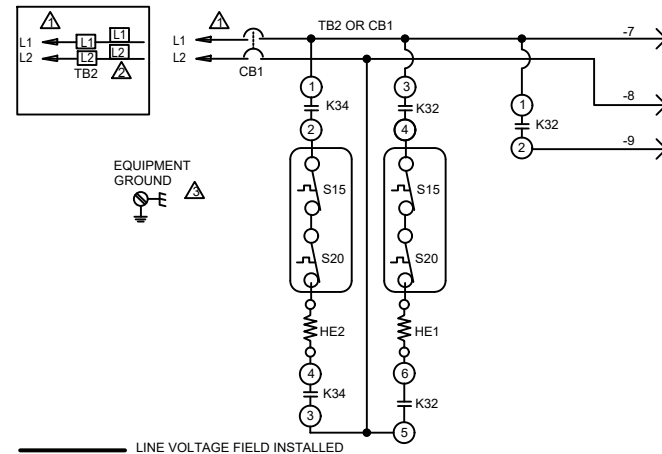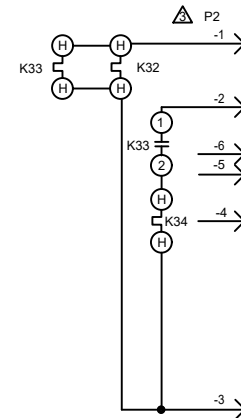

LINE VOLTAGE FIELD INSTALLED

HEATING UNITS-ELECTRIC	
ECB47-9-P,9CB-P	
Supersedes	
03/24	Form No. 538455-01

© 2011

Litho U.S.A.