


- 1** NOTE-FOR USE WITH COPPER CONDUCTORS ONLY.
REFER TO UNIT RATING PLATE FOR MINIMUM CIRCUIT
AMOCITY AND MAXIMUM OVERCURRENT PROTECTION SIZE
- 2** NOTE-IF ANY WIRE IN THIS APPLIANCE IS
REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE
SIZ, RATING,INSULATION THICKNESS AND TERMINATION
- 3** S41 TO BE MOUNTED IN CONTROL BOX AND WIRED
IN PARALLEL WITH LOW PRESSURE SWITCH
- 4** S173 SWITCH USED ONLY IN UNITS EQUIPPED
WITH COMPRESSORS WHICH DO NOT INCLUDE
INTERNAL SWITCH
- 5** L34 SOLENOID IS LOCATED IN COMPRESSOR COIL IS 24VDC.
DO NOT CONNECT 24VAC TO COIL TERMINALS.

DESCRIPTION	
KEY	COMPONENT
B1	COMPRESSOR
B4	MOTOR-OUTDOOR FAN
C12	CAPACITOR-DUAL
CMC1	CONTROL-DEFROST
D4	DIODE BRIDGE
HR1	HEATER-COMPRESSOR
K1,-1	CONTACTOR-COMPRESSOR
L1	VALVE-REVERSING
S4	SWITCH-HIGH PRESSURE
S6	SWITCH-DEFROST
S40	THERMOSTAT-CRANKCASE
S41	THERMOSTAT-LOW AMBIENT
S87	SWITCH-LOW PRESS. COMP 1
S173	SWITCH-THERMAL PROTECTION

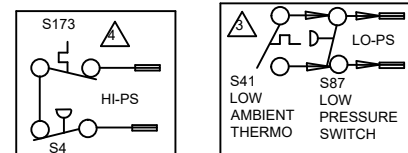

 LINE VOLTAGE FIELD INSTALLED
 CLASS II VOLTAGE FIELD WIRING

DENOTES OPTIONAL COMPONENTS

TWO SPEED HEAT PUMPS

Supersedes

11/25



Form No.
538650-01