

Job Name: \_\_\_\_\_  
 Purchaser: \_\_\_\_\_  
 Submitted to: \_\_\_\_\_  
 Unit designation: \_\_\_\_\_

Location: \_\_\_\_\_  
 Engineer: \_\_\_\_\_  
 Reference: Approval      Construction  
 Schedule #: \_\_\_\_\_



Product image for 4 port shown

Mode Selection Box (MSB) are required for VRF Heat Recovery systems, enabling simultaneous heating and cooling while supporting refrigerant leak mitigation.

- trigger alarms, activate ventilation fans, or perform other actions in response to refrigerant leak detection.
- Emergency power supply stores electrical charge in capacitors to ensure shutoff valves closes automatically in the event of power outage.
- Release mitigation function that conducts individual port pump-down operation when leak is detected at a connected indoor unit, prior to closing off the shut-off valve for that port.
- Meets ETRS requirements, ensuring superior system integrity, leak prevention, and compliance with A2L safety standards.

**Controls**

- Control wiring shall be 16 AWG x 2 shielded wire.
- The unit shall be operated via a DDC type signal.
- The unit shall support auto pairing.

**Compatibility**

- The Mode Selection Box shall be compatible with R-32 VRF Heat Recovery Systems.

**Operation**

- The unit shall allow for simultaneous heating and cooling on a single system.
- The MSB shall have a pressure equalization valve (480 steps) to reduce refrigerant sounds during mode changing of connected indoor units.
- Using solenoid valves, the MSB shall control the path of refrigerant to the indoor unit(s) based on the mode of operation required.
- The unit shall contain an internal subcooler with an electronic expansion valve to maximize performance of connected units and reduce refrigerant sounds.

**Construction and Installation**

- Cabinet shall be constructed of galvanized steel.
- Most internal components shall be accessible for service via a bottom access panel. The PCB and wiring shall be accessible from the rear.
- MSB shall be installed indoors, level, with refrigerant piping entering and exiting in a horizontal orientation.
- No condensate drain connection shall be required.


**Refrigerant Leak Mitigation**

**The MSB (Mode Selection Box) shall be equipped with:**


- Refrigerant Detection Sensors (RDS) to continuously monitor and respond to potential refrigerant leaks within or in proximity to the unit.
- Shut-off valve at each outlet port to enable isolation of the downstream refrigerant circuit upon leak detection.
- Exhaust and inlet air duct connections to ventilate the MSB enclosure as required based on project application and regulatory needs. Block off plates shall be provided to cap off opening if not needed.
- Contact output signal for external exhaust fan upon leak detection to create negative pressure at the MSB for ventilation.
- R-32 alarm output terminals for integration with external systems to

## Key Components MSB

Key components of 4-port MSB is shown below.

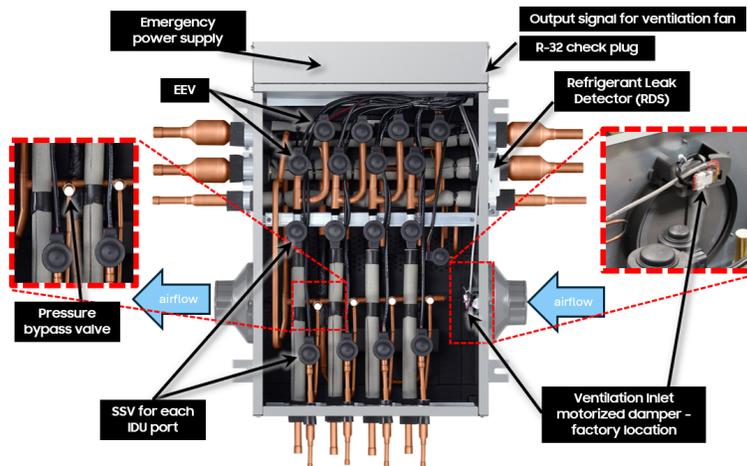


## Accessory Y- Joint - Combining Two Ports

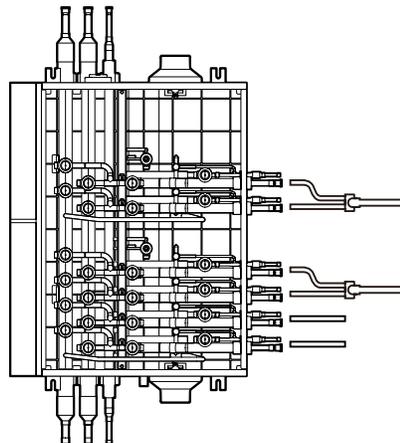

Y-joint accessory V1MSBP01HR is needed to connect to an indoor unit  $> 54,000$  Btu/h and  $\leq 108,000$  Btu/h. Twinned ports cannot connect to multiple indoor units.

## MSB Series Connection

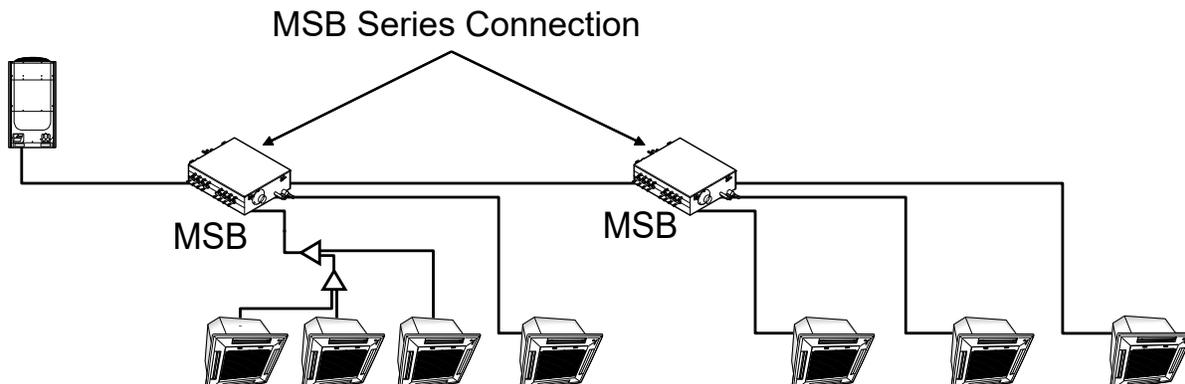




## SPECIFICATIONS V2MSBB04HR

Model Name		V2MSBB04HR		
Power Supply	Φ, V, Hz	1/208~230/60		
Mode	-	HEAT RECOVERY		
Maximum number of connectable indoor units	EA	32		
Number of branches	EA	4		
Maximum capacity of connectable indoor units	Btu/h	216,000		
Maximum capacity of connectable indoor units per branch	-	Btu/h	54,000	
	Y-Joint	Btu/h	108,000	
Electrical	MCA	A	0.5	
	MOP	A	15	
Sound Pressure	Stable cooling Operation	dB(A)	38	
	Heating-to-Cooling Change over		38	
Additional refrigerant charging	kg/unit	0.3		
Ventilation	Duct Connection	Φ, inch	4.0	
Piping Connections	Outdoor unit	Liquid Pipe	Φ, inch	5/8
		Gas Pipe	Φ, inch	7/8
		Discharge gas	Φ, inch	7/8
	Indoor unit	Liquid Pipe	Φ, inch	3/8
		Gas Pipe	Φ, inch	5/8
External Dimension	Net Weight	lbs	66	
	New Dimensions (WxHxD)	inch	19-3/8 × 10-11/16 × 30-11/16	
Operating Limit	Cooling	°F	5~126*	
	Heating	°F	-22~75.2	

\*If continuous cooling operation is required at outdoor temperatures below 23°F (-5°C), enable the outdoor option "Expand operational temperature range for cooling operation (HR only)". With this option enabled, continuous cooling is supported down to 5°F (-15°C). For indoor unit capacities of 18–54 kBtu/h, connect 2 ports using a Y-joint on the liquid and gas pipes.

# DIMENSIONAL DRAWING V2MSBB04HR

Unit: Inches

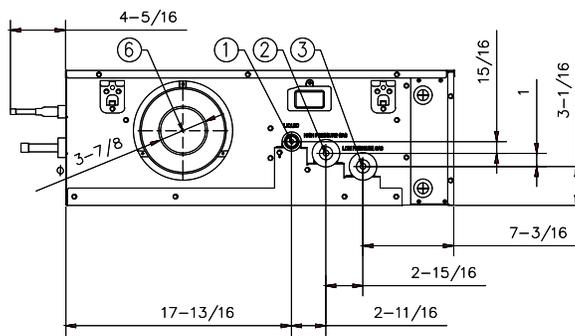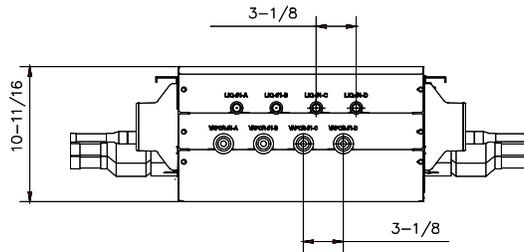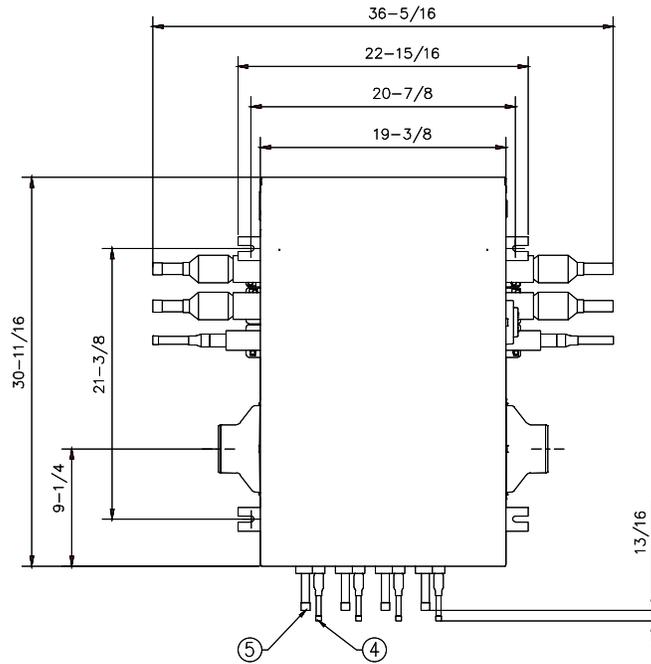

No	Name	Description
1	Refrigerant Liquid Pipe	-
2	Refrigerant High Pressure Gas Pipe	-
3	Refrigerant Low Pressure Gas Pipe	-
4	LIQ (Indoor)	-
5	VAPOR (Indoor)	-
6	Duct	Φ4