


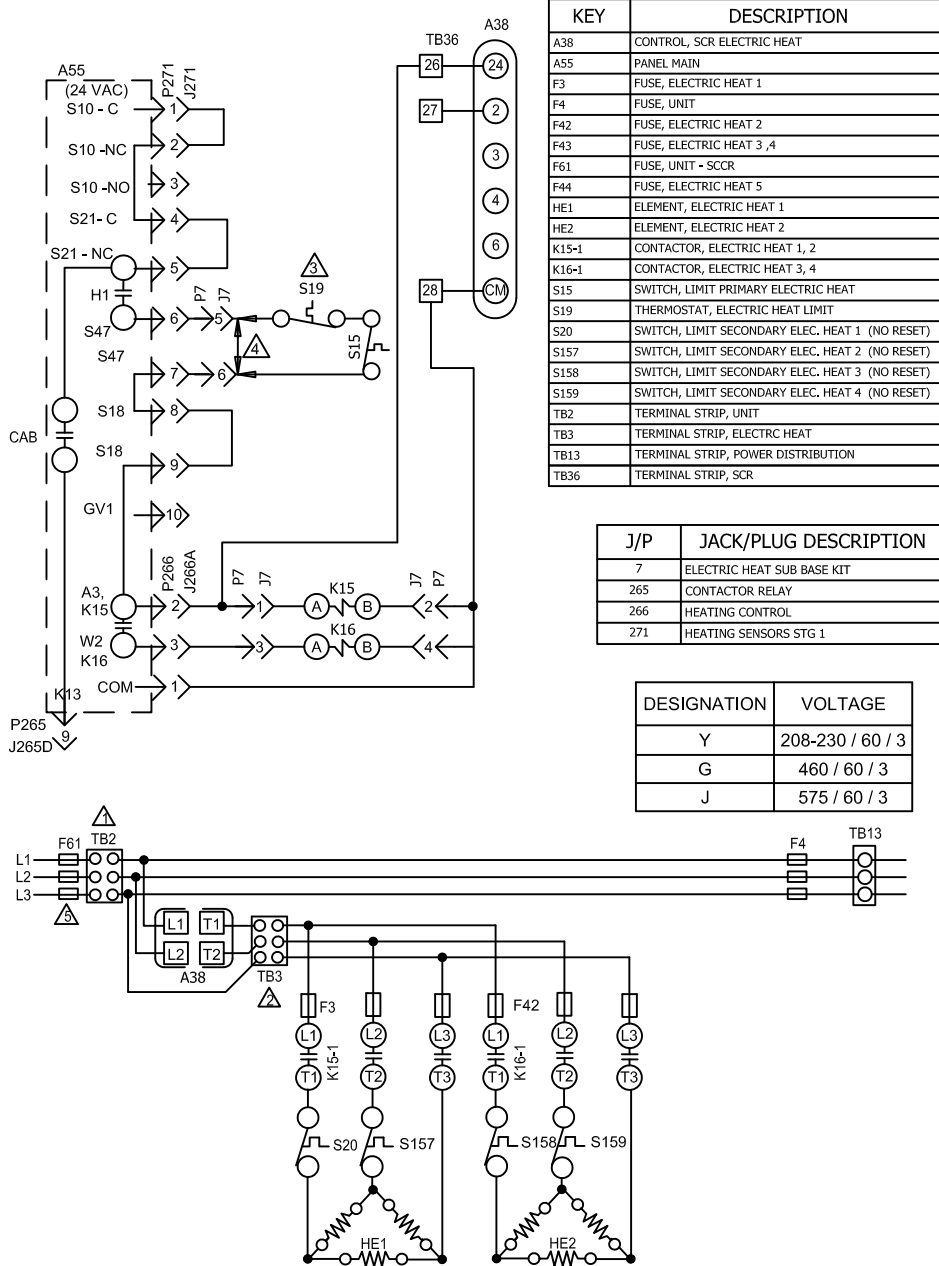

- ⚠ TB2, S48 OR CB10 MAY BE USED
 ⚠ TB3 IS USED ON SOME UNITS
 ⚠ S19 IS USED ON HEAT PUMP APPLICATIONS ONLY
 ⚠ REMOVE JUMPER PLUG WHEN FIELD INSTALLING ELECTRIC HEAT
 ⚠ F61 USED ON UNITS WITH SCCR OPTION

← DENOTES OPTIONAL COMPONENTS

		SCR AMPS	
KW	HE1	HE2	
15	15		40
30	15	15	75
7.5	7.5		30
22.5	15	7.5	50

2018/11		ENERGENCE B-BOX WIRING DIAGRAM 537687-02	11/18
		HEATING - ELECTRIC	
		SCR ELECTRIC HEAT - THIRD PARTY CONTROLLED 7.5, 15, 22.5, 30 - Y	
		SECTION A	REV 0
Supersedes 537687-01		New Form No. 537687-02	