



KEY	DESCRIPTION
CB1	CIRCUIT BREAKER-ELECT HEAT
HE1	ELEMENT-ELECTRIC HEAT 1
HE2	ELEMENT-ELECTRIC HEAT 2
HE3	ELEMENT-ELECTRIC HEAT 3
K1	CONTACTOR
P2	PLUG-ELECTRIC HEAT
S15	SWITCH-LIMIT,PRIMARY,ELECT HEAT
S20	SWITCH-LIMIT,SECONDARY,ELECT HEAT

- NOTE: USE COPPER CONDUCTORS ONLY
- ⚠ REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
- ⚠ EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

NOTE-USE 50 AMP CIRCUIT BREAKER

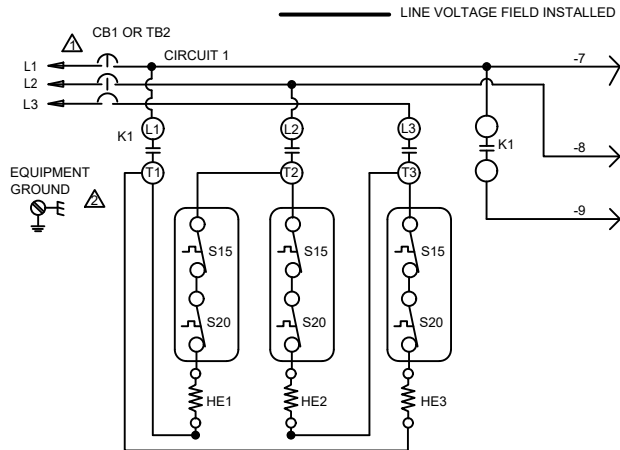


HEATING-ELECTRIC	
ECB47-8-Y,-10-Y,-15CB-Y	
Supersedes	
03/24	Form No. 538459-01

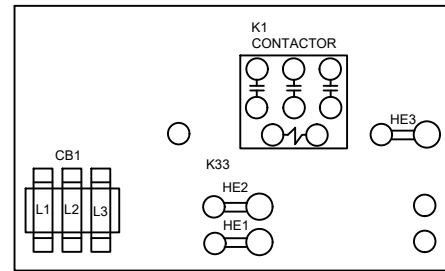

KEY	DESCRIPTION
CB1	CIRCUIT BREAKER-ELECT HEAT
HE1	ELEMENT-ELECTRIC HEAT 1
HE2	ELEMENT-ELECTRIC HEAT 2
HE3	ELEMENT-ELECTRIC HEAT 3
K1	CONTACTOR
P2	PLUG-ELECTRIC HEAT
S15	SWITCH-LIMIT,PRIMARY,ELECT HEAT
S20	SWITCH-LIMIT,SECONDARY,ELECT HEAT

- NOTE: USE COPPER CONDUCTORS ONLY
- ⚠ REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
- ⚠ EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

NOTE-USE 50 AMP CIRCUIT BREAKER

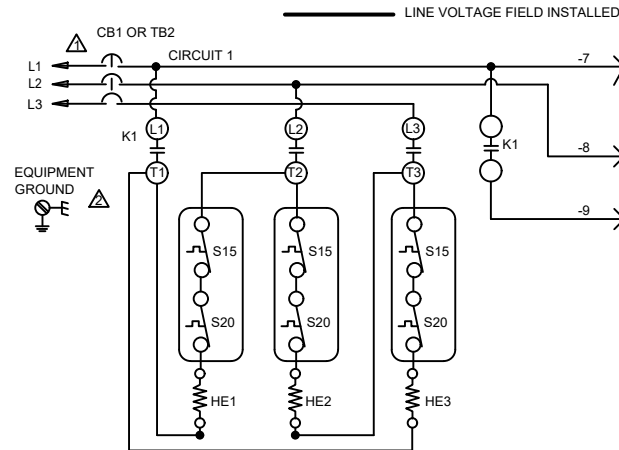

HEATING-ELECTRIC	
ECB47-8-Y,-10-Y,-15CB-Y	
Supersedes	
03/24	Form No. 538459-01