


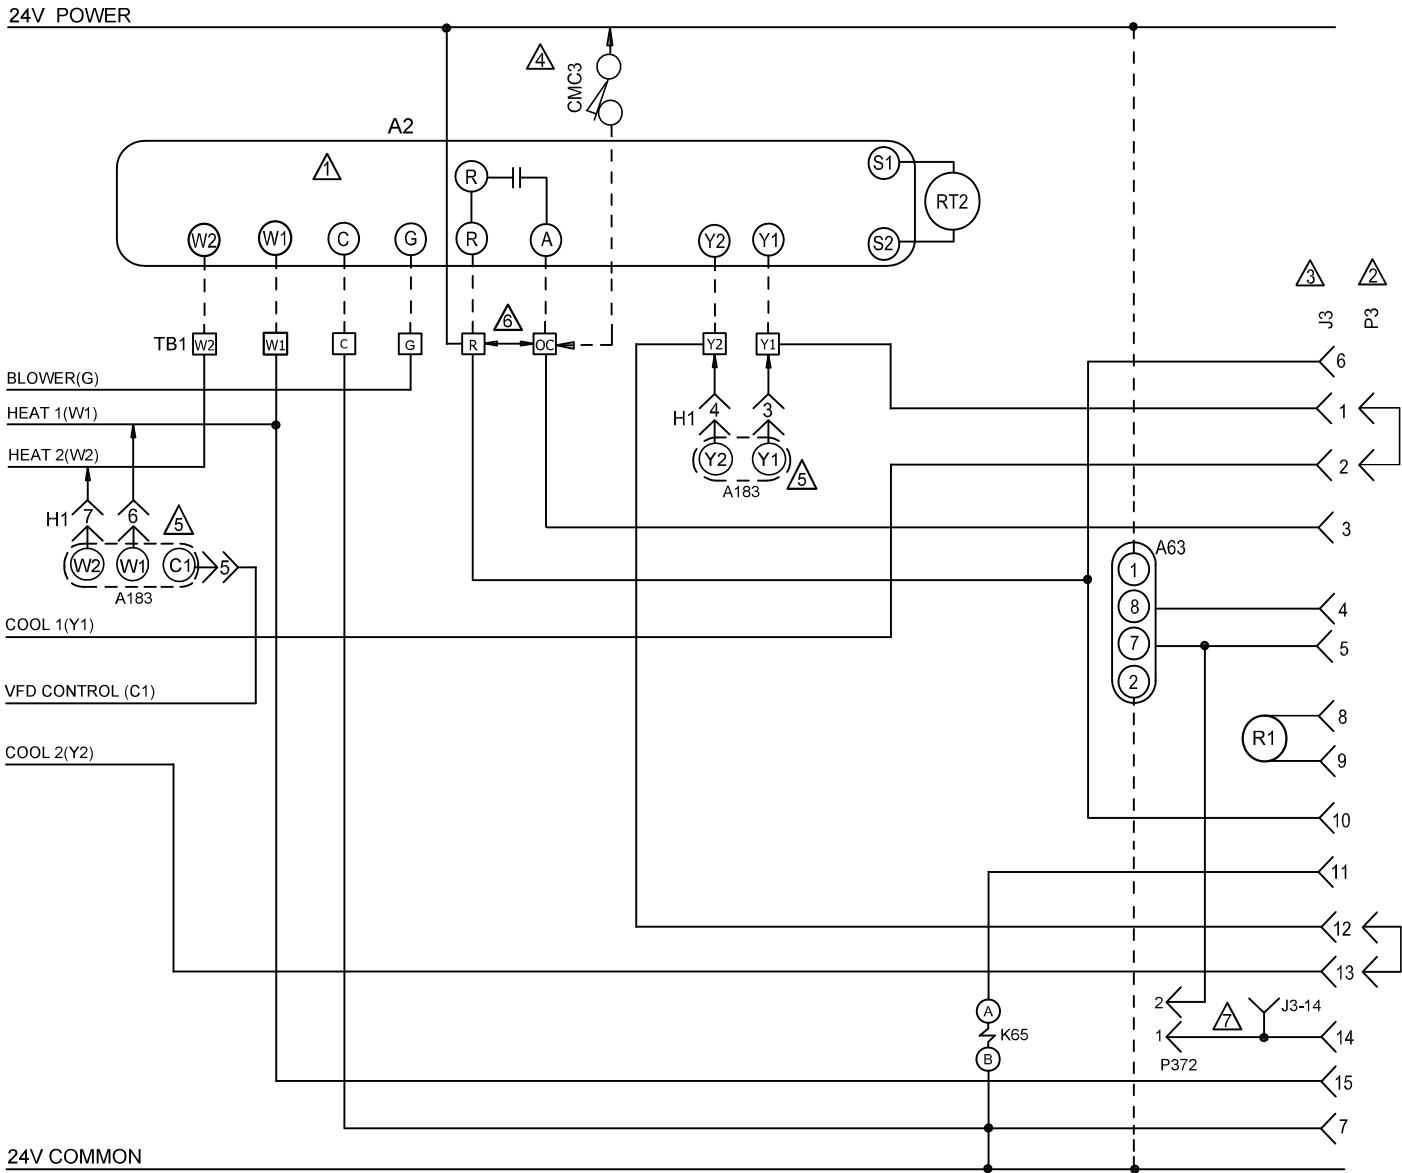

KEY	COMPONENT
A2	SENSOR, THERMOSTAT
A63	SENSOR, CO2
A183	CONTROL, VFD BOARD
CMC3	CLOCK, TIME
H1	HEADER 1 ON VFD BOARD
J3	JACK, UNIT ECONOMIZER
K65	RELAY, EXHAUST FAN
P3	PLUG, LESS ECONOMIZER
P372	PLUG, BACNET/JADE ALARM
R1	SENSOR, MIXED/SUPPLY AIR
RT2	SENSOR, REMOTE THERMOSTAT
TB1	TERMINAL STRIP, THERMOSTAT

- THERMOSTAT SUPPLIED BY USER
- REMOVE P3 WHEN ECONOMIZER IS USED
- J3 MAXIMUM LOAD 20VA 24VAC CLASS II
- TIME CLOCK CONTACTS (OPTIONAL) CLOSED OCCUPIED
- A183 IS USED ON UNITS WITH VFD ONLY
- REMOVE JUMPER BETWEEN TB1-R AND TB1-OC WHEN USING A NITE SETBACK THERMOSTAT
- P372 USED FOR ALARM FEEDBACK SIGNAL FOR UNITS EQUIPPED WITH JADE ECONOMIZER CONTROL AND BACNET, TITLE 24 APPLICATION

— — — CLASS II FIELD WIRING
— — — DESIGNATES OPTIONAL WIRING

2018/07		WIRING DIAGRAM	18/07
		537641-02	
CONTROL			
ELECTRONIC/ELECTROMECHANICAL THERMOSTAT			
SECTION C			REV 0
Supersedes 537641-01, 537642-01		Form No. 537641-02	