

SUBMITTAL DATA – **ACCESSORY** **M1LRDS01**




R-32 LEAK DETECTOR ACCESSORY

Job: _____
 Location: _____
 Schedule No.: _____
 System Designation: _____

Engineer: _____
 Architect: _____
 Date: _____
 For: ☐ Reference ☐ Approval ☐ Review ☐ Construction

General Information:

- Accessory R32 leak detector for Mini-Spit ducted units
- When a leak is detected, the indoor unit will activate leak mitigation sequence of operations.
- Installs on the side of the ducted unit and plugs into the indoor unit control PCB (the indoor unit must be configured to for the leak detector to be enabled).

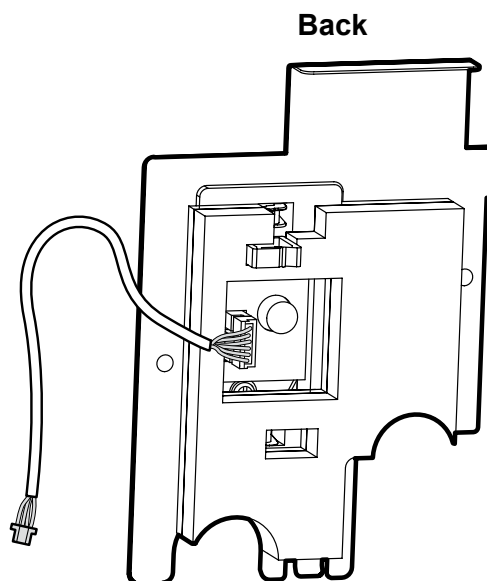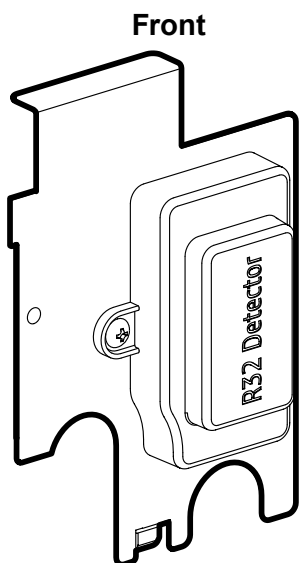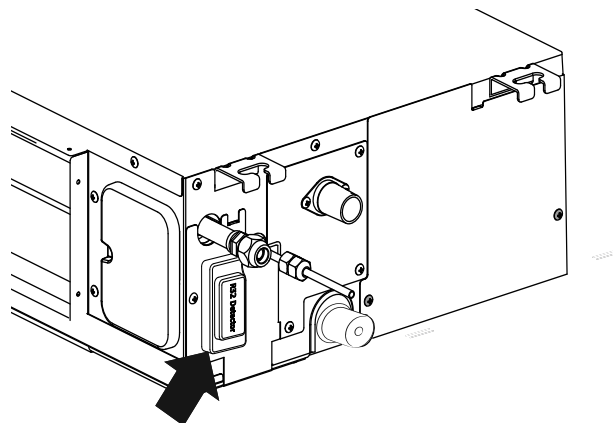

NOTE – Due to Lennox' ongoing commitment to quality, Specifications, Ratings, and Dimensions are subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.