


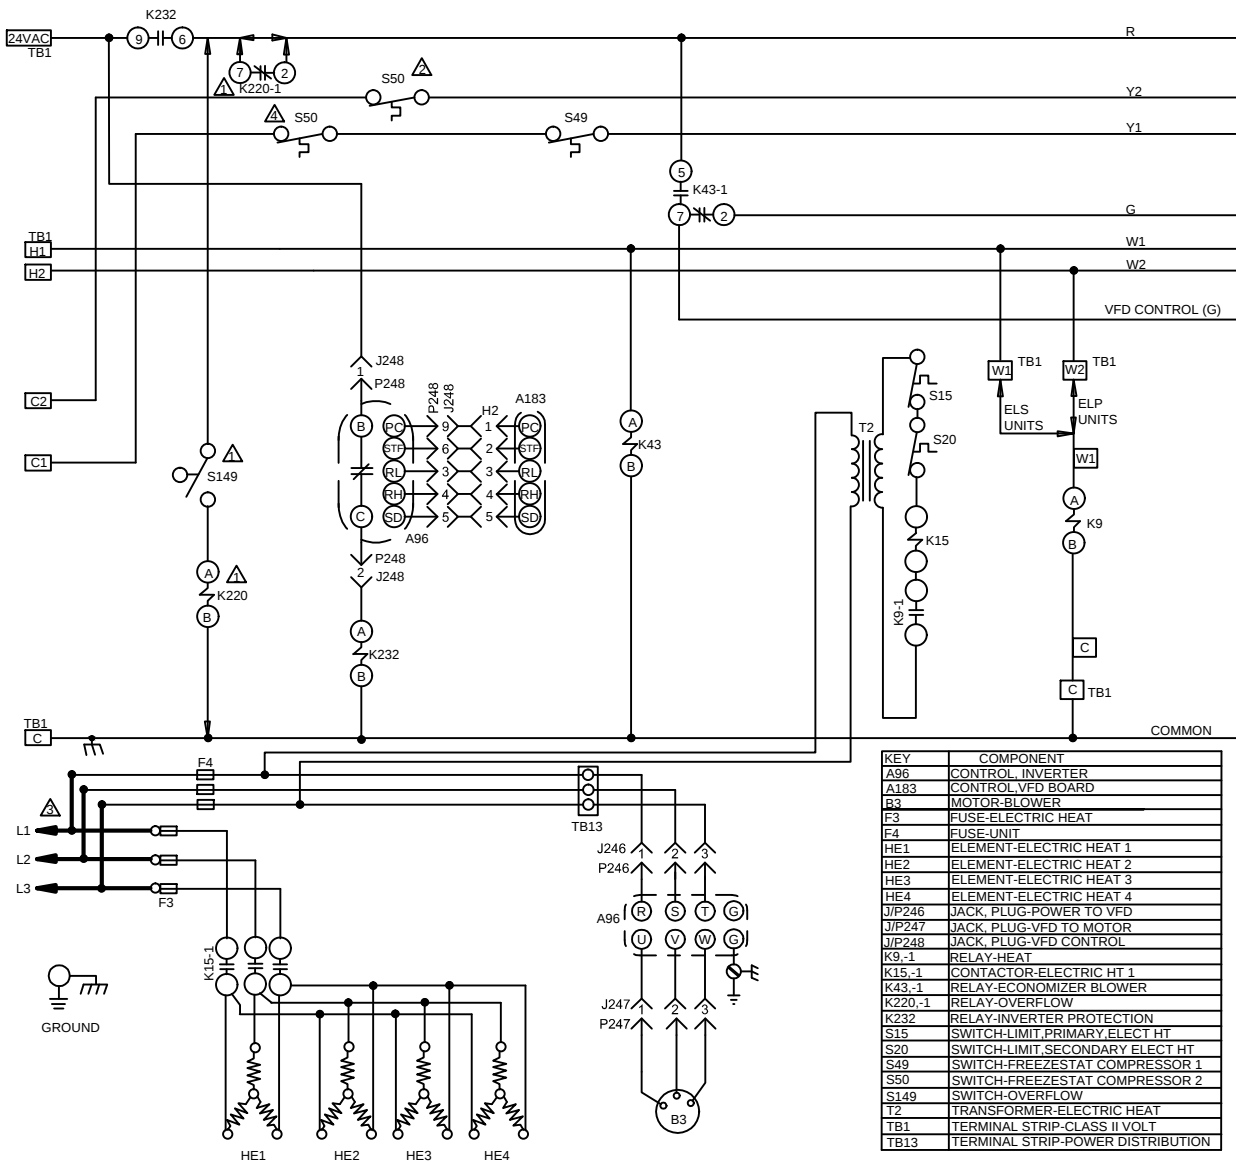

IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING

- ⚠ S149 SWITCH AND K220 RELAY MAY BE FIELD SUPPLIED OR USE AVAILABLE KIT
- ⚠ S50 LOCATION ON UNITS WITH TWO SINGLE SPEED COMPRESSORS
- ⚠ USE COPPER CONDUCTORS ONLY
- ⚠ S50 LOCATION ON UNITS WITH ONE DUAL SPEED COMPRESSOR

- LINE VOLTAGE FIELD INSTALLED
- DENOTES OPTIONAL COMPONENTS

	KW	HE1	HE2	HE3	HE4
180,240					
600V	20	10	10		
	30	15	15		
480V	40	10	10	10	10
	20	10	10		
	30	7.5	7.5	7.5	7.5
	40	10	10	10	10

10/17		WIRING DIAGRAM	10/17
537926-01			
HEATING - ELECTRIC			
T3EH - ELA 180,240 UNITS - G,J,M 20,30,40KW			
SECTION B3			REV 0
Supersedes		New Form No.	
		537926-01	