


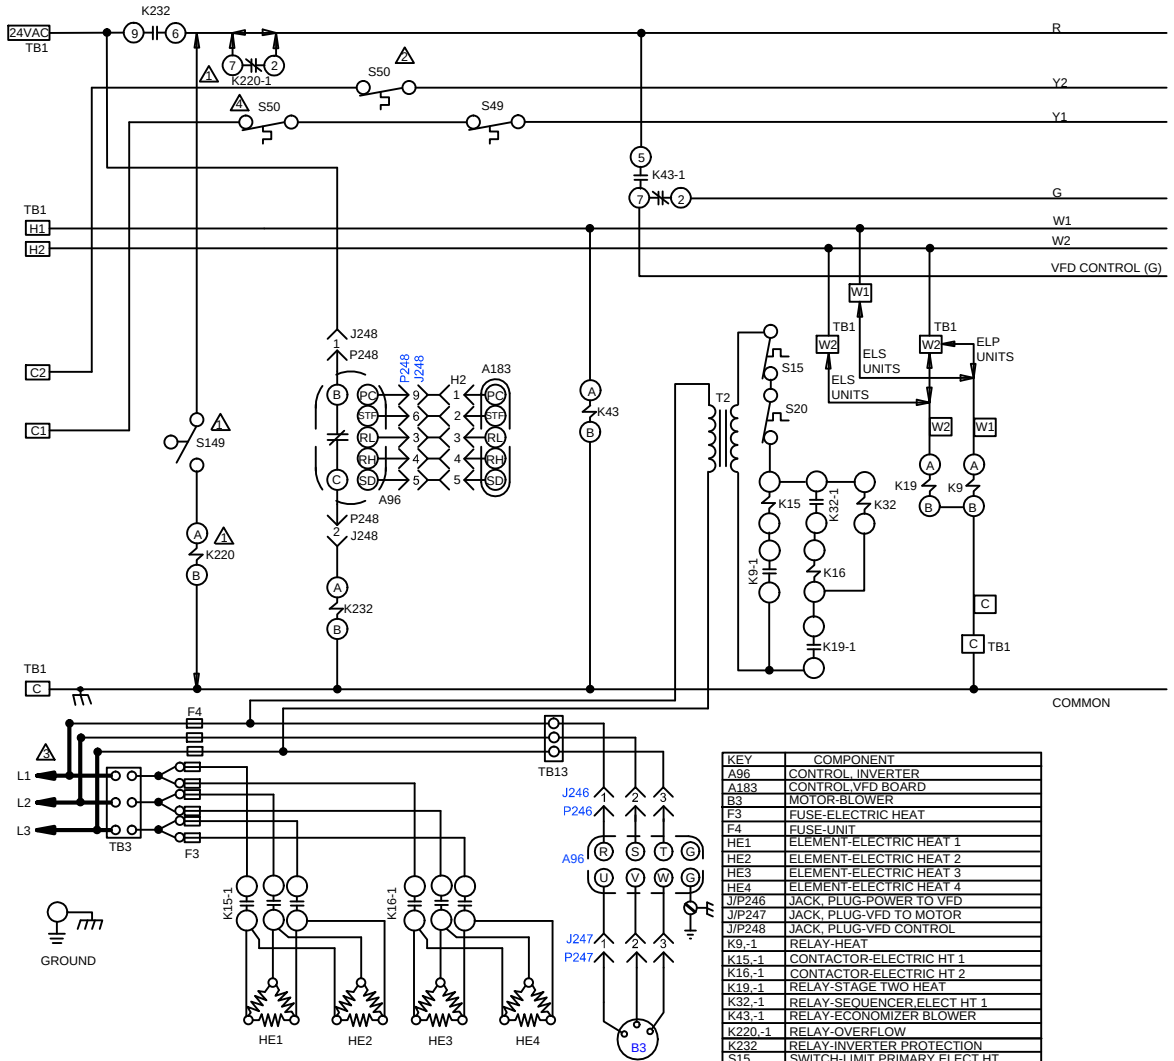

- ⚠ S149 SWITCH AND K220 RELAY MAY BE FIELD SUPPLIED OR USE AVAILABLE KIT
 ⚠ S50 LOCATION ON UNITS WITH TWO SINGLE SPEED COMPRESSORS
 ⚠ USE COPPER CONDUCTORS ONLY
 ⚠ S50 LOCATION ON UNITS WITH ONE DUAL SPEED COMPRESSOR

IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUND IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING

180, 240	KW	HE1	HE2	HE3	HE4
50	12.5	12.5	12.5	12.5	

- LINE VOLTAGE FIELD INSTALLED
 — DENOTES OPTIONAL COMPONENTS

10/17		WIRING DIAGRAM	10/17
		537925-01	
	HEATING - ELECTRIC		
	T3EH-ELA 180,240 UNITS - G,J,M		
SECTION B3			REV 0
Supersedes		New Form No. 537925-01	