



3/13/2018 2:42:16 AM, 7X10

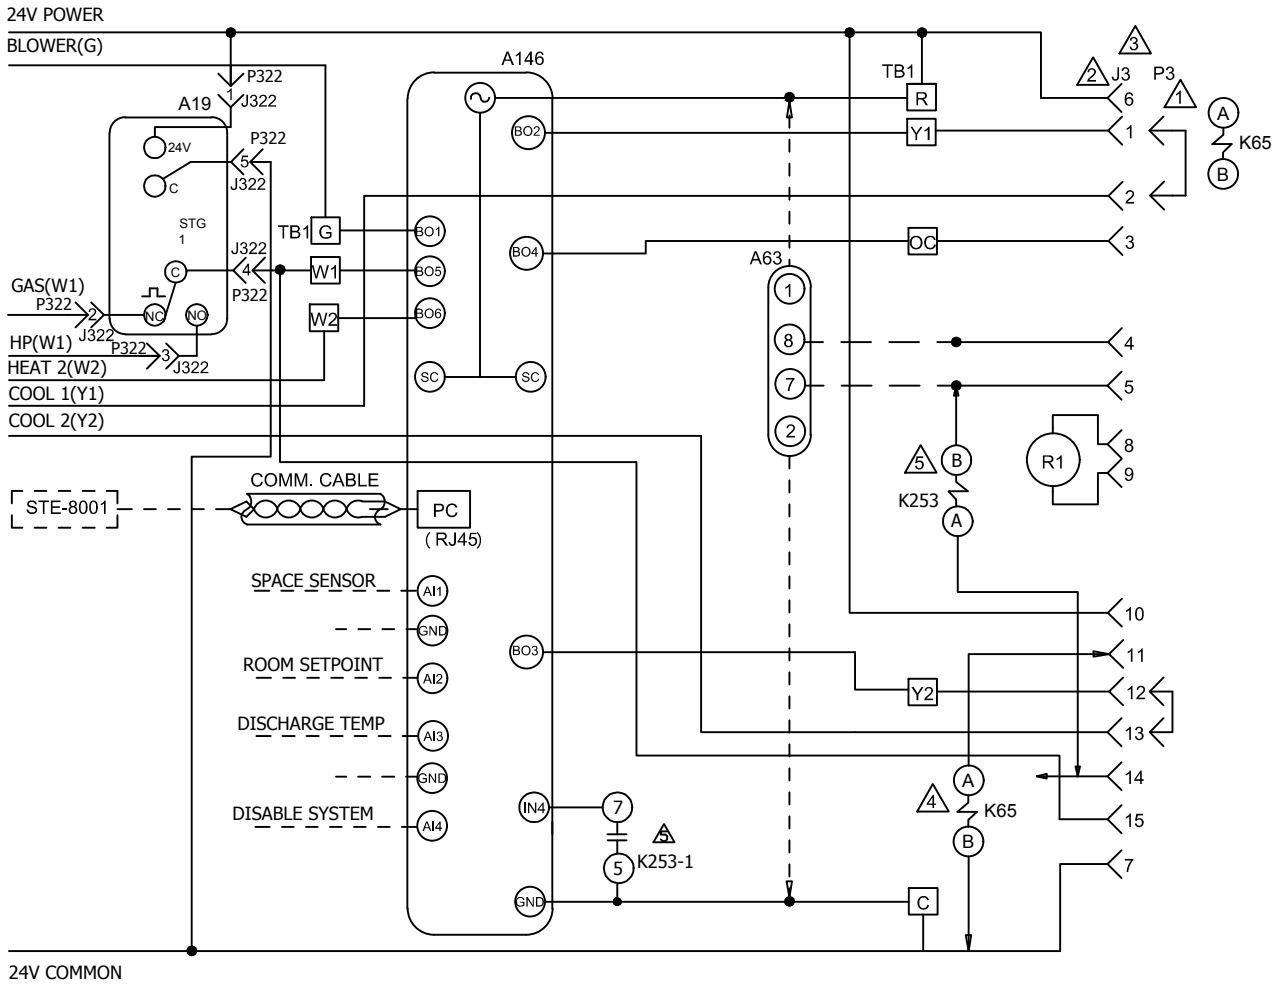

KEY	COMPONENT
A146	CONTROL, BACNET
A63	SENSOR, CO2
A19	THERMOSTAT, ELECTRONIC OUTDOOR
J/P3	JACK/PLUG, ECONOMIZER OR BYPASS
J/P322	JACK/PLUG, A19 OUTDOOR THERMOSTAT
K65	RELAY, EXHAUST FAN
K253	RELAY, ECON FOD
R1	SENSOR, MIXED AIR OR SUPPLY AIR
TB1	TERMINAL STRIP, CLASS II VOLTAGE

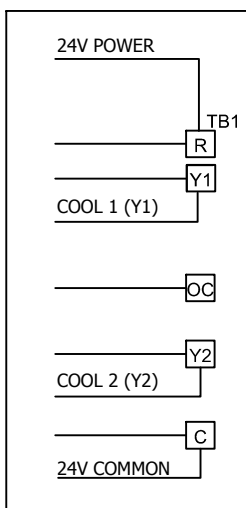

- 1 REMOVE P3 WHEN ECONOMIZER IS USED
- 2 J3 MAXIMUM LOAD 20VA 24VAC CLASS II
- 3 J3/P3 ARE NOT USED ON KDB UNITS WITHOUT ECONOMIZER
- 4 092-122 UNITS ONLY

- 4 CONNECTION SCHEME FOR KDB UNITS WITHOUT ECONOMIZER ONLY
 - 5 ONLY USED ON UNITS WITH JADE (W7220 ECONOMIZER CONTROL)

 DENOTES OPTIONAL COMPONENTS
 CLASS II FIELD WIRING

03/18		WIRING DIAGRAM	03/18
		537861-02	
CONTROLS - KDB			
CONTROL FOR BACNET MODULE (CAV A,A+, B BOX)			
SECTION C			REV 0
Supersedes		New Form No. 537861-02	