


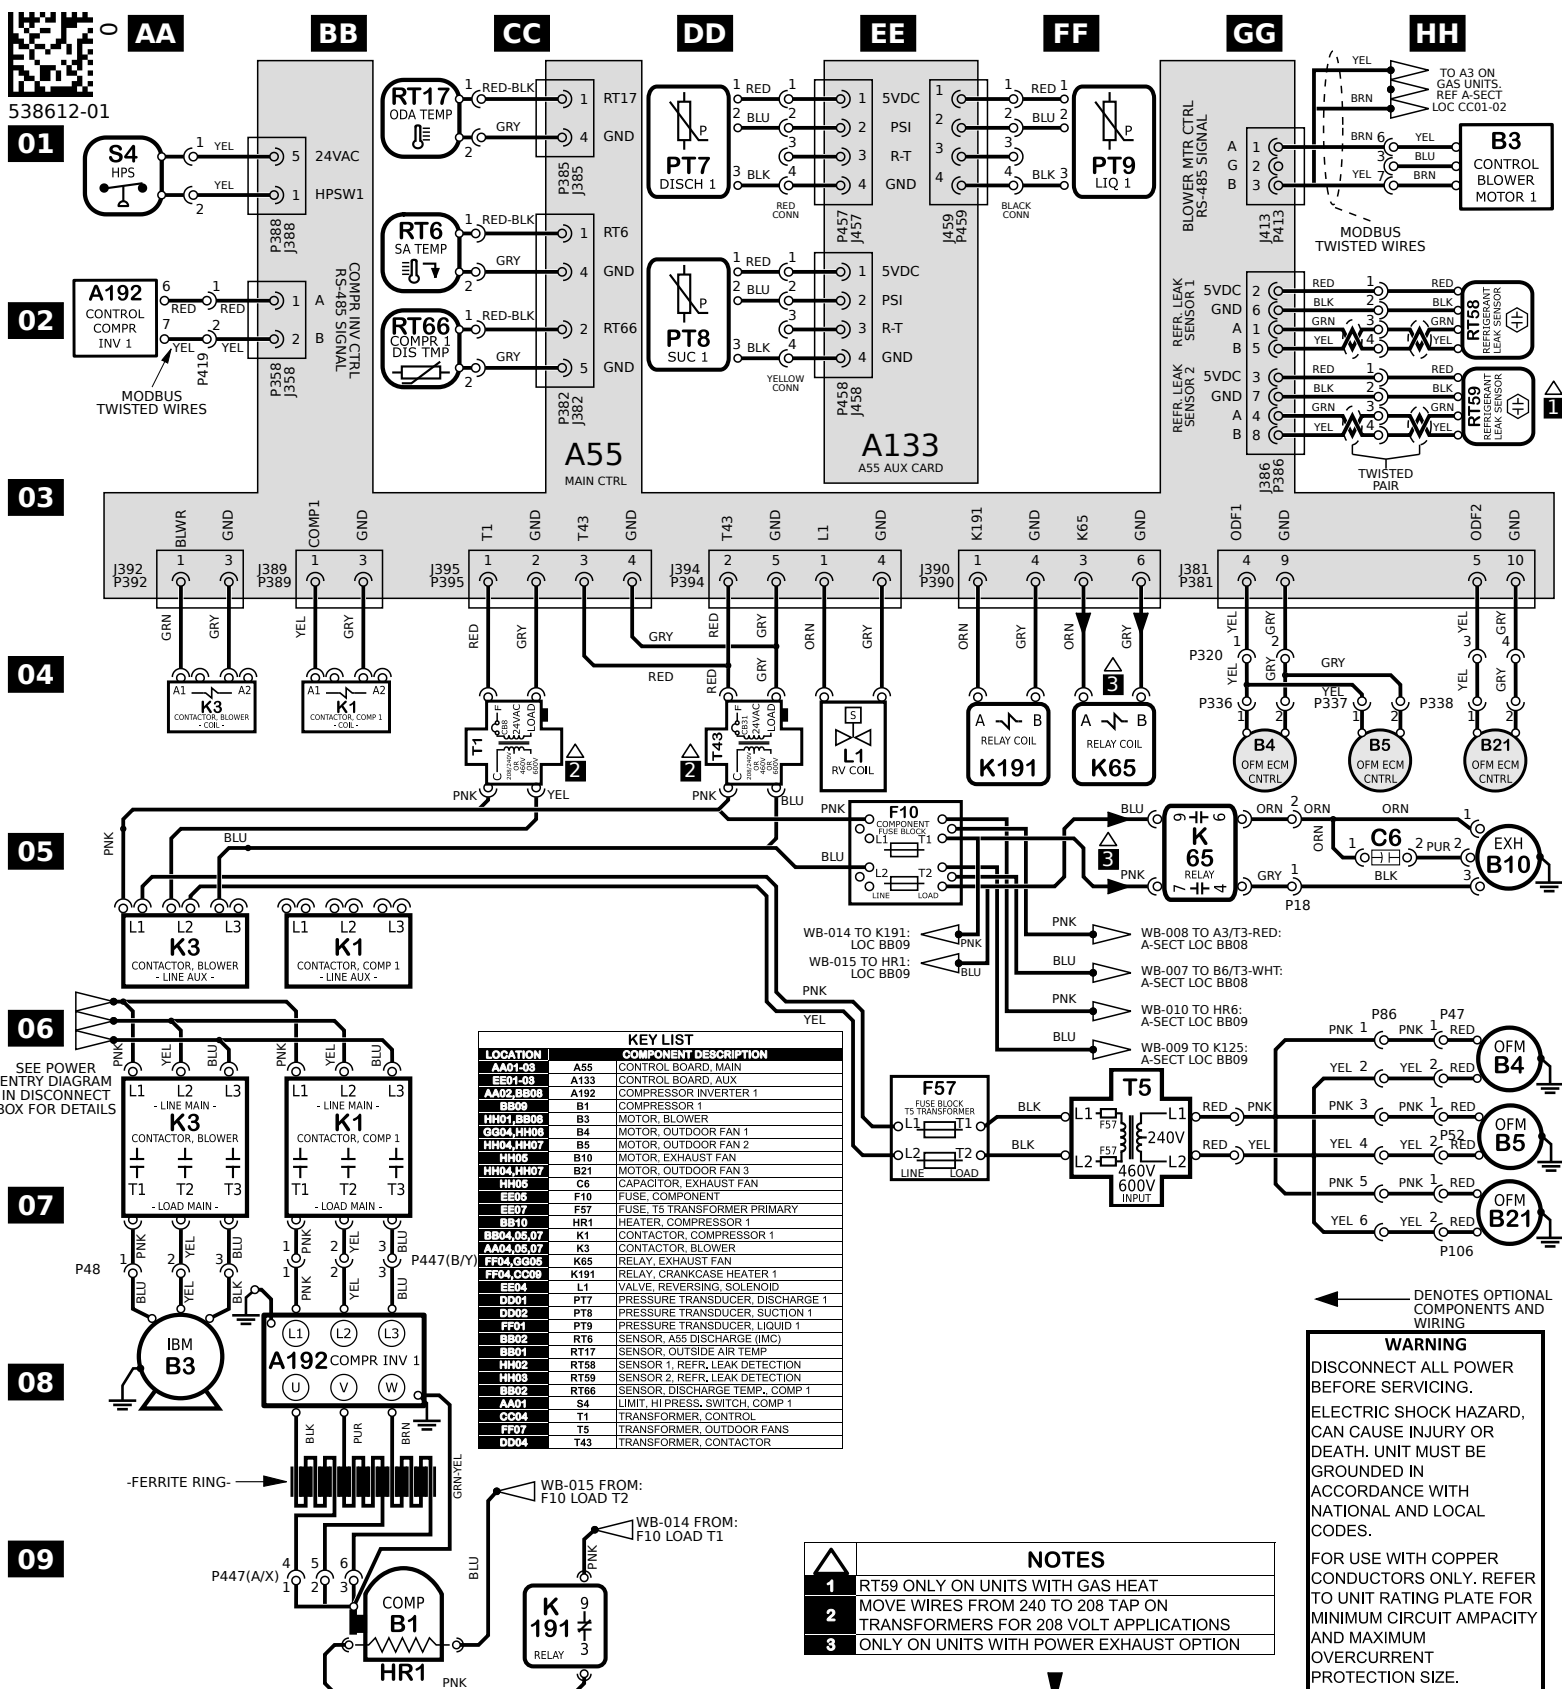

LOCATION	COMPONENT DESCRIPTION
AA01-08	A55 CONTROL BOARD, MAIN
EE01-08	A133 CONTROL BOARD, AUX
AA02, BB09	A192 COMPRESSOR INVERTER 1
BB09	B1 COMPRESSOR 1
HH01, BB08	B3 MOTOR, BLOWER
GG04, HH08	B4 MOTOR, OUTDOOR FAN 1
HH04, HH07	B5 MOTOR, OUTDOOR FAN 2
HH05	B10 MOTOR, EXHAUST FAN
HH04, HH07	B21 MOTOR, OUTDOOR FAN 3
HH05	C6 CAPACITOR, EXHAUST FAN
EE06	F10 FUSE, COMPONENT
EE07	F57 FUSE, T5 TRANSFORMER PRIMARY
BB10	HR1 HEATER, COMPRESSOR 1
BB04, 05, 07	K1 CONTACTOR, COMPRESSOR 1
AA04, 05, 07	K3 CONTACTOR, BLOWER
FF04, GG08	K65 RELAY, EXHAUST FAN
FF04, CC08	K191 RELAY, CRANKCASE HEATER 1
EE04	L1 VALVE, REVERSING, SOLENOID
DD01	PT7 PRESSURE TRANSDUCER, DISCHARGE 1
DD02	PT8 PRESSURE TRANSDUCER, SUCTION 1
FF01	PT9 PRESSURE TRANSDUCER, LIQUID 1
BB02	RT6 SENSOR, A55 DISCHARGE (IMC)
BB01	RT17 SENSOR, OUTSIDE AIR TEMP
HH02	RT58 SENSOR 1, REFR. LEAK DETECTION
HH03	RT59 SENSOR 2, REFR. LEAK DETECTION
BB02	RT66 SENSOR, DISCHARGE TEMP, COMP 1
AA01	S4 LIMIT, HI PRESS. SWITCH, COMP 1
CC04	T1 TRANSFORMER, OUTDOOR FANS
FF07	T5 TRANSFORMER, OUTDOOR FANS
DD04	T43 TRANSFORMER, CONTACTOR

- NOTES**
- 1 RT59 ONLY ON UNITS WITH GAS HEAT
 - 2 MOVE WIRES FROM 240 TO 208 TAP ON TRANSFORMERS FOR 208 VOLT APPLICATIONS
 - 3 ONLY ON UNITS WITH POWER EXHAUST OPTION


HEATING	COOLING	COOLING	ACCS	ACCS
SECTION A	SECTION B	SECTION B5	SECTION C	SECTION D

WARNING
DISCONNECT ALL POWER BEFORE SERVICING.
ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES.
FOR USE WITH COPPER CONDUCTORS ONLY. REFER TO UNIT RATING PLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING AND INSULATION THICKNESS.

Model: SH, SD - 92H, 120H HEATPUMP
Voltage: All Voltages
Supersedes: XXXXXX-XX Form No: 538612-01 Rev: 0

REV	EC NO.	DATE	BY	APVD	REVISION NOTE
0	CN-013234R	9/8/2025	AXL	AAH	ORIGINATED AT PD&R CARROLLTON, TX


8.5 x 10
CUT SIZE

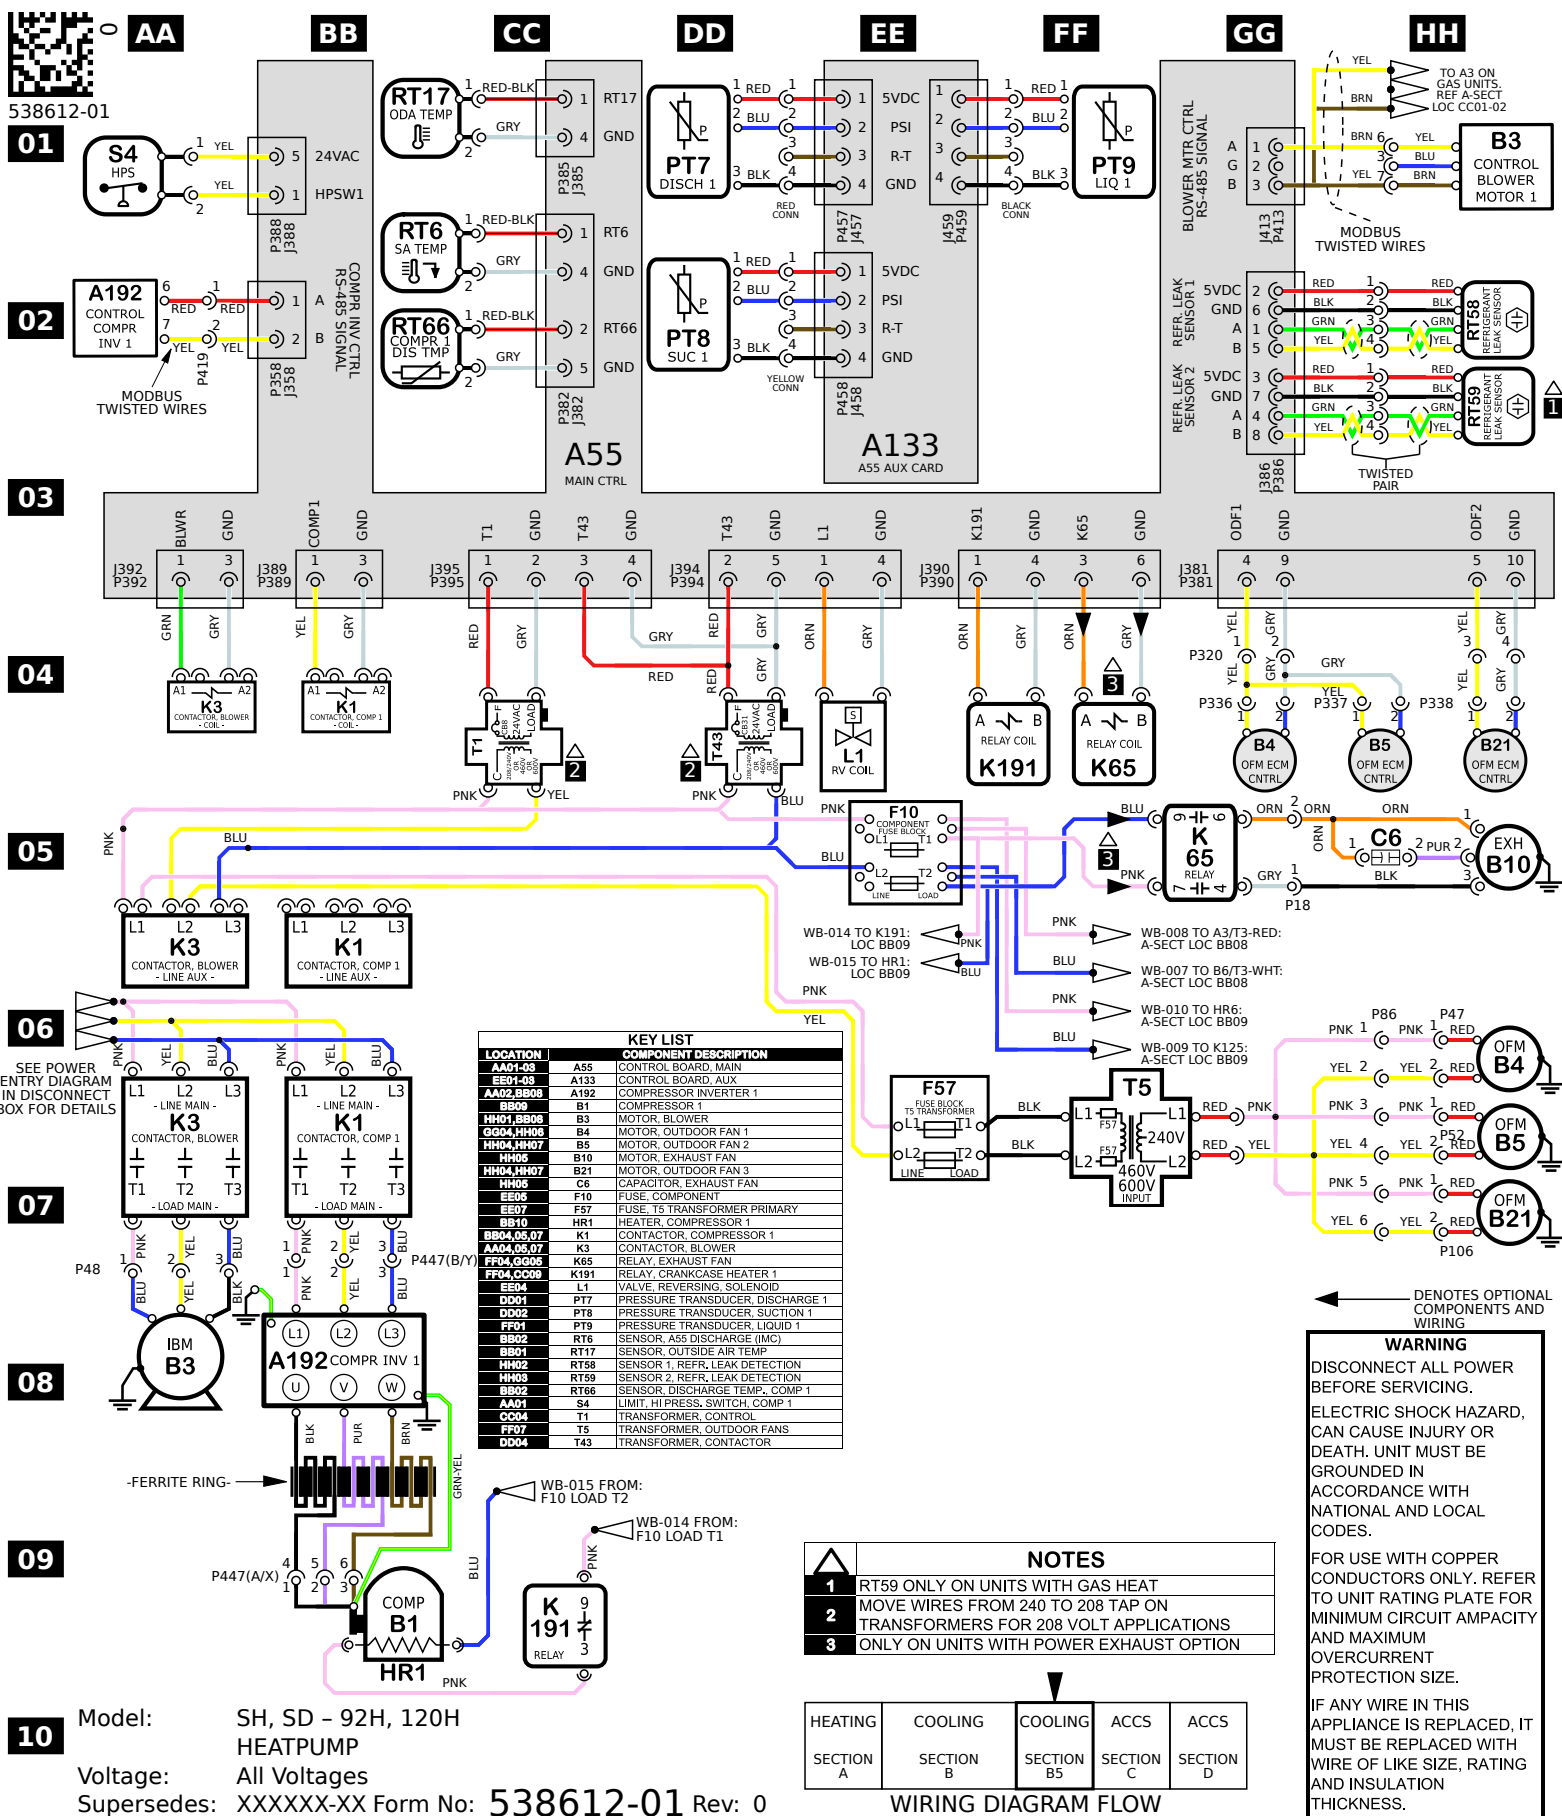

Model: SH, SD - 92H, 120H HEATPUMP
Voltage: All Voltages
Supersedes: XXXXXX-XX Form No: 538612-01 Rev: 0

HEATING	COOLING	COOLING	ACCS	ACCS
SECTION A	SECTION B	SECTION B5	SECTION C	SECTION D

WIRING DIAGRAM FLOW



REV	EC NO.	DATE	BY	APVD	REVISION NOTE
0	CN-013234R	9/8/2025	AXL	AAH	ORIGINATED AT PD&R CARROLLTON, TX