



KEY LIST	
COMPONENT DESCRIPTION	
A194	CONTROL, REFR. LEAK DETECTION
RT58	SENSOR, REFR. LEAK DETECTION

WARNING
DISCONNECT ALL POWER BEFORE SERVICING.
ELECTRIC SHOCK HAZARD. CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES.
FOR USE WITH COPPER CONDUCTORS ONLY. REFER TO UNIT RATING PLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING AND INSULATION THICKNESS.

MODEL: ZC/ZG/ZH
A2L SENSOR DIAGRAM
VOLT: All
SUPSDS: N/A




REV	EC NO.	DATE	BY	APVD	REVISION NOTE
---	CN-012849P	04-23-2025	ZN	STT	ORIGINATED AT PD&R CARROLLTON, TX

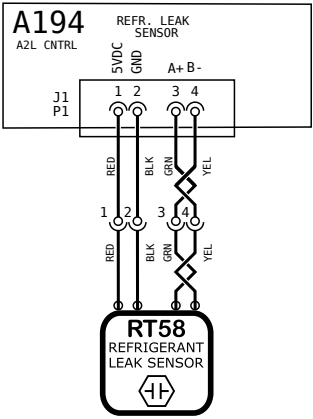

KEY LIST	
COMPONENT DESCRIPTION	
A194	CONTROL, REFR. LEAK DETECTION
RT58	SENSOR, REFR. LEAK DETECTION

WARNING
DISCONNECT ALL POWER BEFORE SERVICING.
ELECTRIC SHOCK HAZARD. CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES.
FOR USE WITH COPPER CONDUCTORS ONLY. REFER TO UNIT RATING PLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING AND INSULATION THICKNESS.

MODEL: ZC/ZG/ZH
A2L SENSOR DIAGRAM
VOLT: All
SUPSDS: N/A



REV	EC NO.	DATE	BY	APVD	REVISION NOTE
---	CN-012849P	04-23-2025	ZN	STT	ORIGINATED AT PD&R CARROLLTON, TX