
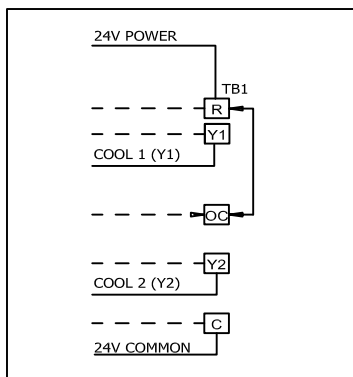


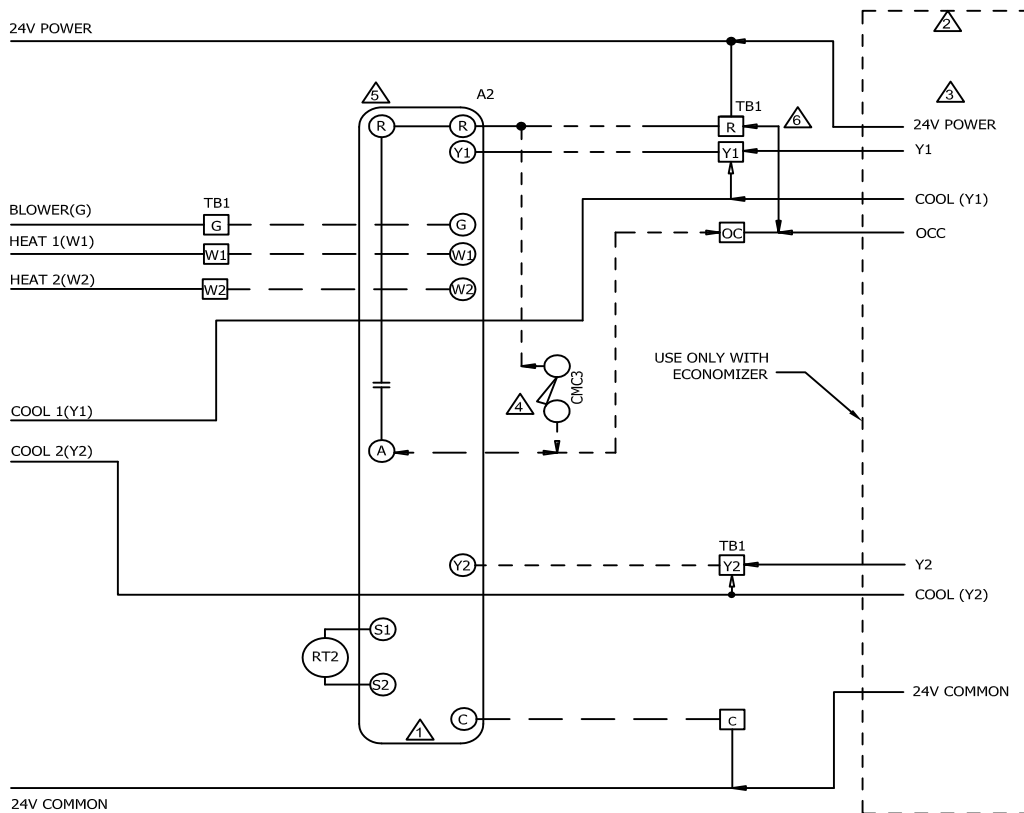

CONNECTION SCHEME FOR ZCA, ZGA AND ZHA
092 THROUGH 150 UNITS WITHOUT
ECONOMIZER ONLY

KEY	COMPONENT
A2	SENSOR, ELECTRONIC THERMOSTAT
A63	SENSOR, CO2
CMC3	CLOCK, TIME
K65	RELAY, EXHAUST FAN
R1	SENSOR, MIXED AIR OR SUPPLY AIR
RT2	SENSOR, REMOTE THERMOSTAT
TB1	TERMINAL STRIP, CLASS II VOLTAGE

- 1 THERMOSTAT SUPPLIED BY USER
- 2 OPTIONAL WIRING FOR UNITS WITH ECONOMIZER
- 3 J3 MAXIMUM LOAD 20VA 24VAC CLASS II
- 4 TIME CLOCK CONTACTS (OPT) CLOSED OCCUPIED
- 5 TOUCHSCREEN THERMOSTAT
- 6 REMOVE JUMPER BETWEEN TB1-R AND TB1-OCP WHEN USING A NITE SETBACK THERMOSTAT

 DENOTES OPTIONAL COMPONENTS
 CLASS II FIELD WIRING

04/14		WIRING DIAGRAM	04/14
		537673-01	
CONTROL			
ELECTRONIC/ELECTROMECHANICAL THERMOSTAT (RAIDER B)			
SECTION C			REV 0
Supersedes		New Form No. 537673-01	