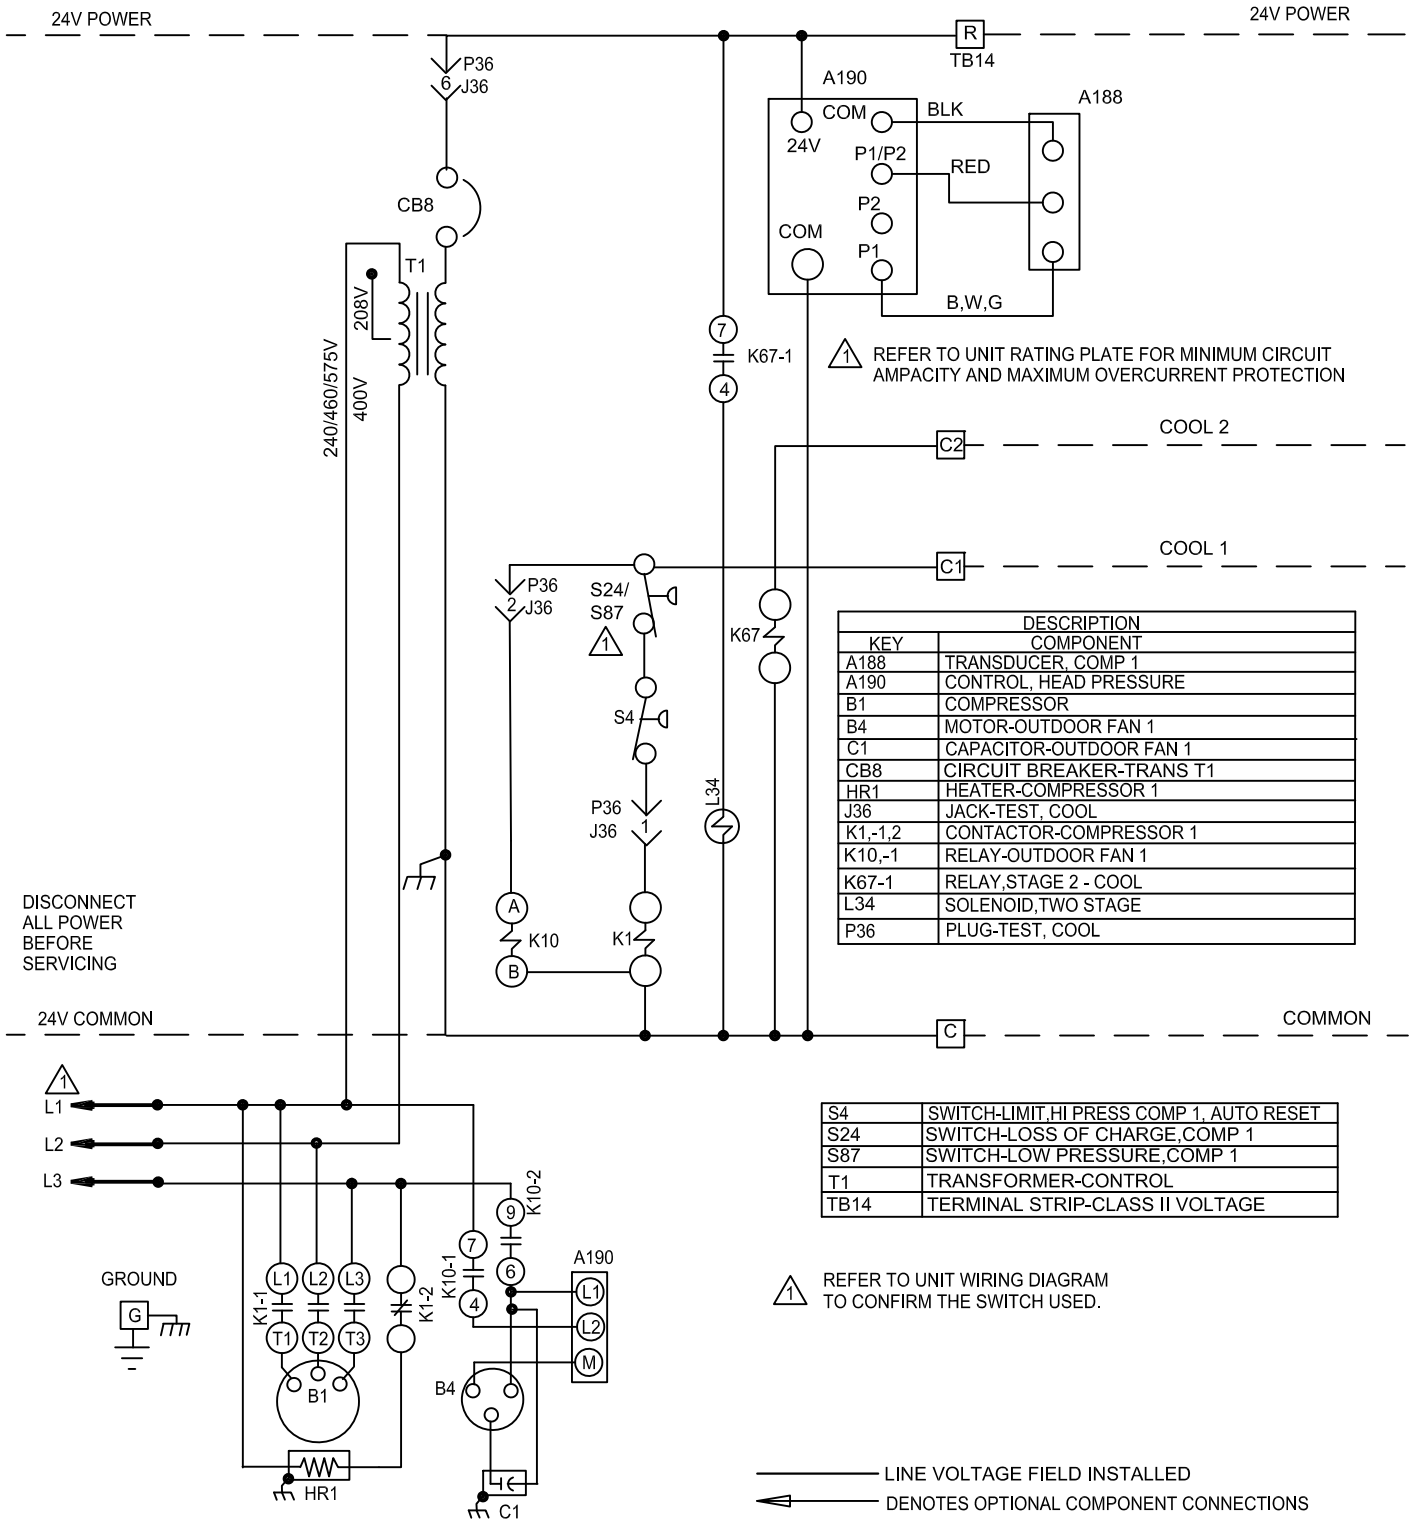

DESCRIPTION	
KEY	COMPONENT
A188	TRANSDUCER, COMP 1
A190	CONTROL, HEAD PRESSURE
B1	COMPRESSOR
B4	MOTOR-OUTDOOR FAN 1
C1	CAPACITOR-OUTDOOR FAN 1
CB8	CIRCUIT BREAKER-TRANS T1
HR1	HEATER-COMPRESSOR 1
J36	JACK-TEST, COOL
K1,-1,2	CONTACTOR-COMPRESSOR 1
K10,-1	RELAY-OUTDOOR FAN 1
K67-1	RELAY,STAGE 2 - COOL
L34	SOLENOID,TWO STAGE
P36	PLUG-TEST, COOL

S4	SWITCH-LIMIT,HI PRESS COMP 1, AUTO RESET
S24	SWITCH-LOSS OF CHARGE,COMP 1
S87	SWITCH-LOW PRESSURE,COMP 1
T1	TRANSFORMER-CONTROL
TB14	TERMINAL STRIP-CLASS II VOLTAGE

1 REFER TO UNIT WIRING DIAGRAM TO CONFIRM THE SWITCH USED.

LINE VOLTAGE FIELD INSTALLED
DENOTES OPTIONAL COMPONENT CONNECTIONS
CLASS II FIELD WIRING

FOR USE WITH COPPER CONDUCTORS ONLY

IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-
ELECTRIC SHOCK HAZARD,CAN CAUSE INJURY OR DEATH.UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES.

2019/03	WIRING DIAGRAMS 537934-01	03/19
DUAL SPEED COMPRESSOR		
ELS-072,090-G,J,M,Y LOW AMBIENT KIT		
SECTION A1		REV 1
Supersedes	New Form No. 537934-01	

© 2008

Litho U.S.A.