

COMMERCIAL TRAINING TOOLBOX TIPS

Economizer Settings – Modulating Damper Actuator DIP Switches

Applies to all Lennox Rooftop Units with factory-installed or field-installed economizers

Damper actuator DIP switches are preset by the factory and adjustment should not be required. If the damper actuator isn't functioning as expected, check the DIP switches and confirm that they are set correctly.


Helpful Resources

1. Installation manual for economizer.

DIP Switches Settings

1. Locate the modulating actuator on the side of the economizer.
2. Access the DIP switches.
3. Using the images below as a guide, ensure that all DIP switches are set correctly.
 - a. Each switch is identified with a symbol.
 - b. Note the symbol on each switch before adjusting.

Tip: Start with the middle DIP switch. The switch should be AWAY from the triangle symbol. All three switches must be in the same position.

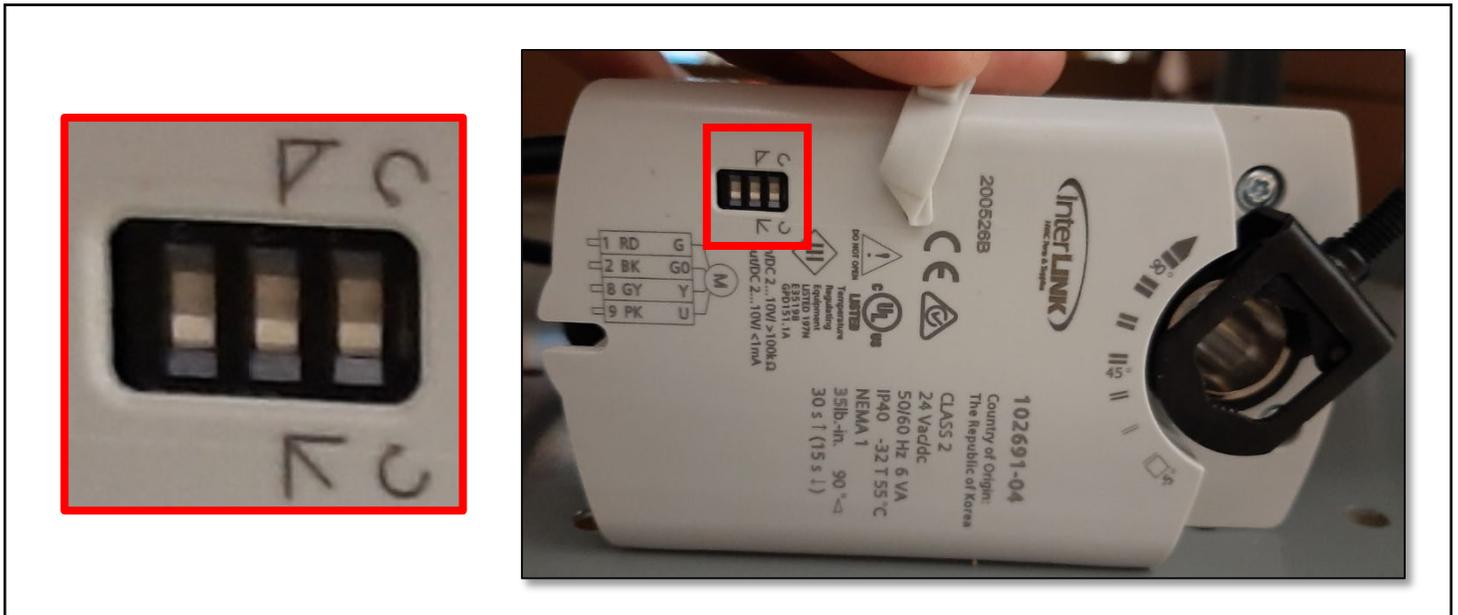

Modulating Actuator DIP Switches with Correct Settings

MORE Training Toolbox Tips Available!
Click [here](#) to download them all.

Self-Service Technical Support with No
Wait Times! Click the black logos to
download these apps.

Click [here](#) to register for any of the
Lennox Commercial Product Technical
Training Webinars.

