


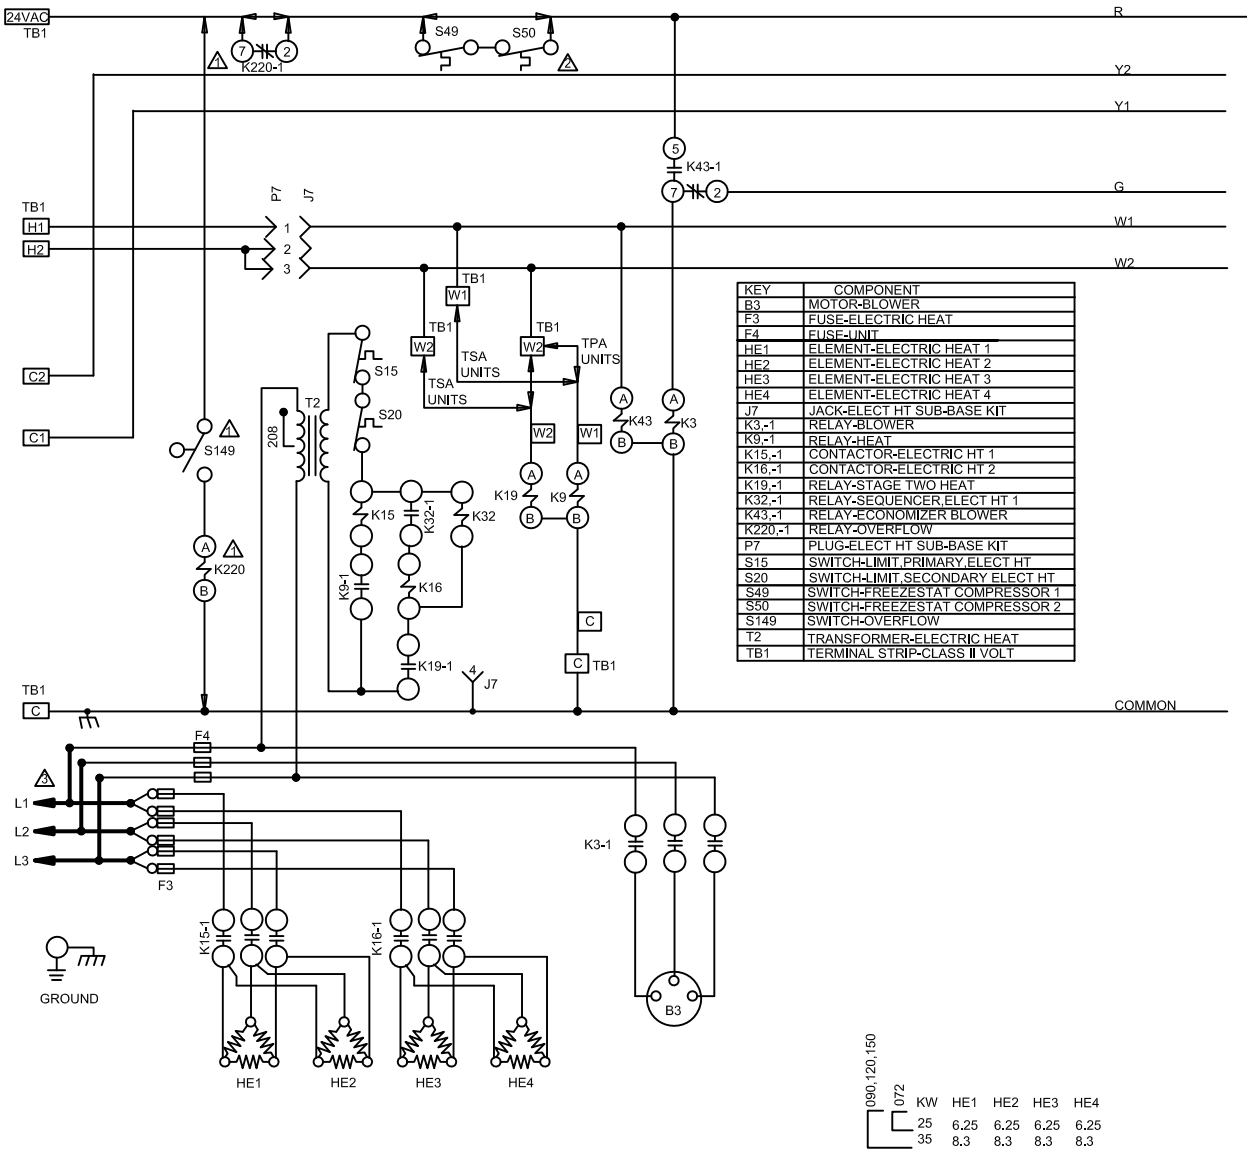

IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING

- △ S149 SWITCH AND K220 RELAY MAY BE FIELD SUPPLIED OR US AVAILABLE KIT
- △ S50 USED ON TWO STAGE UNITS
- △ USE COPPER CONDUCTORS ONLY

— LINE VOLTAGE FIELD INSTALLED
◀ DENOTES OPTIONAL COMPONENTS

01/12		WIRING DIAGRAM	01/12
537525-01			
HEATING - ELECTRIC			
T3EH - TAA 072 - 150 UNITS - Y 25, 35 KW			
SECTION B3			REV 0
Supersedes		New Form No.	
537169-01		537525-01	
© 2012		Lennox Commercial	