


CUT LENGTH 3-3/4" W x 7-3/8" H

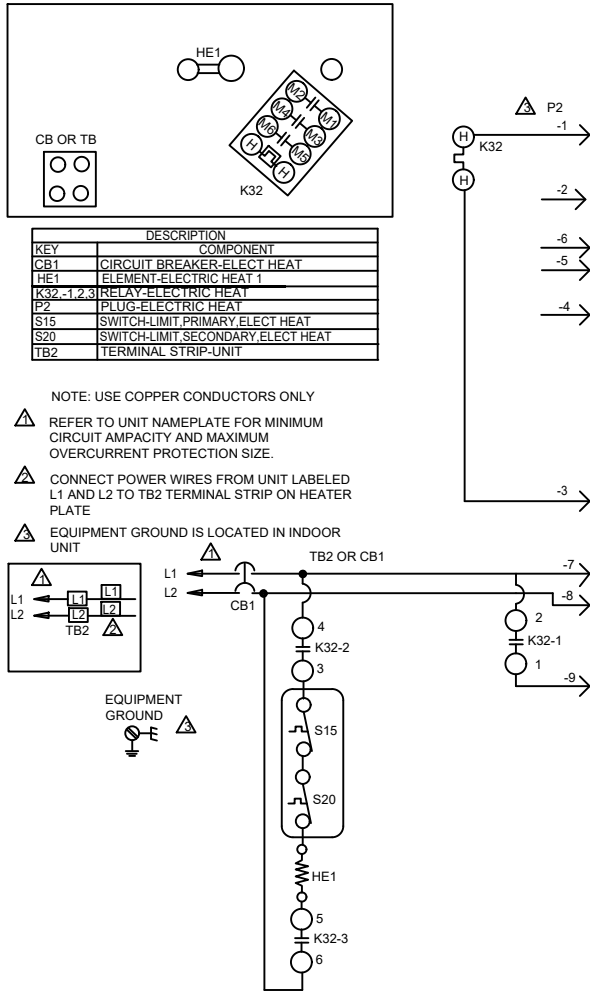


- NOTE: USE COPPER CONDUCTORS ONLY
- REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
 - CONNECT POWER WIRES FROM UNIT LABELED L1 AND L2 TO TB2 TERMINAL STRIP ON HEATER PLATE
 - EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

LINE VOLTAGE FIELD INSTALLED

HEATING-ELECTRIC	
ECB47-4-P, 5-P, 6-P, 4CB-P, 5CB-P, 6CB-P	
Supersedes	
03/24	Form No. 538453-01

© 2011

Litho U.S.A.

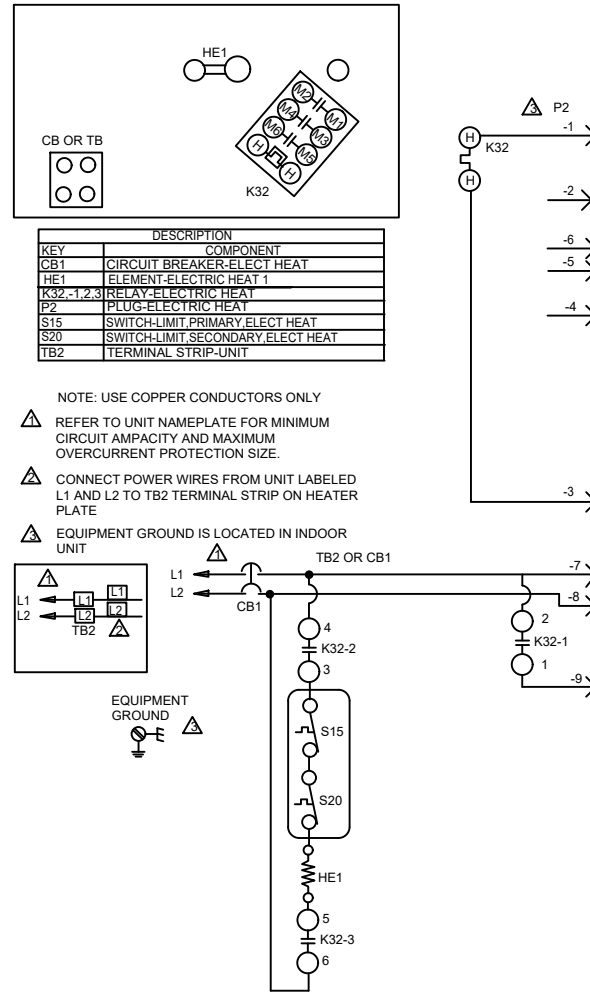

- NOTE: USE COPPER CONDUCTORS ONLY
- REFER TO UNIT NAMEPLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
 - CONNECT POWER WIRES FROM UNIT LABELED L1 AND L2 TO TB2 TERMINAL STRIP ON HEATER PLATE
 - EQUIPMENT GROUND IS LOCATED IN INDOOR UNIT

LINE VOLTAGE FIELD INSTALLED

HEATING-ELECTRIC	
ECB47-4-P, 5-P, 6-P, 4CB-P, 5CB-P, 6CB-P	
Supersedes	
03/24	Form No. 538453-01

© 2011

Litho U.S.A.