


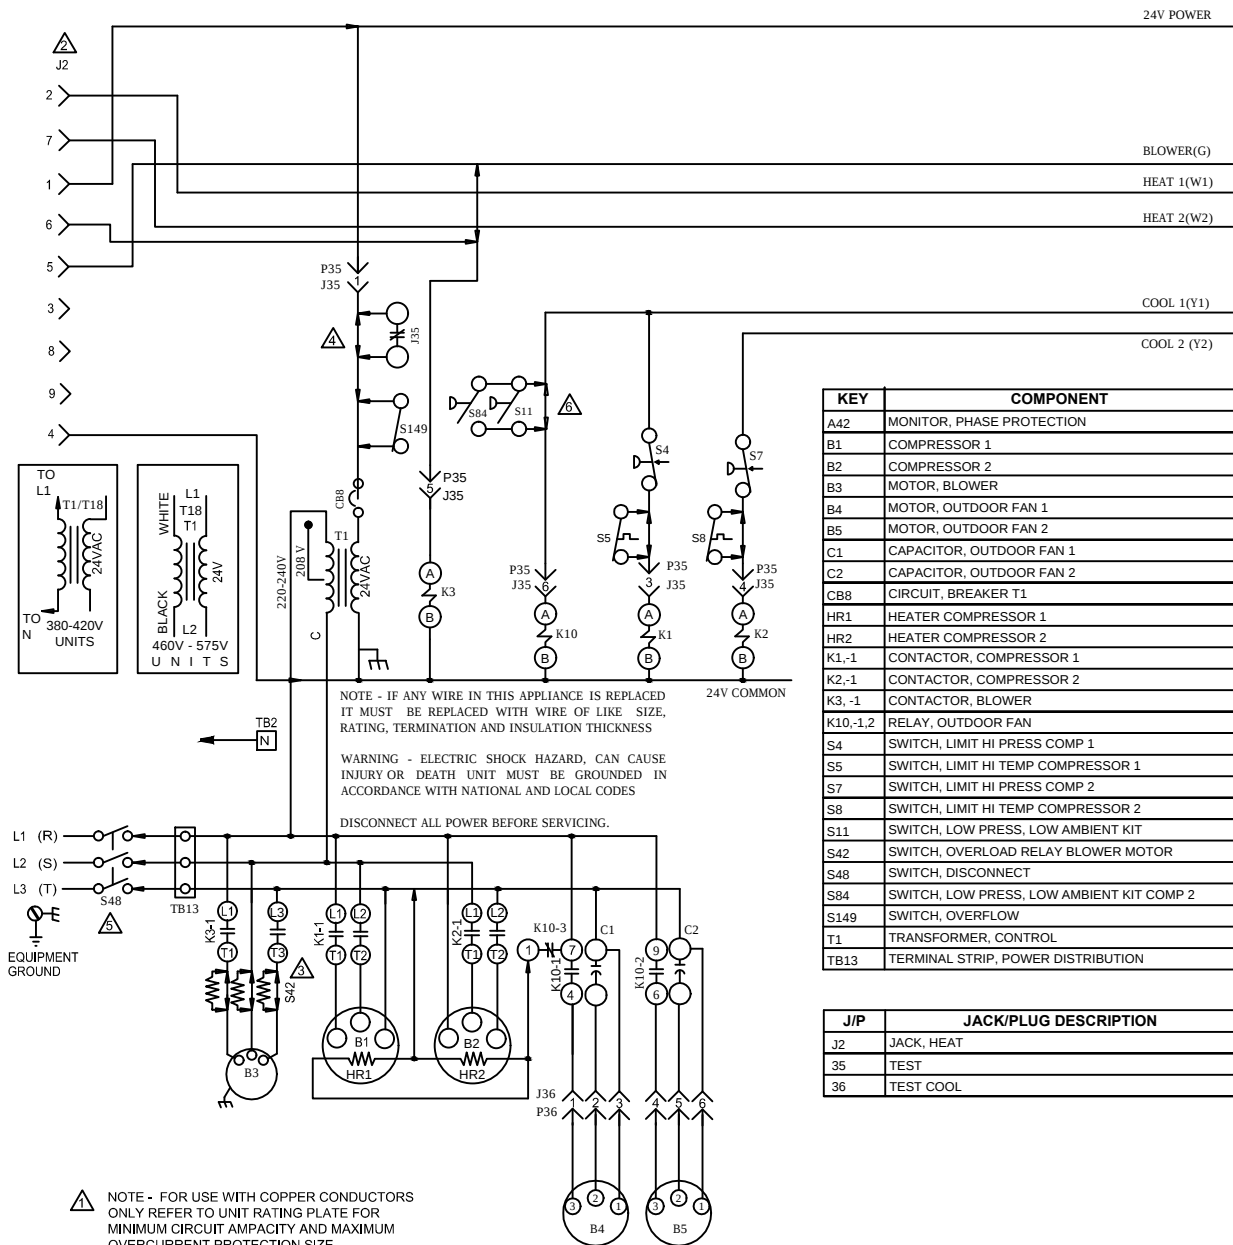

- NOTE - FOR USE WITH COPPER CONDUCTORS ONLY REFER TO UNIT RATING PLATE FOR MINIMUM CIRCUIT AMPACITY AND MAXIMUM OVERCURRENT PROTECTION SIZE.
- J2 IS USED ON ZG* UNITS OR FIELD INSTALLED ZC* WITH ELECTRICAL HEAT
- IMPORTANT: TO PREVENT MOTOR BURNOUT, NEVER CONNECT MORE THAN ONE MOTOR LEAD TO ANY ONE CONNECTION. TAPE UNUSED MOTOR LEADS
- S42 USED ON "M" VOLTAGE UNITS
- S48 OR CB8 MAY BE USED
- JUMPER WHEN S11 AND S84 ARE NOT USED

← DENOTES OPTIONAL COMPONENTS
— LINE VOLTAGE FIELD INSTALLED

07/17		WIRING DIAGRAM	07/17
537671-01			
COOLING - CAV			
ZC*, ZG* - 092, 102, 120, 150 - G, J, M, Y			
SECTION B			REV. 0
Supersedes		New Form No. 537671-01	