

# LCT

## ENLIGHT ROOFTOP UNITS

High Efficiency | Lennox® CORE Controller | Environ™ Coil | **R-454B** | 60Hz

COMMERCIAL  
PRODUCT SPECIFICATIONS (EHB)



25 to 30 Tons

Net Cooling Capacity – 300,000 to 350,000 Btuh  
Optional Electric Heat - 30 to 90 kW

# ENLIGHT



SMARTWIRE™ SYSTEM



### MODEL NUMBER IDENTIFICATION

**LCT302H5VN1Y**

**Brand**  
L = Lennox®

**Voltage**  
Y = 208/230V-3 phase-60Hz  
G = 460V-3 phase-60Hz  
J = 575V-3 phase-60Hz

**Unit Type**  
C = Packaged Electric Cooling with optional Electric Heat

**Minor Design Sequence**  
1 = 1st Revision

**Family**  
T = Enlight Series

**Factory Installed Electric Heat**  
N = No Heat  
J = 30 kW Electric Heat  
K = 45 kW Electric Heat  
L = 60 kW Electric Heat  
P = 90 kW Electric Heat

**Nominal Cooling Capacity - Tons**  
302 = 25 Tons  
360 = 30 Tons

**Blower Type**  
M = MSAV® Multi-Stage Air Volume, Belt Drive  
V = Variable Air Volume, Belt Drive


**Cooling Efficiency**  
H = High Efficiency

**Refrigerant Type**  
5 = R-454B

## FEATURE HIGHLIGHTS

Enlight rooftop units featuring the Lennox® CORE Control System create a bright future through a highly energy-efficient and environmentally sustainable design. Comprehensive configurations meet a wide range of applications, making it the most flexible product line Lennox has to offer.

1. Scroll Compressors
2. Environ™ Coil System
3. Thermal Expansion Valves
4. Filters/Driers
5. Outdoor Coil Fan Motors
6. Heavy Gauge Steel Cabinet
7. Hinged Access Panels
8. Variable or MSAV® Multi-Stage Air Volume Blower
9. Electric Heat (option)
10. Air Filters
11. Lennox® CORE Control System
12. Economizer (option)
13. Downflow Barometric Relief Dampers (option)
14. Power Exhaust
15. Humiditrol® Dehumidification (option)

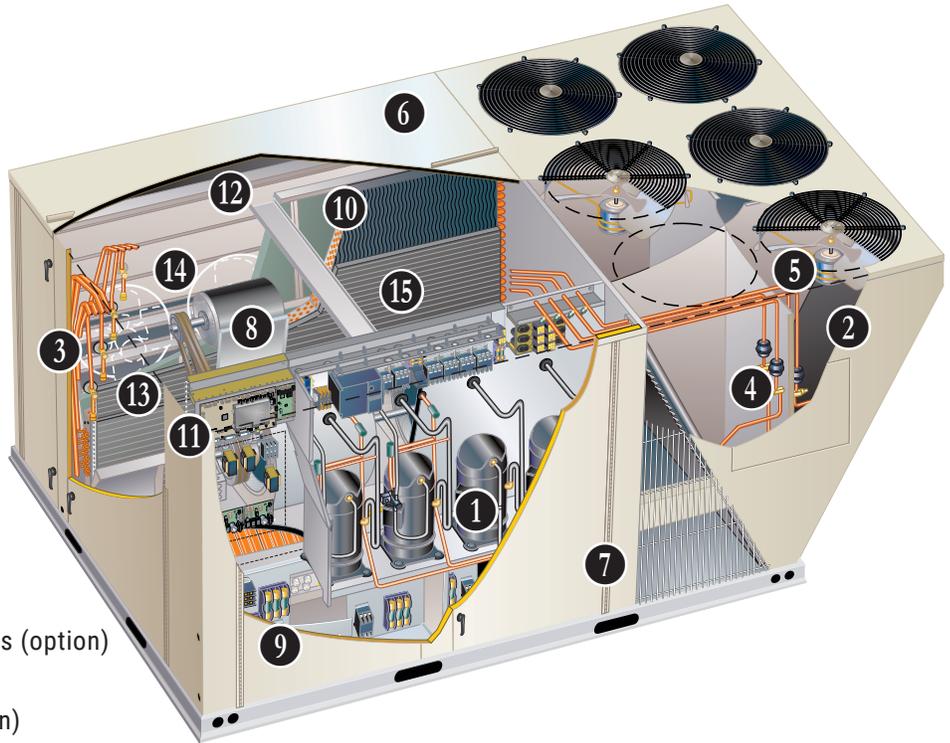

## CONTENTS

Approvals And Warranty . . . . .	3
Blower Data . . . . .	33
Control System . . . . .	9
Dimensions - Accessories . . . . .	47
Dimensions - Unit . . . . .	46
Electrical Data . . . . .	37
Features And Benefits . . . . .	4
Humiditrol® Dehumidification System Option . . . . .	14
Humiditrol® Dehumidification System Ratings . . . . .	32
Model Number Identification . . . . .	1
Optional Conventional Temperature Control Systems . . . . .	16
Options / Accessories . . . . .	23
Outdoor Sound Data . . . . .	45
Specifications . . . . .	27
- 25 Ton . . . . .	27
- 30 Ton . . . . .	28
Unit Clearances . . . . .	43
Weight Data . . . . .	45

## **APPROVALS AND WARRANTY**

### **APPROVALS**

- All models tested at conditions included in AHRI Standard 340/360-2022
- ETL and CSA listed
- All models are ASHRAE 90.1-2025 compliant
- All models meet DOE 2023 energy efficiency standards
- All models are listed to UL 60335-1 and UL 60335-2-40 and meet the Refrigerant Detection and Dissipation Requirements
- Components are bonded for grounding to meet safety standards for servicing required by ETL, NEC and CEC
- All models meet California Code of Regulations, Title 24 and ASHRAE 90.1-2025 Section 6.4.3.10 requirements for staged airflow
- All models have been sound tested in accordance with test conditions included in AHRI Standard 270 or 370
- ISO 9001 Registered Manufacturing Quality System
- All models have FSA approval and are compliant with standard ASCE 7-22 (ASD) and the Florida Building Code Eighth Edition (2023)
- Units are charged with virgin refrigerant to comply with NYCRR Part 494
- All models are fully charged and run tested to verify unit operation and functionality

### **WARRANTY**

- Compressors - Limited five years
- Environ™ Coil System - Limited three years
- Lennox® CORE Unit Controller - Limited three years
- Variable-Frequency Drive (VFD) - Limited five years
- High Performance Economizers (optional) - Limited five year
- All other covered components - Limited one year

## FEATURES AND BENEFITS

### **COOLING SYSTEM**

- Designed to maximize sensible and latent cooling performance at design conditions
- System can operate from 0°F to 125°F without any additional controls

#### **R-454B Refrigerant**

- Low GWP (Global Warming Potential)
- Zero ODP (Ozone Depletion Potential)
- Low Toxicity/Lower Flammability - A2L
- Unit is factory pre-charged

### **1 Scroll Compressors**

- Scroll compressors on all models for high performance, reliability and quiet operation
- Resiliently mounted on rubber grommets for quiet operation

#### **Compressor Crankcase Heaters**

- Protects against refrigerant migration that can occur during low ambient operation or during extended off cycles

### **2 Condenser Coil - Environ™ Coil System**

- Lightweight, all aluminum brazed fin construction
- Constructed of three components
  - A flat extrusion tube
  - Fins in-between the flat extrusion tube
  - Two refrigerant manifolds



#### **Environ™ Coil System Features:**

- Improved heat transfer performance due to high primary surface area (flat tubes) versus secondary surface (fins)
- Smaller internal volume (reduced refrigerant charge)
- High durability
- All aluminum construction
- Fewer brazed joints
- Compact design
- Reduced unit weight
- Easy maintenance/cleaning
- Mounting brackets with rubber inserts
- Angled cabinet design protects coil from damage

#### **Evaporator Coil**

- Copper tube construction
- Enhanced rippled-edge aluminum fins
- Flared shoulder tubing connections
- Silver soldered construction
- Factory leak tested
- Cross-row circuiting with rifled tubing

### **3 Thermal Expansion Valves**

- Ensures optimal performance throughout the application range
- Removable element head

### **4 Filter/Driers**

- High capacity filter/drier protects the system from dirt and moisture

#### **High Pressure Switches**

Protects the compressor from overload conditions such as dirty condenser coils, blocked refrigerant flow or loss of outdoor fan operation

#### **Low Pressure Switches**

- Protects the compressors from low pressure conditions such as low refrigerant charge or low/no airflow

#### **Antimicrobial Condensate Drain Pan**

- Composite pan, sloped to meet drainage requirements per ASHRAE 62.1
- Antimicrobial additive prevents growth of mold and mildew, which improves indoor air quality and reduces drain line blockage
- Side drain connections

**NOTE** - Stainless steel drain pan available as a factory installed option.

#### **Indoor Coil Freeze Protection**

- Protects the evaporator coil from damaging ice build-up due to conditions such as low/no airflow or low refrigerant charge

### **5 Outdoor Coil Fan Motors**

- Thermal overload protected
- Totally enclosed
- Permanently lubricated ball bearings
- Shaft up
- Wire basket mount

#### **Outdoor Coil Fans**

- PVC coated fan guard furnished

### **Required Selections**

#### **Cooling Capacity**

- Specify nominal cooling capacity

### **Options/Accessories**

#### **Factory or Field Installed**

##### **Drain Pan Overflow Switch**

- Monitors condensate level in drain pan
- Shuts down unit if drain becomes clogged

##### **Stainless Steel Drain Pan**

- Non-corrosive drain pan

#### **Field Installed**

##### **Condensate Drain Trap**

- Available in copper or PVC

## FEATURES AND BENEFITS

### **LOW GWP REFRIGERANT DETECTION SYSTEM (RDS)**

- Complies with UL 60335-2-40 approved standard
- Required for all systems using R-454B refrigerant
- Factory installed on all units
- Consists of a refrigerant detection sensor(s) and a mitigation control
- Ensures safe operation for systems equipped with R-454B refrigerant
- Sensor(s) monitors indoor coil area for R-454B refrigerant
- If R-454B refrigerant is detected the refrigerant detection system will prevent compressor and heating operation until R-454B refrigerant is no longer detected
- Refrigeration detection system energizes blower if any R-454B refrigerant is detected to mitigate any concentrations of refrigerant from the unit and the system

### **CABINET**

#### **6 Construction**

- Heavy-gauge steel panels
- Full perimeter heavy-gauge galvanized steel base rail
- Base rails have rigging holes
- Three sides of the base rail have forklift slots
- Raised edges around duct and power entry openings in the bottom of the unit for water protection

#### **Airflow Choice**

- Units are shipped in downflow (vertical) return air flow configuration

**NOTE** - Units can be field converted to horizontal air flow with optional Horizontal Return Air Panel Kit and Horizontal Roof Curb.

#### **Power Entry**

- Electrical lines can be routed through the unit base or through horizontal access knock-outs

#### **Exterior Panels**

- Constructed of heavy-gauge, galvanized steel
- Textured pre-paint with polyurethane finish
- Cyclic salt fog and UV exposure up to 1,680 hours per ASTM D5894

#### **Insulation**

- Fully insulated with non-hygroscopic fiberglass insulation (conditioned areas)
- Unit base is fully insulated
- Base insulation serves as an air seal to the roof curb, eliminating the need to add a seal during installation

#### **7 Hinged Access Panels**

- Filter section
- Blower section
- Heating section
- Compressor/controls section
- Panel seals and quarter-turn latching handles provide a tight air and water seal

### **Options/Accessories**

#### **Factory Installed**

##### **Corrosion Protection**

- Completely flexible immersed coating
- Electrodeposited dry film process
- AST ElectroFin E-Coat
- Meets Mil Spec MIL-P-53084, ASTM B117 Standard Method Salt Spray Testing
- Indoor Corrosion Protection:
  - Coated coil
  - Coated reheat coil (Humiditrol®)
  - Painted blower housing
  - Painted base
- Outdoor Corrosion Protection:
  - Coated coil
  - Painted outdoor base

#### **Factory or Field Installed**

##### **Combination Coil/Hail Guards**

- Heavy gauge steel frame
- Painted to match cabinet
- Expanded metal mesh protects outdoor coil

#### **Field Installed**

##### **Horizontal Return Air Panel Kit**

- Required for horizontal applications with Horizontal Roof Curb
- Contains panel with return air opening for field replacement of existing unit panel and panel to cover bottom return air opening in unit
- See dimension drawings

##### **Burglar Bars**

- Heavy gauge galvanized frame
- Fully welded
- 3/4 in. bar meets ASTM specification
- Frame meets ASTM A446, A525, A526 and A527 specification
- Burglar bars designed to fit ductwork

## FEATURES AND BENEFITS

### **BLOWER**

- A wide selection of supply air blower options are available to meet a variety of airflow requirements

### **Motor**

- Overload protected
- Ball bearings
- Belt drive motors are offered on all models and are available in several different sizes to maximize air performance

**NOTE** - All blower motors 5 HP and above meet minimum energy efficiency standards in accordance with the Energy Independence and Security Act (EISA).of 2007

### **8 Supply Air Blower**

- Forward curved blades
- Double inlet
- Blower wheel statically and dynamically balanced
- Ball bearings
- Adjustable pulley (allows speed change)
- Blower assembly slides out of unit for servicing
- Grease fittings furnished

### **Blower Proving Switch**

- Monitors blower operation, shuts down unit if blower fails

### **Supply Static Pressure Transducer (VAV Models Only)**

- Sends information to the Lennox® CORE unit controller to control VFD blower speed
- Shipped with the unit for remote field installation in the supply duct

### **Required Selections**

#### **Select VAV Variable Air Volume or MSAV® Multi-Stage Air Volume**

- Variable Air Volume (VAV) variable frequency drive (VFD) varies the air volume to maintain a constant duct static pressure
- MSAV® Multi-Stage Air Volume models stage the amount of airflow according to compressor stages, heating demand, ventilation demand or smoke alarm
  - Utilizes a Variable Frequency Drive (VFD) to stage the supply air blower airflow
  - VFD alters the frequency and voltage of the power supply to the blower to control blower speed

- The amount of airflow for each stage can be set according to a parameter in the Lennox® CORE Unit Controller
  - Unit is shipped from the factory with preset airflows
- The MSAV® Multi-Stage Air Volume supply air blower option can be ordered with or without an Electronic Bypass Control
- If equipped with the bypass control the MSAV® Multi-Stage Air Volume features automatic electronic bypass control of the VFD
- In case of a VFD malfunction, a VFD alarm is generated by the Lennox® CORE Unit controller
- Unit controller will automatically switch to full blower speed if a VFD alarm is generated

**NOTE** - Units equipped a Variable Frequency Drive (VFD) are designed to operate on balanced, three-phase power. Operating units on unbalanced three-phase power will reduce the reliability of all electrical components in the unit. Unbalanced power is a result of the power delivery system supplied by the local utility company. Factory-installed inverters are sized to drive blower motors with an equivalent current rating using balanced three-phase power. If unbalanced three-phase power is supplied; the installer must replace the existing factory-installed inverter with an inverter that has a higher current rating to allow for the imbalance. Refer to the installation instructions for additional information and replacement information.

### **Ordering Information**

- Specify motor horsepower and drive kit number when base unit is ordered

### **Options/Accessories**

#### **Factory Installed**

##### **Supply VFD Blower Bypass Control**

- Allows unit to operate as a constant air volume (CAV) unit in case of variable frequency drive (VFD) failure

**NOTE** - Supply VFD Blower Bypass Control is not available with High Static Power Exhaust.

#### **Field Installed**

##### **Blower Belt Auto-Tensioner**

- Provides proper tension to belt drive blower belt without the need for regular adjustments
- Maintains airflow and proper performance

##### **Supply Static Limit Switch**

- Manual reset switch for supply static high pressure limit
- Prevents exceeding pressure limit in supply air duct
- Optional Mounting Kit includes tubing and adaptors

## FEATURES AND BENEFITS

### **ELECTRICAL**

**NOTE** - All units include terminal block and fuse block in power entry junction box for single power entry application.

#### **SmartWire™ System**

- Keyed and color-coded wiring connectors prevent miswiring
- Wire coloring scheme is standardized across all models
- Each connection is intuitively labeled to make troubleshooting and servicing quick and easy

#### **Electrical Plugs**

- Positive connection electrical plugs connect common accessories or maintenance parts for easy removal or installation

#### **Phase/Voltage Detection**

- Monitors power supply to assure phase is correct at unit start-up
- If phase is incorrect, the unit will not start and an alarm code is reported to the unit controller
- Protects unit from being started with incorrect phasing which could lead to issues such as compressors running backwards
- Voltage detection monitors power supply voltage to assure proper voltage
- If voltage is not correct (over/under voltage conditions) the unit will not start and an alarm code is reported to the unit controller

### **Required Selections**

#### **Voltage Choice**

- Specify when ordering base unit

### **Options/Accessories**

#### **Factory Installed**

##### **Circuit Breakers**

- HACR type
- Overload and short circuit protection
- Factory wired and mounted in the power entry panel
- Current sensitive and temperature activated
- Manual reset

##### **Short-Circuit Current Rating (SCCR)**

- Higher short-circuit protection up to 100kA

**NOTE** - Disconnect Switch not available with higher SCCR option. SCCR option only available with factory installed electric heat.

#### **Factory or Field Installed**

##### **Disconnect Switch**

- Accessible outside of unit
- Spring loaded weatherproof cover furnished

#### **9 Electric Heat**

- Helix wound nichrome elements
- Individual element limit controls
- Wiring harness
- Unit fuse block
- See Options/Accessories tables for ordering information

##### **GFI Service Outlets (2)**

- 115V ground fault circuit interrupter (GFCI) type options:
  - Factory installed and wired, unit powered
  - Factory installed, non-powered, field wired
  - Field installed, non-powered, field wired

#### **Field Installed**

##### **GFI Weatherproof Cover**

- Single-gang cover
- Heavy-duty UV-resistant polycarbonate case construction
- Hinged base cover with gasket

## FEATURES AND BENEFITS

### INDOOR AIR QUALITY

10

#### Air Filters

- Disposable 2 inch MERV 4 filters furnished as standard

#### Options/Accessories

#### Factory or Field Installed

##### Healthy Climate® High Efficiency Air Filters

- Disposable MERV 8 or MERV 13 (Minimum Efficiency Reporting Value based on ASHRAE 52.2) efficiency 2-inch pleated filters

##### Replacement Filter Media Kit With Frame

- Replaces existing pleated filter media
- Includes washable metal mesh screen and metal frame with clip for holding replaceable non-pleated filter

#### Field Installed

##### Healthy Climate® High Efficiency MERV 16 Air Filters

- Disposable MERV 16 (Minimum Efficiency Reporting Value based on ASHRAE 52.2) efficiency 2-inch pleated filters

##### Indoor Air Quality (CO<sub>2</sub>) Sensors

- Monitors CO<sub>2</sub> levels
- Reports to the Lennox® CORE Control, which adjusts economizer dampers as needed

## CONTROL SYSTEM

### LENNOX® CORE CONTROL SYSTEM



- 11** The Lennox® CORE Control System is designed to accelerate equipment install and service. Standard with all Enlight rooftop units, control system integrates key technologies that lower installation costs, drive system efficiency, and protect your investments.

The Lennox® CORE Unit Controller is a microprocessor-based controller that provides flexible control of all unit functions.

#### CORE Mobile Service App

- Guided Setup with progress indicators, detailed help, and exportable summaries to manage simple, trouble-free setup, reducing commissioning times
- Enhanced Test Functionality provides real-time sensor readings, trending, and reports that enable easy troubleshooting
- Ability to set and configure parameters of the CORE Control System to manage sequence of operation
- Economizer test function ensures economizer is operating correctly



#### Additional Features:

- Built-In 7-Segment Display shows Unit Status and active alarms for easy troubleshooting
- Buttons for test and clearing delays
- SmartWire™ System with keyed and removable screw terminals ensure correct field wiring
- Built-in BACnet MS/TP and IP allow open integration to building management systems.
- Two-port Ethernet Switch enables daisy chaining for BACnet IP and automatic firmware updates

**NOTE** - Unit Internet Connection required.

- Profile setup copies key settings between units with the same configuration to reduce setup time
- USB port allows a technician to download and transfer unit information to help verify service was performed
- USB software updates on the Lennox® CORE Unit Controller enhance functionality without the need to change components
- Unit Controller Software

#### Configurable Built-In Functions

- Discharge Air Cooling Control
- Up to three distinct Cooling Airflows in Thermostat Mode
- Programmable independent heating, ventilation and cooling blower speeds

- Discharge Air Heating Control
- Economizer Control Options (See Economizer / Exhaust Air / Outdoor Air sections)
- Exhaust Fan Control Modes for fresh air damper position
- Configurable Morning Warm-up
- Night Setback Mode
- Fresh Air Tempering for Improved Ventilation
- Demand Control Ventilation
- Low Ambient Controls for operation down to 0°F
- Humiditrol™ Operation
- Enhanced Dehumidification (Latent Demand Control without hot gas reheat)

#### Component Protection / Unit Safeguards:

- Compressor Time-Off Delay
- Adjustable Blower On/Off Delay
- Return Air Temperature Limit Control
- Safety Switch Input allows Controller to respond to a external safety switch trip
- Service Relay Output
- Thermostat Bounce Delay
- Smoke Alarm Mode has four choices (unit off, positive pressure, negative pressure, purge)
- "Strike Three" Protection
- Gas Valve Time Delay Between First and Second Stage
- Minimum Compressor Run Time

#### Control Methods / Interfaces:

- DDC and 24V Thermostat
- BACnet MS/TP and IP
- LONTalk (Factory and Field Option)
- Lennox S-BUS
- Zone Temperature Sensor Input
- Dehumidistat and Humidity Sensor Inputs
- Indoor Air Quality Inputs (2)
- Built-in Control Parameter Defaults
- Permanent Diagnostic Code Storage
- Field Adjustable Control Parameters (Over 200 settings)
- Multiple Configurable Digital Inputs
- LED Indicators
- PC Interface connects the Lennox® CORE Unit Controller to a PC with the Lennox Unit Controller Software

**NOTE** - Lennox® CORE Control System features vary with the type of rooftop unit in which the control is installed.

## CONTROL SYSTEM

### LENNOX® CORE CONTROL SYSTEM (continued)

#### Discharge Air Temperature Sensor (VAV Model Only)

- Sensor sends information to the unit controller to cycle up to 2 stages of heating or 4 stages of cooling to maintain the discharge air setpoints for heating or cooling

**NOTE** - Sensor is shipped with the VAV unit for remote field installation in the supply duct.

### Controls Options

#### Factory or Field Installed

##### Dirty Filter Switch

- Senses static pressure increase and issues alarm if necessary

##### Fresh Air Tempering

- Used in applications with high outside air requirements
- Controller energizes the first stage heat as needed to maintain a minimum supply air temperature for comfort, regardless of the thermostat demand
- When ordered as a factory option, sensor ships with the unit for field installation

##### Smoke Detector

- Photoelectric type
- Installed in supply air section, return air section or both sections
- Available with power board and single sensor (supply or return) or power board and two sensors (supply and return)
- Power board located in unit control compartment

#### Commercial Control Systems

##### Interoperability via BACnet® or LonTalk® Protocols

- Communication compatible with third-party automation systems that support the BACnet Application Specific Controller device profile, LonMark® Space Comfort Controller functional profile, or LonMark Discharge Air Controller functional profile

#### Field Installed

##### Thermostats and Room Sensors

- Control system and thermostat options, see page 16

## OPTIONS / ACCESSORIES

### ECONOMIZER

- Economizer operation is set and controlled by the Lennox® CORE unit controller
- Simple plug-in connections from economizer to unit controller for easy installation
- All Enlight rooftop units are equipped with factory installed CEC Title 24 approved sensors for outside, return and discharge air temperature monitoring

**NOTE** - Optional sensors may be used instead of unit sensors to determine whether outdoor air is suitable for free cooling. See Options/Accessories table.

#### Factory or Field Installed

##### **12** High Performance Economizer

- Approved for California Title 24 building standards
- Low leakage dampers are Air Movement and Control Association International (AMCA) Class 1A Certified - Maximum 3 CFM per sq. ft. leakage at 1 in. w.g.
- ASHRAE 90.1 and IECC compliant
- Outdoor Air Hood with mist elimination is included when economizer is factory installed and is furnished with economizer when ordered for field installation

**NOTE** - Downflow or horizontal economizer applications require optional Downflow or Horizontal Barometric Relief Dampers with Exhaust Hood.

- Linked damper action
- High torque 24-volt fully-modulating spring return damper motor
- Return air and outdoor air dampers
- Plug-in connections to unit

**NOTE** - High Performance Economizers are not approved for use with enthalpy controls in Title 24 applications.

**NOTE** - The Free Cooling setpoint for Title 24 applications must be set based on the Climate Zone where the system is installed. See Section 140.4 "Prescriptive Requirements for Space Conditioning Systems" of the California Energy Commission's 2022 Building Energy Efficiency Standards.

**NOTE** - Refer to Installation Instructions for complete setup information.

## OPTIONS / ACCESSORIES

### ECONOMIZER (continued)

#### Differential Sensible Control

- Factory setting
- Uses outdoor air and return air sensors that are furnished with the unit
- The Lennox® CORE unit controller compares outdoor air temperature with return air
- When the outdoor air is below the configured setpoint and cooler than return air, the controller activates the economizer

**NOTE** - Differential Sensible Control can be configured in the field to provide Offset Differential Sensible Control or Single Sensible Control.

**NOTE** - In Offset Differential Sensible Control mode, the economizer is enabled if the temperature differential (offset) between outdoor air and return air reaches the configured setpoint. In Single Sensible Control mode, the economizer is enabled when outdoor air temperature falls below the configured setpoint.

#### Global Control

- The unit controller communicates with a DDC system with one global sensor (enthalpy or sensible)
- Determines whether outside air is suitable for free cooling on all units connected to the control system
- Sensor must be field provided

**NOTE** - Global control with enthalpy is not approved for Title 24 applications.

### Factory or Field Installed

#### Single Enthalpy Temperature Control (Not for Title 24)

- Outdoor air enthalpy sensor enables Economizer if the outdoor enthalpy is less than the setpoint of the control

#### Differential Enthalpy Control (Not for Title 24)

- Order two Single Enthalpy Controls
- One is field installed in the return air section
- One is installed in the outdoor air section
- Allows the economizer control to select between outdoor air or return air, whichever has lower enthalpy

### Field Installed

#### Outdoor Air CFM Control

- Maintains constant outdoor air volume levels on the supply air fan and varying unit airflows
- Velocity sensor located in the rooftop unit outdoor air section, the Lennox® CORE unit controller changes the Economizer position to help minimize the effect of supply fan speed changes on outdoor air volume levels
- Setpoint for outdoor air volume is established by field testing

**NOTE** - Not available with Demand Control Ventilation (CO<sub>2</sub> Sensor) or Building Pressure Control.

#### Building Pressure Control

- Maintains constant building pressure level
- Includes a static pressure transducer and outdoor static pressure assembly

Using differential pressure information between the outdoor air and the building air, the Lennox® CORE unit controller changes the Economizer position to help maintain a constant building pressure

**NOTE** - Not available with Demand Control Ventilation (CO<sub>2</sub> Sensor) or Outdoor Air CFM Control.

### EXHAUST

#### Factory or Field Installed

#### **13** Downflow Barometric Relief Dampers

- Allow relief of excess air
- Aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle
- Exhaust hood is factory installed when dampers are factory installed with economizer
- Exhaust hood is furnished with dampers when ordered for field installation
- Bird screen furnished

#### Horizontal Barometric Relief Dampers

- For use when unit is configured for horizontal applications requiring an economizer
- Allows relief of excess air
- Aluminum blade dampers prevent blow back and outdoor air infiltration during off cycle
- Field installed in return air duct
- Bird screen and hood furnished

**NOTE** - Horizontal Economizer Conversion kit is available for field installation.

## OPTIONS / ACCESSORIES

### EXHAUST (continued)

#### **Factory or Field Installed**

- 14** Standard Static Power Exhaust
- Fans install internal to unit for downflow applications only with economizer option
  - Provides exhaust air pressure relief
  - Interlocked to run when return air dampers are closed and supply air blower is operating
  - Fans run based on air damper position (adjustable)
  - Three 1/3 HP motors
  - 20 in. diameter propeller-type fans
  - Five blades
  - Total power input of 1125 Watts
  - Total air volume of 12,800 cfm at 0 in. w.g.
  - Motor is inherently protected
  - Totally enclosed
  - Steel cabinet and hood painted to match unit

**NOTE** - Requires optional Downflow Economizer Barometric Relief Dampers. Also see Standard Static Power Exhaust Blower Tables.

#### **Field Installed**

##### **High Static Power Exhaust**

- Centrifugal-type power exhaust blowers
- Overload and sub-fuse protected
- Ball bearings
- Forward curved blades
- Blower wheel is statically and dynamically balanced
- Adjustable pulleys for speed adjustments

**NOTE** - High Static Power Exhaust (with VFD) features a solid-state analog pressure transducer control which senses differential pressure between conditioned space and outdoor air to regulate exhaust blower speed. Also see High Static Power Exhaust Blower Tables.

**NOTE** - High Static Power Exhaust is field installed but must be ordered at the same time as the rooftop unit so the unit can be factory configured for this option.

### Control Choices

#### **Damper Position Control**

- For Standard Static Power Exhaust without VFD
- Lennox® CORE unit controller controls the power exhaust based on economizer damper position

#### **Field Installed**

##### **Differential Pressure Transducer Control**

- For Standard Static Power Exhaust or High Static Power Exhaust with VFD
- Lennox® CORE unit controller controls the power exhaust system based on a 0-10VDC signal from a differential pressure transducer, which compares atmospheric pressure to conditioned space static pressure

### OUTDOOR AIR

#### **Factory or Field Installed**

##### **Motorized Outdoor Air Dampers**

- Linked mechanical dampers
- Fully modulating spring return damper motor with plug-in connection
- 0 to 25% (fixed) outdoor air adjustable
- Installs in unit
- Outdoor air hood with bird screen included

**NOTE** - Outdoor Air Hood is shipped separately in the unit with factory installed dampers for field installation.

#### **Field Installed**

##### **Manual Outdoor Air Damper**

- Adjustable slide damper
- Installed in unit
- Outdoor air hood with bird screen included

## OPTIONS / ACCESSORIES

### **ROOF CURBS**

- Nailer strip furnished (downflow only)
- Mates to unit
- US National Roofing Contractors Approved
- Shipped knocked down

### **Downflow**

#### **Hybrid Roof Curbs**

- Interlocking tabs fasten corners together
- No tools required for assembly
- Can also be fastened together with furnished hardware
- Available in 14, 18, and 24 inch heights

### **Horizontal**

- Converts unit from downflow to horizontal (side) air flow
- Return air is on unit
- Supply air is on curb
- Available in 37 inch and 41 inch heights.
- See dimension drawings

**NOTE** - Requires Horizontal Return Air Panel Kit.

**NOTE** - Optional Insulation Kit is available to help prevent sweating.

### **CEILING DIFFUSERS**

#### **Field Installed**

#### **Ceiling Diffusers**

##### **(Flush or Step-Down)**

- White powder coat finish on diffuser face and grilles
- Insulated UL listed duct liner
- Diffuser box has collars for duct connection
- Step-down diffusers have double deflection blades
- Flush diffusers have fixed blades
- Provisions for suspending
- Internally sealed to prevent recirculation
- Removable return air grille
- Adapts to T-bar ceiling grids or plaster ceilings

#### **Transitions (Supply and Return)**

- Used with diffusers
- Installs in roof curb
- Galvanized steel construction
- Flanges furnished for duct connection to diffusers
- Fully insulated

### 15 **OVERVIEW**

**NOTE** - Available for 302H and 360H models with MSAV® Multi-Stage Air Volume option.

- Factory installed option designed to control humidity
- Provides dehumidification on demand using ASHRAE 90.1 recommended method for comfort conditioning humidity control
- Unit comes equipped with one row reheat coil, solenoid valve and humidity controller

### **BENEFITS**

- Improves indoor air quality
- Helps prevent damage due to high humidity levels
- Improves comfort levels by reducing space humidity levels

### **OPERATION**

#### **No Dehumidification Demand**

- The unit will operate conventionally whenever there is a demand for cooling or heating and no dehumidification demand
- Free cooling is only permitted when there is no demand for dehumidification

#### **Dehumidification Demand Only**

- Reheat operation will initiate on a dehumidification demand and does not require a cooling demand
- The unit will operate in the dehumidification mode until the relative humidity of the conditioned space is below the setpoint
- The reheat coil is sized to provide 68°F to 75°F supply air during reheat operation
- This reduces sensible cooling capacity and extends compressor run time to control humidity when the cooling load is low
- A solenoid valve diverts hot gas from the compressor to the reheat coil
- The cooled and dehumidified air from the evaporator is reheated as it passes through the reheat coil
- The de-superheated and partially condensed refrigerant continues to the outdoor condenser coil where condensing is completed
- The unit will continue to operate in this mode until the dehumidification demand is satisfied


**NOTE** - See Sequence of Operation for additional information.

#### **Dehumidification and Cooling Demand (Thermostat/ Room Sensor Application)**

- If both a dehumidification and a full cooling demand occur, the system will operate in cooling until the cooling demand is satisfied
- Then the system will energize the dehumidification mode


# HUMIDITROL® DEHUMIDIFICATION SYSTEM OPTION

## REFRIGERANT SCHEMATIC

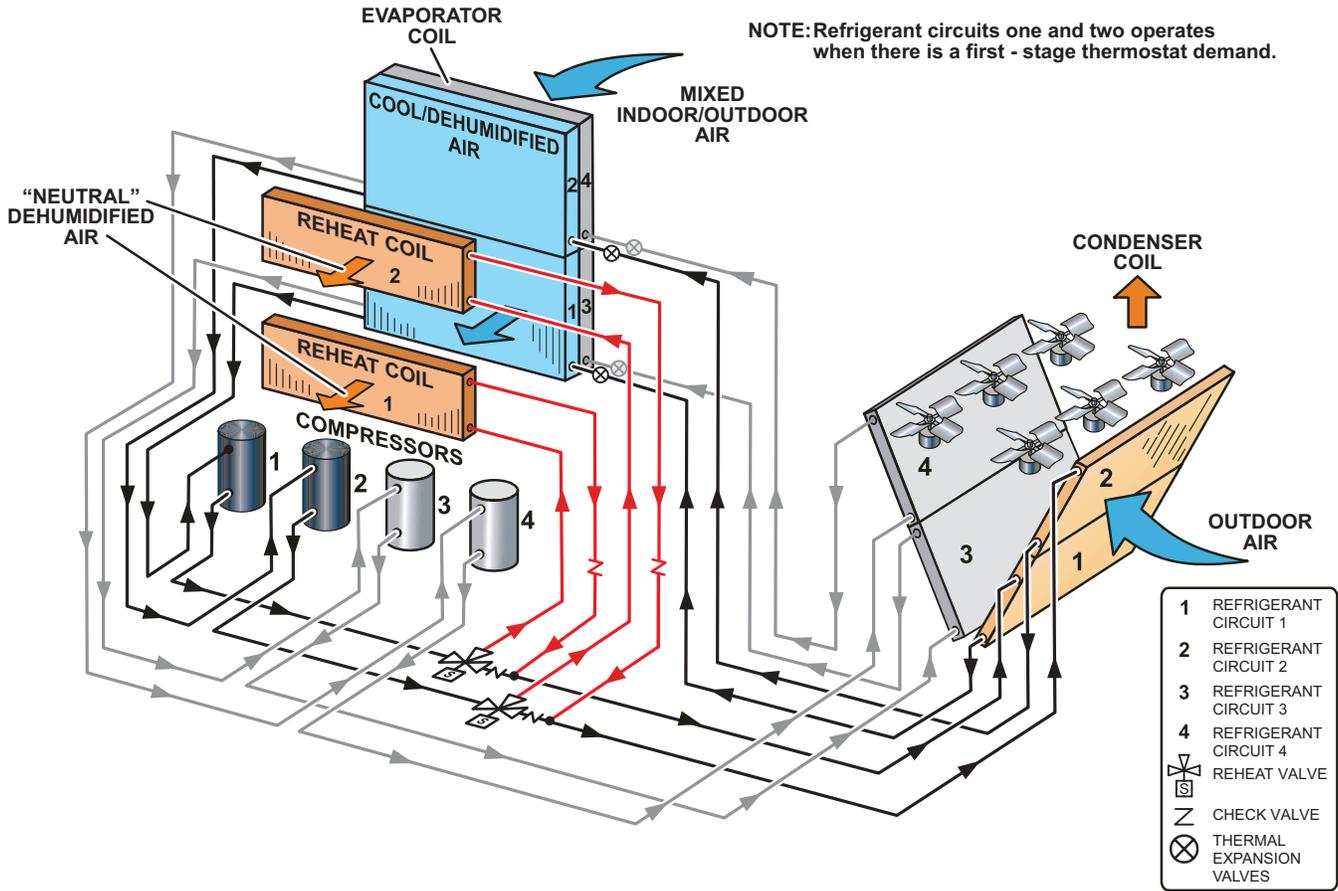

## OPTIONAL CONVENTIONAL TEMPERATURE CONTROL SYSTEMS

### CS8500 Commercial 7-Day Programmable Thermostat

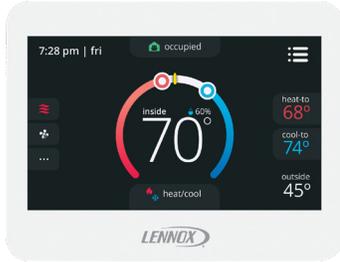

- Fully Communicating Sensor
- Full Color Touchscreen Interface
- Variable Speed System Control (On Compatible Units)
- Up To 4 Heat / 4 Cool
- Built-In Sensors For Temperature, Humidity And Optional CO<sub>2</sub>
- Remote Sensor Options For Occupancy, Temperature
- BACnet Capable Options
- 5-2 or 7-Day Scheduling
- Smooth Setback Recovery
- Heat/Cool Auto-Changeover
- Four-Wire Installation
- FDD, ASHRAE, IECC Compliant

### CS7500 Commercial 7-Day Programmable Thermostat



- Premium Universal Thermostat
- Full Color Touchscreen Interface
- Up To 4 Heat / 3 Cool
- Built-In Sensors For Temperature and Humidity
- Remote Sensors Options For Temperature, Discharge Air, Outdoor Air
- 5-2 or 7-Day Scheduling
- Smooth Setback Recovery
- Heat/Cool Auto-Changeover
- FDD, ASHRAE, IECC Compliant

### CS3000 Commercial 5-2 Day Programmable Thermostat



- Conventional Multi-Stage Thermostat
- Intuitive Display
- Push-Button Operation
- Up To 2 Heat / 2 Cool
- Built-In Temperature Sensor
- Remote Temperature Sensing
- Up to 5-2 Day Scheduling
- Smooth Setback Recovery
- Heat/Cool Auto-changeover

### Wired Temperature/Humidity Room Sensor (Non-Communicating)



- Terminal blocks for wiring connections
- Five-wire sensor connection
- Off-white plastic enclosure
- Non-adjustable
- Relative humidity range: 0 -100%
- +/- 3% Accuracy

## OPTIONAL CONVENTIONAL TEMPERATURE CONTROL SYSTEMS

Description	Order Number
<b>CS8500 Commercial 7 Day Programmable Thermostat</b>	
CS8500 7-Day Thermostat	No CO <sub>2</sub> Sensing <b>24K55</b>
	With CO <sub>2</sub> Sensing <b>24K53</b>
Sensors/Accessories	<sup>1</sup> Remote non-adjustable wall-mount 10k <b>47W37</b>
	<sup>1</sup> Remote non-adjustable wall-mount 11k <b>94L61</b>
<b>Sysbus Network Cable (Yellow) for CS8500 and LCS-5030 Wired Room Sensor</b>	
Twisted pair 100% shielded communication cable, Red and Black	500 ft. box <b>27M19</b>
22 AWG, yellow jacket, rated at 75°C, 300V, Plenum rated	1000 ft. box <b>94L63</b>
Insulation - Low smoke PVC, NEC, CMP	2500 ft. roll <b>68M25</b>
<b>CS7500 Commercial 7-Day Programmable Thermostat</b>	
CS7500 7-Day Thermostat	<b>24K41</b>
Sensors/Accessories	<sup>2</sup> Remote non-adjustable wall-mount 20k <b>47W36</b>
	<sup>2</sup> Remote non-adjustable wall-mount 10k <b>47W37</b>
	Remote non-adjustable discharge air (duct mount) <b>19L22</b>
	Outdoor temperature sensor <b>X2658</b>
<b>CS3000 Commercial 5-2 Day Programmable Thermostat</b>	
CS3000 5-2 Day Thermostat	<b>11Y05</b>
Sensors/Accessories	Remote non-adjustable wall mount 10k averaging <b>47W37</b>
	Thermostat wall mounting plate <b>X2659</b>
<b>Universal Thermostat Guard with Lock (clear)</b>	
	Inside Dimensions (H x W x D) 5-7/8 x 8-3/8 x 3 in. <b>39P21</b>
<b>Temperature/Humidity Room Sensor</b>	
A335MT13AE1 Wired Temperature/Humidity Room Sensor (Non-Communicating)	<b>21W06</b>

<sup>1</sup> Up to nine of the same type remote temperature sensors can be connected in parallel.

<sup>2</sup> Remote wall-mount sensors can be applied in any of the following combinations:

One Sensor - (1) 47W36, Two Sensors - (2) 47W37, Three Sensors - (2) 47W36 and (1) 47W37

Four Sensors - (4) 47W36, Five Sensors - (3) 47W36 and (2) 47W37

**UNIT OPERATION WITH 2-STAGE THERMOSTAT OR THIRD PARTY UNIT CONTROLLERS (2 HEAT / 2 COOL)  
(THIS SECTION NOT APPLICABLE FOR DISCHARGE AIR TEMPERATURE CONTROL)****SUPPLY AIR BLOWER SPEED**

Unit has the following supply air blower speed settings:

- Ventilation Speed
- Low Cooling Speed
- High Cooling Speed
- Heating Speed
- Smoke Speed (Used only in smoke removal option - not discussed)

**COOLING (2 Cool)****<sup>1</sup> Unit Features An Economizer And Outdoor Air Is Suitable****Y1 Demand:**

All compressors are off, supply air blower is set to Low Cooling Speed; economizer modulates (minimum to maximum open position) to maintain 55°F discharge air temperature.

**Y2 Demand:**

All compressors are off, supply air blower is set to High Cooling Speed, and economizer modulates (minimum to maximum open position) to maintain 55°F discharge air temperature.

*NOTE - If economizer stays at maximum open for 3 minutes, 1st stage compressors (compressor 1 and 2) are energized while supply air blower stays on high cooling speed providing maximum cooling capacity.*

<sup>1</sup> *Outdoor air suitability is determined by the energy state of outdoor ambient (enthalpy or sensible) and its ability to achieve the desired free cooling effects. Outdoor air suitability can also be determined by a third party controller and provided to the RTU via a network connection.*

**Unit Does Not Feature An Economizer Or Outdoor Air Is Not Suitable****Y1 Demand:**

The first two compressors operate and the supply air blower is activated. The blower is set to the Low Cooling Speed.

**Y2 Demand:**

All compressors operate and supply air blower is activated. The blower is set to the High Cooling Speed.

**Dehumidification Mode**

If a unit with Humiditrol® Dehumidification Option receives a call for dehumidification, economizer free cooling is locked out.

**Call For Dehumidification, No Y1, Y2 Demand:**

Compressors 1 and 2 operate, supply air blower operates at low cooling speed, and both reheat valves are energized.

**Y1 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed and both reheat valves are energized.

**Y2 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed, and the reheat valves are de-energized.

**HEATING (2 Heat)****W1 Demand:**

The first two stages of mechanical heat are activated; the blower is set to Heating Speed.

**W2 Demand:**

The third and fourth stages of mechanical heat are activated; the blower is set to the Heating Speed.

**UNIT OPERATION IN ROOM SENSOR MODE OR DISCHARGE AIR TEMPERATURE CONTROL  
(4 HEAT / 4 COOL)****SUPPLY AIR BLOWER SPEED**

Unit has the following supply air blower speed settings:

- Ventilation speed
- Cooling Speed 1 (low)
- Cooling Speed 2 (medium-low)
- Cooling Speed 3 (medium-high)
- Cooling Speed 4 (high)
- Heating Speed
- Smoke Speed (Used only in smoke removal option - not discussed)

**COOLING (4 Cool)**

- Room sensors (when connected to S-Bus) or Discharge air temperature (DAT) can be used to control unit staging.
- DAT default setpoint = 55°F. Unit will stage compressors as required to maintain the setpoint when provided with Y1 thermostat demand.
- Room sensor occupied default setpoint = 75°F. Unit will stage compressors as required to maintain the setpoint.
- Increasing compressor stages provides more cooling capacity while decreasing compressor stages provides less cooling capacity.

**<sup>1</sup> Unit Features An Economizer And Outdoor Air Is Suitable****Cooling Stage 1:**

All compressors are off, supply air blower is on Cooling Speed 1 to minimize blower power consumption, economizer modulates (minimum to maximum open position) to maintain setpoint.

**Cooling Stage 2:**

All compressors are off, supply air blower is on Cooling Speed 4 to provide higher cooling capacity, and economizer modulates to maintain setpoint. If economizer stays at maximum open for 3 minutes, compressor 1 is energized while supply air blower stays on Cooling Speed 4. After compressor 1 is energized, the economizer stays at maximum open.

**Cooling Stage 3:**

Compressor 1 and 2 are energized while supply air blower is on Cooling speed 4 to provide even higher cooling capacity.

**Cooling Stage 4:**

All compressors are energized while supply air blower is on Cooling speed 4 to provide maximum cooling capacity. 1 Outdoor air suitability is determined by the energy state of outdoor ambient (enthalpy or sensible) and its ability to achieve the desired free cooling effects. Outdoor air suitability can also be determined by a third party controller and provided to the RTU via a network connection.

**Unit Does Not Feature An Economizer Or Outdoor Air Is Not Suitable****Cooling Stage 1:**

Compressor 1 operates and supply air blower operates at Cooling Speed 1.

**Cooling Stage 2:**

Compressors 1 and 2 operate and supply air blower operates at Cooling Speed 2.

**Cooling Stage 3:**

Compressors 1, 2, and 3 operate and supply air blower operates at Cooling Speed 3.

**Cooling Stage 4:**

All compressors operate and supply air blower operates at Cooling Speed 4.

**UNIT OPERATION IN ROOM SENSOR MODE OR DISCHARGE AIR TEMPERATURE CONTROL  
(4 HEAT / 4 COOL) (CONTINUED)****Dehumidification Mode**

If a unit with Humiditrol® Dehumidification Option receives a call for dehumidification, economizer free cooling is locked out.

**Call For Dehumidification, No Y1, Y2, Y3, Y4 Demand:**

Compressors 1 and 2 operate, supply air blower operates at medium-low cooling speed, and both reheat valves are energized.

**Y1 Demand With A Call For Dehumidification:**

Compressors 1, 2, and 3 operate, supply air blower operates at high cooling speed and both reheat valves are energized.

**Y2 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed and both reheat valves are energized.

**Y3 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed, and the reheat valve of compressor 1 is energized while the reheat valve of compressor 2 is de-energized.

**Y4 Demand With A Call For Dehumidification:**

All compressors operate, supply air blower operates at high cooling speed, and the reheat valves are de-energized.

**HEATING (4 Heat)**

- Room sensors (when connected to S-Bus) or Discharge air temperature (DAT) can be used to control up to four stages of electric heat.
- DAT default setpoint = 110°F. Unit will stage heating as required to maintain the setpoint when provided with W1 demand.
- Room sensor occupied setpoint default = 70°F. Unit will stage heating as required to maintain the setpoint.
- Increasing heat stages provides more heating capacity while decreasing heat stages provides less heating capacity.
- Blower set to Heating Speed for all stages.

**UNITS IN ZONING APPLICATIONS OPERATING WITH DISCHARGE AIR CONTROL (4 HEAT / 4 COOL)****SUPPLY AIR BLOWER SPEED**

Unit has the following supply air blower speed settings:

- Ventilation Speed
- Cooling Speed - Fully modular based on supply duct static pressure
- Heating Speed
- Smoke Speed (Used only in smoke removal option - not discussed)

**COOLING (4 Cool)**

- Discharge air temperature (DAT) can be used to control unit staging.
- DAT default setpoint = 55°F. Unit will stage compressors as required to maintain the setpoint when provided with Y1 thermostat demand.
- Increasing compressor stages provides more cooling capacity while decreasing compressor stages provides less cooling capacity.

**<sup>1</sup> Unit Features An Economizer And Outdoor Air Is Suitable****Cooling Stage 1:**

All compressors are off, supply air blower operates to maintain duct static pressure, economizer modulates (minimum to maximum open position) to maintain 55°F supply air temperature (default unit controller setting).

**Cooling Stage 2:**

All compressors are off, supply air blower operates to maintain duct static pressure, and economizer modulates to maintain 55°F supply air temperature. If economizer stays at maximum open for 3 minutes, compressor 1 is energized while supply air blower operates to maintain duct static pressure. After compressor 1 is energized, the economizer stays at maximum open.

**Cooling Stage 3:**

Compressor 1 and 2 are energized while supply air blower operates to maintain duct static pressure.

**Cooling Stage 4:**

All compressors are energized while supply air blower operates to maintain duct static pressure.

<sup>1</sup> Outdoor air suitability is determined by the energy state of outdoor ambient (enthalpy or sensible) and its ability to achieve the desired free cooling effects. Outdoor air suitability can also be determined by a third party controller and provided to the RTU via a network connection.

**Unit Does Not Feature An Economizer Or Outdoor Air Is Not Suitable****Cooling Stage 1:**

Compressor 1 operates and supply air blower operates to maintain duct static pressure.

**Cooling Stage 2:**

Compressors 1 and 2 operate and supply air blower operates to maintain duct static pressure.

**Cooling Stage 3:**

Compressors 1, 2, and 3 operate and supply air blower operates to maintain duct static pressure.

**Cooling Stage 4:**

All compressors operate and supply air blower operates to maintain duct static pressure.

**UNIT IN ZONING APPLICATIONS OPERATING WITH DISCHARGE AIR CONTROL (4 HEAT / 4 COOL) (CONTINUED)****HEATING (4 Heat)**

- Room sensors (when connected to S-Bus) or Discharge air temperature (DAT) can be used to control up to four stages of electric heat.
- DAT default setpoint = 110°F. Unit will stage heating as required to maintain the setpoint when provided with W1 demand.
- Room sensor occupied setpoint default = 70°F. Unit will stage heating as required to maintain the setpoint.
- Increasing heat stages provides more heating capacity while decreasing heat stages provides less heating capacity.
- Blower set to Heating Speed for all stages.

**ACCESSORIES****Modulating Outdoor Air Damper**

The minimum damper position for “occupied low blower” and “occupied high blower” is adjusted during unit setup to provide minimum fresh air requirements per ASHRAE 62.1 at the corresponding supply air blower speeds.

- When supply air blower is off or the unit is in unoccupied mode, the outdoor air damper is closed.
- When unit is in occupied mode and supply air blower is operating at a speed below the “midpoint” blower speed, the outdoor air damper is at minimum “low blower” position.
- When unit is in occupied mode and supply air blower is operating at a speed equal to or above the “midpoint” blower speed, the outdoor air damper is at minimum “high blower” position.

*NOTE - The “midpoint” blower speed is an average of the minimum and maximum blower speed ((minimum speed + maximum speed) divided by 2).*

## OPTIONS / ACCESSORIES

Item Description	Order Number	Size		
		302	360	
<b>COOLING SYSTEM</b>				
Condensate Drain Trap	PVC	<b>22H54</b>	X	X
	Copper	<b>76W27</b>	X	X
Drain Pan Overflow Switch		<b>21Z07</b>	OX	OX
Stainless Steel Condensate Drain Pan		<b>83W42</b>	OX	OX
<b>BLOWER - SUPPLY AIR</b>				
Blower Type	MSAV® Multi-Stage Air Volume	Factory	O	O
	VAV Variable Air Volume	Factory	O	O
Motors	Belt Drive (standard efficiency) - 5 HP	Factory	O	O
	Belt Drive (standard efficiency) - 7.5 HP	Factory	O	O
	Belt Drive (standard efficiency) - 10 HP	Factory	O	O
	Automatic VFD Bypass Option (MSAV® Models Only)	Factory	O	O
Drive Kits See Blower Data Tables for usage and selection	Kit #1 740-895 rpm	Factory	O	O
	Kit #2 870-1045 rpm	Factory	O	O
	Kit #3 715-880 rpm	Factory	O	O
	Kit #4 770-965 rpm	Factory	O	O
	Kit #5 660-810 rpm	Factory	O	O
	Kit #6 770-965 rpm	Factory	O	O
	Kit #7 570-720 rpm	Factory	O	O
	Kit #8 480-630 rpm	Factory	O	O
	Kit #9 410-535 rpm	Factory	O	O
	Blower Belt Auto-Tensioner	<b>38C61</b>	X	X
<b>CABINET</b>				
Burglar Bars		<b>Y1036</b>	X	X
Combination Coil/Hail Guards		<b>13T16</b>	OX	OX
Corrosion Protection		Factory	O	O
Horizontal Return Air Panel Kit		<b>38K48</b>	X	X
<b>CONTROLS</b>				
Commercial Controls	LonTalk® Module	<b>54W27</b>	OX	OX
	Novar® LSE	Factory	O	O
Dirty Filter Switch		<b>53W68</b>	OX	OX
Fresh Air Tempering		<b>21Z08</b>	OX	OX
Smoke Detector - Supply or Return (Power board and one sensor)		<b>37G73</b>	OX	OX
Smoke Detector - Supply and Return (Power board and two sensors)		<b>37G74</b>	OX	OX
Supply Static Limit Switch		<b>79M80</b>	X	X
Supply Static Limit Switch - Mounting Kit		<b>79M81</b>	X	X

NOTE - Order numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

## OPTIONS / ACCESSORIES

Item Description	Order Number	Size		
		302	360	
<b>INDOOR AIR QUALITY</b>				
<b>Air Filters</b>				
Healthy Climate® High Efficiency Air Filters 20 x 20 x 2 - order 12 per unit	MERV 8	<b>54W21</b>	OX	OX
	MERV 13	<b>52W39</b>	OX	OX
	MERV 16	<b>21U40</b>	X	X
Replaceable Media Filter with Metal Mesh Frame (includes Non-Pleated Filter Media) 20 x 20 x 2- order 12 per unit		<b>44N60</b>	X	X
<b>Indoor Air Quality (CO<sub>2</sub>) Sensors</b>				
Sensor - Wall-mount, off-white plastic cover with LCD display		<b>77N39</b>	X	X
Sensor - Wall-mount, off-white plastic cover, no display		<b>87N53</b>	X	X
Sensor - Black plastic case, LCD display, rated for plenum mounting		<b>87N52</b>	X	X
Sensor - Black plastic case, no display, rated for plenum mounting		<b>87N54</b>	X	X
CO <sub>2</sub> Sensor Duct Mounting Kit - for downflow applications		<b>23Y47</b>	X	X
Aspiration Box - for duct mounting non-plenum rated CO <sub>2</sub> sensors ( <b>77N39</b> )		<b>90N43</b>	X	X
<b>ELECTRICAL</b>				
Voltage 60 Hz	208/230V - 3 phase	Factory	O	O
	460V - 3 phase	Factory	O	O
	575V - 3 phase	Factory	O	O
HACR Circuit Breakers		Factory	O	O
<sup>1</sup> Short-Circuit Current Rating (SCCR) of 100kA (includes Phase/Voltage Detection)			O	O
<sup>2</sup> Disconnect Switch (See Electrical Accessories Table for usage, page 42)	80 amp	<b>54W85</b>	OX	OX
	150 amp	<b>54W86</b>	OX	OX
	250 amp	<b>54W87</b>	OX	OX
GFI Service Outlets	15 amp non-powered, field-wired (208/230V, 460V only)	<b>74M70</b>	OX	OX
	<sup>3, 4</sup> 15 amp factory-wired and powered (208/230V, 460V)	Factory	O	O
	<sup>5</sup> 20 amp non-powered, field-wired (208/230V, 460V, 575V)	<b>67E01</b>	X	X
	<sup>5</sup> 20 amp non-powered, field-wired (575V)	Factory	O	O
Weatherproof Cover for GFI		<b>10C89</b>	X	X
Phase/Voltage Detection		Factory	O	O
<b>ELECTRIC HEAT</b>				
30 kW	208/230V-3ph	<b>30U68</b>	OX	OX
	460V-3ph	<b>30U69</b>	OX	OX
	575V-3ph	<b>30U70</b>	OX	OX
45 kW	208/230V-3ph	<b>30U74</b>	OX	OX
	460V-3ph	<b>30U75</b>	OX	OX
	575V-3ph	<b>30U76</b>	OX	OX
60 kW	208/230V-3ph	<b>30U80</b>	OX	OX
	460V-3ph	<b>30U81</b>	OX	OX
	575V-3ph	<b>30U82</b>	OX	OX
90 kW	208/230V-3ph	<b>30U83</b>	OX	OX
	460V-3ph	<b>30U84</b>	OX	OX
	575V-3ph	<b>30U85</b>	OX	OX

<sup>1</sup> SCCR option is only available with factory installed electric heat or no electric heat.  
SCCR option is not available if the MOCP of the configured unit is greater than 200A.

<sup>2</sup> Disconnect Switch is not available with the SCCR option.

<sup>3</sup> If a factory installed disconnect switch is ordered with a factory installed GFI, the default disconnect size is 150 amps.

<sup>4</sup> Unit powered GFI Service Outlets are not available with SCCR option.  
Disconnect Switch or Circuit Breaker is required with unit powered GFI Service Outlets.

<sup>5</sup> Canada requires a minimum 20 amp circuit. Select 20 amp, non-powered, field wired GFI.

NOTE - Order numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

## OPTIONS / ACCESSORIES

Item Description	Order Number	Size	
		302	360
<b>7 HUMIDITROL® CONDENSER REHEAT OPTION</b>			
Humiditrol® Dehumidification Option	Factory	O	O
<b>ECONOMIZER</b>			
<b>High Performance Economizer (Approved for California Title 24 Building Standards / AMCA Class 1A Certified)</b>			
High Performance Economizer (Downflow or Horizontal) Includes Economizer Dampers with Outdoor Air Hood Downflow Applications - Use furnished Outdoor Air Hood - Order Downflow Barometric Relief Dampers with Exhaust Hood separately Horizontal Applications - Use furnished Outdoor Air Hood - Order Horizontal Barometric Relief Dampers with Exhaust Hood separately	<b>18X87</b>	OX	OX
<b>Economizer Controls</b>			
Differential Enthalpy (Not for Title 24)	Order 2 <b>21Z09</b>	OX	OX
Sensible Control	Sensor is Furnished Factory	O	O
Single Enthalpy (Not for Title 24)	<b>21Z09</b>	OX	OX
Global, Enthalpy	Sensor Field Provided Factory	O	O
Building Pressure Control	<b>13J77</b>	X	X
Differential Sensible	Sensor is Furnished Factory	O	O
Outdoor Air CFM Control	<b>13J76</b>	X	X
<b>Barometric Relief Dampers With Exhaust Hood</b>			
Downflow Barometric Relief Dampers	<b>76W17</b>	OX	OX
Horizontal Barometric Relief Dampers	<b>33K78</b>	OX	OX
<b>OUTDOOR AIR</b>			
<b>Outdoor Air Dampers With Outdoor Air Hood</b>			
Motorized	<b>18X89</b>	OX	OX
Manual	<b>18X88</b>	X	X
<b>POWER EXHAUST</b>			
Standard Static, SCCR Rated	208/230V <b>74W21</b>	OX	OX
	460V <b>74W22</b>	OX	OX
	575V <b>74W23</b>	OX	OX
High Static with VFD 2 HP (731-932 rpm)	208/230V <b>83M89</b>	X	X
	460V <b>83M90</b>	X	X
	575V <b>83M91</b>	X	X
<b>Power Exhaust Control</b>			
Pressure Transducer Control	<b>13J77</b>	X	X

<sup>6</sup> Available for 302H and 360H models only with MSAV® Multi-Stage Air Volume option.

NOTE - Order numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

## OPTIONS / ACCESSORIES

Item Description	Order Number	Size		
		302	360	
<b>ROOF CURBS</b>				
<b>Hybrid Roof Curbs, Downflow</b>				
14 in. height	11F62	X	X	
18 in. height	11F63	X	X	
24 in. height	11F64	X	X	
<b>Standard Roof Curbs, Horizontal - Requires Horizontal Return Air Panel Kit</b>				
30 in. height - slab applications	11T90	X	X	
41 in. height - rooftop applications	11T97	X	X	
<b>Horizontal Return Air Panel Kit</b>				
Required for Horizontal Applications with Roof Curb	38K48	X	X	
<b>Insulation Kit For Standard Horizontal Curbs</b>				
For 30 in. Curb	73K33	X	X	
For 41 in. Curb	73K35	X	X	
<b>CEILING DIFFUSERS</b>				
Step-Down - Order one	LARTD30/36S	45K74	X	X
Flush - Order one	LAFD30/36S	45K75	X	X
Transitions (Supply and Return) - Order one	LASRT30/36	33K80	X	X

NOTE - Order numbers shown are for ordering field installed accessories.

OX - Configure To Order (Factory Installed) or Field Installed

O = Configure To Order (Factory Installed)

X = Field Installed

**SPECIFICATIONS** **25 TON**

Model		LCT302H5V	LCT302H5M	
<b>Nominal Tonnage</b>		25 Ton	25 Ton	
<b>Efficiency Type</b>		High	High	
<b>Blower Type</b>		VAV Variable Air Volume	MSAV® Multi-Stage Air Volume	
<b>Cooling Performance</b>	Gross Cooling Capacity - Btuh	309,000	309,000	
	<sup>1</sup> Net Cooling Capacity (Btuh)	300,000	300,000	
	<sup>1</sup> AHRI Rated Air Flow (cfm)	8200	8200	
	Total Unit Power - kW	26.2	26.2	
	<sup>1</sup> IEER (Btuh/Watt)	14.3	15.8	
	<sup>1</sup> EER (Btuh/Watt)	11.4	11.4	
<b>Sound Rating Number</b>		dBA 95	95	
<b>Refrigerant Charge</b>		Refrigerant Type R-454B	R-454B	
Without Reheat	Circuit 1	6 lbs. 12 oz.	6 lbs. 12 oz.	
		Circuit 2	6 lbs. 8 oz.	
		Circuit 3	6 lbs. 11 oz.	
		Circuit 4	6 lbs. 13 oz.	
	With Reheat	Circuit 1	---	6 lbs. 12 oz.
		Circuit 2	---	6 lbs. 8 oz.
		Circuit 3	---	6 lbs. 11 oz.
		Circuit 4	---	6 lbs. 13 oz.
<b>Electric Heat Available</b>		See page 41		
<b>Compressor Type (number)</b>		Scroll (4)	Scroll (4)	
<b>Outdoor Coils</b>	Net face area - ft. <sup>2</sup> (total)	68.3	68.3	
	Number of rows	1	1	
	Fins - in.	23	23	
<b>Outdoor Coil Fans</b>	Motor HP (number and type)	1/3 (6 PSC)	1/3 (6 PSC)	
	Rpm	1075	1075	
	Watts (total)	2500	2500	
	Diameter (Number) - in.	(6) 24	(6) 24	
	Blades	3	3	
	Total Air volume - cfm	21,500	21,500	
<b>Indoor Coils</b>	Net face area - ft. <sup>2</sup> (total)	31.40	31.40	
	Tube diameter - in.	3/8	3/8	
	Rows	4	4	
	Fins - in.	14	14	
	Condensate drain size (NPT) - in.	(1) 1 in.	(1) 1 in.	
Expansion device type		Balanced Port Thermostatic Expansion Valve,removable power head		
<sup>3</sup> Indoor Blower and Kit Selection	Nominal motor HP	5, 7.5, 10		
	Maximum usable motor output (US Only)	5.75, 8.63, 11.5		
	Motor - Drive kit number	5 HP Kit 5 660-810 rpm Kit 6 770-965 rpm Kit 7 570-720 rpm Kit 8 480-630 rpm Kit 9 410-535 rpm		
		7.5 HP Kit 3 715-880 rpm Kit 4 770-965 rpm		
		10 HP Kit 1 740-895 rpm Kit 2 870-1045 rpm		
	Wheel (Number) diameter x width - in.	(2) 18 x 15		
	<b>Filters</b>	Type of filter	Fiberglass, disposable	
		Number and size - in.	(12) 20 x 20 x 2	
	<b>Line voltage data (Volts-Phase-Hz)</b>		208/230-3-60, 460-3-60, 575-3-60	

NOTE - Net capacity includes evaporator blower motor heat deduction. Gross capacity does not include evaporator blower motor heat deduction.  
<sup>1</sup> Tested at conditions included in with AHRI Standard 340/360; 95°F outdoor air temperature and 80°F db/67°F wb entering evaporator air; minimum external duct static pressure.  
<sup>2</sup> Using total air volume and system static pressure requirements determine from blower performance tables rpm and motor output required. Maximum usable output of motors furnished are shown. In Canada, nominal motor output is also maximum usable motor output. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

**SPECIFICATIONS**
**30 TON**

Model		LCT360H5V	LCT360H5M	
<b>Nominal Tonnage</b>		30 Ton	30 Ton	
<b>Efficiency Type</b>		High	High	
<b>Blower Type</b>		VAV Variable Air Volume	MSAV® Multi-Stage Air Volume	
<b>Cooling Performance</b>	Gross Cooling Capacity - Btuh	360,000	360,000	
	<sup>1</sup> Net Cooling Capacity (Btuh)	350,000	350,000	
	<sup>1</sup> AHRI Rated Air Flow (cfm)	8750	8750	
	Total Unit Power - kW	32.5	32.5	
	<sup>1</sup> IEER (Btuh/Watt)	13.5	14.2	
	<sup>1</sup> EER (Btuh/Watt)	10.8	10.8	
<b>Sound Rating Number</b>		dBA	95	
<b>Refrigerant Charge</b>		Refrigerant Type	R-454B	
Without Reheat Option  With Reheat Option	Circuit 1	6 lbs. 6 oz.	6 lbs. 6 oz.	
		Circuit 2	6 lbs. 13 oz.	6 lbs. 13 oz.
			Circuit 3	6 lbs. 10 oz.
		Circuit 4		6 lbs. 6 oz.
	Circuit 1		---	7 lbs. 12 oz.
	Circuit 2		---	7 lbs. 8 oz.
	Circuit 3		---	6 lbs. 14 oz.
	Circuit 4	---	6 lbs. 12 oz.	
<b>Electric Heat Available</b>		See page 41		
<b>Compressor Type (number)</b>		Scroll (4)	Scroll (4)	
<b>Outdoor Coils</b>	Net face area - ft. <sup>2</sup> (total)	68.3	68.3	
	Number of rows	1	1	
	Fins - in.	23	23	
<b>Outdoor Coil Fans</b>	Motor HP (number and type)	1/3 (6 PSC)	1/3 (6 PSC)	
	Rpm	1075	1075	
	Watts (total)	2500	2500	
	Diameter (Number) - in.	(6) 24	(6) 24	
	Blades	3	3	
	Total Air volume - cfm	21,500	21,500	
<b>Indoor Coils</b>	Net face area - ft. <sup>2</sup> (total)	31.40	31.40	
	Tube diameter - in.	3/8	3/8	
	Rows	4	4	
	Fins - in.	14	14	
	Condensate drain size (NPT) - in.	(1) 1 in.	(1) 1 in.	
		Expansion device type		
		Balanced Port Thermostatic Expansion Valve,removable power head		
<sup>3</sup> Indoor Blower and Kit Selection	Nominal motor HP		5, 7.5, 10	
	Maximum usable motor output (US Only)		5.75, 8.63, 11.5	
	Motor - Drive kit number		5 HP Kit 5 660-810 rpm Kit 6 770-965 rpm Kit 7 570-720 rpm Kit 8 480-630 rpm Kit 9 410-535 rpm	
			7.5 HP Kit 3 715-880 rpm Kit 4 770-965 rpm	
			10 HP Kit 1 740-895 rpm Kit 2 870-1045 rpm	
	Wheel (Number) diameter x width - in.		(2) 18 x 15	
	<b>Filters</b>	Type of filter	Fiberglass, disposable	
		Number and size - in.	(12) 20 x 20 x 2	
	<b>Line voltage data (Volts-Phase-Hz)</b>		208/230-3-60, 460-3-60, 575-3-60	

NOTE - Net capacity includes evaporator blower motor heat deduction. Gross capacity does not include evaporator blower motor heat deduction.

<sup>1</sup> Tested at conditions included in with AHRI Standard 340/360; 95°F outdoor air temperature and 80°F db/67°F wb entering evaporator air; minimum external duct static pressure.

<sup>2</sup> Using total air volume and system static pressure requirements determine from blower performance tables rpm and motor output required. Maximum usable output of motors furnished are shown. In Canada, nominal motor output is also maximum usable motor output. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

# RATINGS

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

## 25 TON HIGH EFFICIENCY LCT302H5M (2 COMPRESSORS - PART LOAD) - MSAV® (MULTI-STAGE AIR VOLUME)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4000	161.9	6.75	0.69	0.81	0.92	156.9	7.79	0.7	0.82	0.94	151.4	8.89	0.7	0.83	0.96	145.7	10.1	0.72	0.85	0.98
	5000	171	6.76	0.72	0.86	0.99	165.6	7.82	0.73	0.88	1	159.6	8.94	0.74	0.89	1	153.3	10.16	0.76	0.92	1
	6000	178	6.76	0.76	0.92	1	171.9	7.83	0.77	0.94	1	165.5	8.98	0.79	0.96	1	158.8	10.21	0.81	0.98	1
67°F	4000	170	6.76	0.55	0.67	0.77	164.7	7.82	0.56	0.67	0.78	158.8	8.94	0.57	0.68	0.8	153	10.16	0.58	0.69	0.81
	5000	179.8	6.76	0.58	0.7	0.83	173.7	7.84	0.58	0.71	0.85	167.6	8.99	0.59	0.72	0.86	161	10.23	0.6	0.74	0.89
	6000	186.8	6.75	0.59	0.74	0.89	180.3	7.86	0.6	0.75	0.9	173.6	9.02	0.61	0.77	0.93	166	10.27	0.63	0.79	0.95
71°F	4000	177.6	6.76	0.44	0.54	0.65	171.8	7.83	0.44	0.55	0.65	166	8.98	0.44	0.56	0.66	159.4	10.21	0.45	0.56	0.67
	5000	187.7	6.75	0.45	0.57	0.68	182.2	7.86	0.45	0.57	0.69	175.2	9.03	0.45	0.58	0.71	168.3	10.29	0.45	0.59	0.72
	6000	195.9	6.75	0.45	0.58	0.72	189	7.87	0.45	0.59	0.73	181.4	9.06	0.45	0.6	0.75	173.5	10.33	0.46	0.62	0.77

## 25 TON HIGH EFFICIENCY LCT302H5M (4 COMPRESSORS - FULL LOAD) - MSAV® (MULTI-STAGE AIR VOLUME)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	8000	311.7	17.95	0.72	0.83	0.93	299.5	20.37	0.73	0.85	0.95	287.3	23.02	0.74	0.86	0.96	274.4	26.02	0.75	0.88	0.98
	10000	327.7	18.04	0.77	0.89	0.99	314.6	20.51	0.78	0.91	1	301.5	23.19	0.8	0.92	1	288	26.18	0.82	0.94	1
	12000	339	18.1	0.81	0.94	1	325.6	20.6	0.84	0.96	1	312.1	23.32	0.85	0.98	1	297.8	26.31	0.86	1	1
67°F	8000	326.9	18.02	0.57	0.69	0.81	312.7	20.47	0.57	0.71	0.82	299.4	23.19	0.59	0.72	0.84	284.5	26.12	0.6	0.73	0.86
	10000	337.9	18.1	0.61	0.74	0.87	324.3	20.59	0.61	0.76	0.89	309.7	23.29	0.63	0.78	0.9	294.1	26.23	0.64	0.81	0.92
	12000	347.6	18.16	0.64	0.8	0.92	332.6	20.65	0.65	0.81	0.94	318.1	23.37	0.65	0.84	0.96	303.2	26.35	0.66	0.86	0.98
71°F	8000	344.2	18.14	0.43	0.56	0.66	330.6	20.64	0.44	0.56	0.68	315.3	23.35	0.44	0.57	0.69	299.6	26.31	0.44	0.58	0.71
	10000	355.9	18.2	0.45	0.6	0.72	340.9	20.72	0.46	0.59	0.74	325.2	23.45	0.45	0.61	0.75	309.1	26.43	0.47	0.62	0.77
	12000	364.5	18.24	0.45	0.62	0.77	348.9	20.79	0.46	0.63	0.8	332.5	23.52	0.46	0.65	0.81	316.2	26.52	0.47	0.66	0.83

## 25 TON HIGH EFFICIENCY LCT302H5V (1 COMPRESSOR - PART LOAD) - VARIABLE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	2000	63.6	3.43	0.63	0.71	0.79	61.9	3.9	0.63	0.71	0.79	60	4.43	0.63	0.71	0.8	58.5	5	0.63	0.72	0.81
	2500	69	3.44	0.63	0.73	0.81	67.2	3.93	0.64	0.73	0.82	65.2	4.46	0.64	0.74	0.83	63.2	5.05	0.65	0.75	0.85
	3000	73.6	3.47	0.65	0.75	0.85	71.9	3.96	0.66	0.76	0.86	69.3	4.49	0.66	0.77	0.87	66.9	5.09	0.67	0.78	0.88
67°F	2000	66	3.44	0.53	0.59	0.67	64.3	3.91	0.53	0.6	0.67	62.5	4.44	0.53	0.6	0.68	61.3	5.03	0.53	0.6	0.68
	2500	72.1	3.45	0.53	0.61	0.69	70.3	3.96	0.53	0.61	0.7	68.2	4.49	0.53	0.62	0.71	66	5.08	0.54	0.62	0.72
	3000	77.5	3.48	0.53	0.62	0.72	74.9	3.98	0.54	0.63	0.73	72.6	4.53	0.54	0.64	0.74	70.3	5.13	0.54	0.64	0.75
71°F	2000	69	3.44	0.43	0.5	0.57	67.7	3.94	0.42	0.5	0.57	66.1	4.48	0.42	0.5	0.58	63.4	5.06	0.42	0.51	0.58
	2500	76.2	3.47	0.42	0.51	0.58	74	3.98	0.42	0.51	0.58	71.7	4.51	0.42	0.51	0.59	69.1	5.11	0.42	0.52	0.6
	3000	80.6	3.47	0.42	0.52	0.6	78.6	3.99	0.42	0.52	0.61	75.7	4.55	0.42	0.53	0.61	73.3	5.16	0.42	0.53	0.62

## 25 TON HIGH EFFICIENCY LCT302H5V (2 COMPRESSORS - PART LOAD) - VARIABLE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4000	161.9	6.75	0.69	0.81	0.92	156.9	7.79	0.7	0.82	0.94	151.4	8.89	0.7	0.83	0.96	145.7	10.1	0.72	0.85	0.98
	5000	171	6.76	0.72	0.86	0.99	165.6	7.82	0.73	0.88	1	159.6	8.94	0.74	0.89	1	153.3	10.16	0.76	0.92	1
	6000	178	6.76	0.76	0.92	1	171.9	7.83	0.77	0.94	1	165.5	8.98	0.79	0.96	1	158.8	10.21	0.81	0.98	1
67°F	4000	170	6.76	0.55	0.67	0.77	164.7	7.82	0.56	0.67	0.78	158.8	8.94	0.57	0.68	0.8	153	10.16	0.58	0.69	0.81
	5000	179.8	6.76	0.58	0.7	0.83	173.7	7.84	0.58	0.71	0.85	167.6	8.99	0.59	0.72	0.86	161	10.23	0.6	0.74	0.89
	6000	186.8	6.75	0.59	0.74	0.89	180.3	7.86	0.6	0.75	0.9	173.6	9.02	0.61	0.77	0.93	166	10.27	0.63	0.79	0.95
71°F	4000	177.6	6.76	0.44	0.54	0.65	171.8	7.83	0.44	0.55	0.65	166	8.98	0.44	0.56	0.66	159.4	10.21	0.45	0.56	0.67
	5000	187.7	6.75	0.45	0.57	0.68	182.2	7.86	0.45	0.57	0.69	175.2	9.03	0.45	0.58	0.71	168.3	10.29	0.45	0.59	0.72
	6000	195.9	6.75	0.45	0.58	0.72	189	7.87	0.45	0.59	0.73	181.4	9.06	0.45	0.6	0.75	173.5	10.33	0.46	0.62	0.77

# RATINGS

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

## 25 TON HIGH EFFICIENCY LCT302H5V (3 COMPRESSORS - PART LOAD) - VARIABLE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	6000	244.8	10.08	0.71	0.82	0.91	236.8	11.63	0.71	0.83	0.91	228.5	13.25	0.72	0.84	0.92	219.5	15.15	0.73	0.86	0.93
	7500	257	10.05	0.74	0.87	0.94	248.7	11.66	0.75	0.89	0.94	240.8	13.35	0.76	0.89	0.95	230.5	15.14	0.78	0.9	0.96
	9000	268.4	10.05	0.79	0.9	0.96	260	11.69	0.8	0.91	0.97	251.1	13.39	0.81	0.92	0.98	240.1	15.21	0.83	0.93	0.99
67°F	6000	258.3	10.05	0.57	0.68	0.79	249.8	11.63	0.57	0.69	0.8	240	13.32	0.58	0.7	0.82	230.7	15.14	0.58	0.71	0.83
	7500	271.4	10.07	0.59	0.72	0.85	261.4	11.68	0.59	0.73	0.86	251.7	13.38	0.61	0.74	0.87	240.8	15.23	0.61	0.75	0.88
	9000	280.3	10.06	0.61	0.76	0.89	269.8	11.69	0.63	0.77	0.9	258.5	13.43	0.64	0.79	0.91	248.2	15.28	0.64	0.8	0.92
71°F	6000	272.2	10.05	0.44	0.56	0.66	263.6	11.69	0.44	0.56	0.67	254	13.42	0.43	0.56	0.68	243.5	15.24	0.44	0.57	0.69
	7500	286.3	10.06	0.44	0.57	0.69	276	11.72	0.45	0.58	0.7	265.3	13.46	0.45	0.59	0.72	254	15.34	0.46	0.6	0.73
	9000	295.5	10.03	0.46	0.6	0.74	283.8	11.71	0.45	0.61	0.75	272.4	13.48	0.46	0.63	0.77	261.1	15.37	0.46	0.63	0.79

## 25 TON HIGH EFFICIENCY LCT302H5V (4 COMPRESSORS - FULL LOAD) - VARIABLE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	8000	311.7	17.95	0.72	0.83	0.93	299.5	20.37	0.73	0.85	0.95	287.3	23.02	0.74	0.86	0.96	274.4	26.02	0.75	0.88	0.98
	10000	327.7	18.04	0.77	0.89	0.99	314.6	20.51	0.78	0.91	1	301.5	23.19	0.8	0.92	1	288	26.18	0.82	0.94	1
	12000	339	18.1	0.81	0.94	1	325.6	20.6	0.84	0.96	1	312.1	23.32	0.85	0.98	1	297.8	26.31	0.86	1	1
67°F	8000	326.9	18.02	0.57	0.69	0.81	312.7	20.47	0.57	0.71	0.82	299.4	23.19	0.59	0.72	0.84	284.5	26.12	0.6	0.73	0.86
	10000	337.9	18.1	0.61	0.74	0.87	324.3	20.59	0.61	0.76	0.89	309.7	23.29	0.63	0.78	0.9	294.1	26.23	0.64	0.81	0.92
	12000	347.6	18.16	0.64	0.8	0.92	332.6	20.65	0.65	0.81	0.94	318.1	23.37	0.65	0.84	0.96	303.2	26.35	0.66	0.86	0.98
71°F	8000	344.2	18.14	0.43	0.56	0.66	330.6	20.64	0.44	0.56	0.68	315.3	23.35	0.44	0.57	0.69	299.6	26.31	0.44	0.58	0.71
	10000	355.9	18.2	0.45	0.6	0.72	340.9	20.72	0.46	0.59	0.74	325.2	23.45	0.45	0.61	0.75	309.1	26.43	0.47	0.62	0.77
	12000	364.5	18.24	0.45	0.62	0.77	348.9	20.79	0.46	0.63	0.8	332.5	23.52	0.46	0.65	0.81	316.2	26.52	0.47	0.66	0.83

## 30 TON HIGH EFFICIENCY LCT360H5M (2 COMPRESSORS OPERATING) - MSAV® MULTI-STAGE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4800	196.2	9.17	0.71	0.82	0.93	187.1	10.38	0.71	0.83	0.94	178.5	11.7	0.72	0.84	0.96	169.2	13.14	0.73	0.86	0.98
	6000	207.1	9.26	0.74	0.87	0.99	197.9	10.48	0.75	0.89	1	188.6	11.82	0.76	0.9	1	178.8	13.27	0.77	0.92	1
	7200	215.7	9.32	0.78	0.93	1	206.1	10.56	0.79	0.94	1	196	11.91	0.8	0.96	1	185.4	13.37	0.82	0.98	1
67°F	4800	206	9.25	0.57	0.68	0.79	197.4	10.48	0.57	0.69	0.8	188.4	11.81	0.57	0.7	0.81	178.9	13.28	0.58	0.7	0.83
	6000	218.6	9.35	0.59	0.72	0.85	208.5	10.58	0.6	0.73	0.86	198	11.93	0.6	0.74	0.87	188.6	13.41	0.61	0.75	0.89
	7200	227.4	9.41	0.62	0.76	0.9	216.7	10.67	0.63	0.77	0.91	205.4	12.02	0.62	0.79	0.93	195.6	13.51	0.62	0.8	0.96
71°F	4800	216.4	9.33	0.45	0.56	0.66	207.4	10.57	0.44	0.56	0.67	197.6	11.93	0.44	0.56	0.68	187.7	13.39	0.42	0.56	0.68
	6000	229.4	9.43	0.44	0.58	0.7	218.5	10.69	0.46	0.59	0.71	208.4	12.05	0.43	0.59	0.72	198	13.55	0.46	0.6	0.74
	7200	238.1	9.49	0.47	0.61	0.74	227.6	10.77	0.47	0.61	0.75	215.8	12.14	0.45	0.62	0.77	205.1	13.64	0.47	0.62	0.79

## 30 TON HIGH EFFICIENCY LCT360H5M (ALL COMPRESSORS OPERATING) - MSAV® MULTI-STAGE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	9600	383.1	24.11	0.74	0.86	0.95	363.6	27.05	0.74	0.88	0.96	344.7	30.4	0.75	0.89	0.98	323.2	33.91	0.77	0.9	0.99
	12000	404.7	24.34	0.8	0.91	1	384.7	27.35	0.81	0.93	1	362.5	30.6	0.82	0.94	1	340.6	34.21	0.84	0.96	1
	14400	420.8	24.53	0.84	0.96	1	400	27.56	0.86	0.97	1	377.5	30.85	0.87	0.99	1	353.8	34.43	0.89	1	1
67°F	9600	403.9	24.34	0.58	0.72	0.84	383.4	27.33	0.57	0.73	0.85	361.2	30.59	0.59	0.74	0.87	337.4	34.14	0.59	0.75	0.88
	12000	422	24.55	0.61	0.77	0.9	399.9	27.55	0.62	0.78	0.91	376.2	30.83	0.63	0.8	0.92	351	34.38	0.64	0.83	0.94
	14400	435	24.71	0.65	0.83	0.94	411.1	27.71	0.68	0.84	0.96	386.8	30.99	0.68	0.86	0.97	361.6	34.56	0.7	0.88	0.99
71°F	9600	429.1	24.63	0.43	0.56	0.69	407.3	27.65	0.43	0.56	0.7	383.8	30.94	0.42	0.57	0.71	358	34.49	0.44	0.58	0.73
	12000	446.7	24.84	0.45	0.6	0.75	422.5	27.87	0.44	0.61	0.77	396.8	31.15	0.45	0.62	0.79	370.8	34.71	0.45	0.64	0.81
	14400	458.2	24.98	0.47	0.65	0.81	432.7	28.02	0.48	0.66	0.83	406.2	31.29	0.48	0.67	0.85	379.8	34.86	0.49	0.7	0.86

# RATINGS

NOTE – For Temperatures and Capacities not shown in tables, see bulletin – Cooling Unit Rating Table Correction Factor Data in Miscellaneous Engineering Data section.

## 30 TON HIGH EFFICIENCY LCT360H5V (1 COMPRESSOR - PART LOAD) - VARIABLE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	2400	75.5	4.46	0.63	0.71	0.79	72	5.03	0.64	0.72	0.8	69	5.67	0.63	0.71	0.8	65.7	6.38	0.63	0.72	0.81
	3000	82.2	4.53	0.65	0.74	0.83	79.1	5.12	0.65	0.74	0.83	75.7	5.77	0.65	0.75	0.84	71.6	6.48	0.65	0.75	0.85
	3600	87.8	4.59	0.66	0.77	0.86	84.6	5.19	0.67	0.77	0.87	80.3	5.83	0.67	0.78	0.88	76.2	6.55	0.67	0.79	0.9
67°F	2400	78.6	4.49	0.54	0.6	0.68	76	5.08	0.52	0.61	0.68	72.7	5.72	0.52	0.61	0.68	68.9	6.43	0.52	0.6	0.68
	3000	86.5	4.57	0.54	0.62	0.71	83.4	5.17	0.54	0.62	0.71	79.8	5.83	0.53	0.63	0.72	75.4	6.54	0.53	0.63	0.72
	3600	92.4	4.63	0.55	0.64	0.74	89.1	5.24	0.55	0.64	0.74	84.2	5.88	0.55	0.65	0.75	80.6	6.62	0.55	0.65	0.76
71°F	2400	82.7	4.53	0.43	0.51	0.58	79.4	5.12	0.42	0.51	0.58	75.6	5.76	0.41	0.5	0.58	72.7	6.49	0.41	0.5	0.58
	3000	90.3	4.61	0.42	0.53	0.6	86.7	5.21	0.42	0.52	0.6	83.1	5.86	0.42	0.52	0.61	79.2	6.59	0.42	0.52	0.61
	3600	96.6	4.67	0.44	0.54	0.62	93.1	5.28	0.42	0.53	0.62	88.8	5.95	0.41	0.53	0.63	84.7	6.68	0.41	0.53	0.63

## 30 TON HIGH EFFICIENCY LCT360H5V (2 COMPRESSORS - PART LOAD) - VARIABLE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4800	196.2	9.17	0.71	0.82	0.93	187.1	10.38	0.71	0.83	0.94	178.5	11.7	0.72	0.84	0.96	169.2	13.14	0.73	0.86	0.98
	6000	207.1	9.26	0.74	0.87	0.99	197.9	10.48	0.75	0.89	1	188.6	11.82	0.76	0.9	1	178.8	13.27	0.77	0.92	1
	7200	215.7	9.32	0.78	0.93	1	206.1	10.56	0.79	0.94	1	196	11.91	0.8	0.96	1	185.4	13.37	0.82	0.98	1
67°F	4800	206	9.25	0.57	0.68	0.79	197.4	10.48	0.57	0.69	0.8	188.4	11.81	0.57	0.7	0.81	178.9	13.28	0.58	0.7	0.83
	6000	218.6	9.35	0.59	0.72	0.85	208.5	10.58	0.6	0.73	0.86	198	11.93	0.6	0.74	0.87	188.6	13.41	0.61	0.75	0.89
	7200	227.4	9.41	0.62	0.76	0.9	216.7	10.67	0.63	0.77	0.91	205.4	12.02	0.62	0.79	0.93	195.6	13.51	0.62	0.8	0.96
71°F	4800	216.4	9.33	0.45	0.56	0.66	207.4	10.57	0.44	0.56	0.67	197.6	11.93	0.44	0.56	0.68	187.7	13.39	0.42	0.56	0.68
	6000	229.4	9.43	0.44	0.58	0.7	218.5	10.69	0.46	0.59	0.71	208.4	12.05	0.43	0.59	0.72	198	13.55	0.46	0.6	0.74
	7200	238.1	9.49	0.47	0.61	0.74	227.6	10.77	0.47	0.61	0.75	215.8	12.14	0.45	0.62	0.77	205.1	13.64	0.47	0.62	0.79

## 30 TON HIGH EFFICIENCY LCT360H5V (4 COMPRESSORS - PART LOAD) - VARIABLE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	7200	309.2	14.07	0.74	0.85	0.93	296.4	15.94	0.75	0.86	0.93	282.9	17.98	0.75	0.87	0.94	267	20.16	0.76	0.88	0.94
	9000	325.7	14.22	0.78	0.89	0.95	311.6	16.1	0.79	0.9	0.96	296.8	18.17	0.79	0.92	0.96	282.1	20.38	0.8	0.92	0.97
	10800	338.8	14.33	0.81	0.93	0.98	324.3	16.23	0.82	0.93	0.98	309.7	18.32	0.83	0.94	0.99	294.4	20.57	0.84	0.95	1
67°F	7200	327.3	14.23	0.6	0.72	0.82	313.7	16.12	0.6	0.72	0.83	298.8	18.19	0.59	0.73	0.84	283.7	20.41	0.59	0.74	0.85
	9000	343.8	14.37	0.63	0.75	0.87	327.9	16.27	0.62	0.77	0.88	312.3	18.35	0.62	0.78	0.89	296.1	20.6	0.63	0.79	0.9
	10800	354.9	14.47	0.64	0.8	0.91	339	16.4	0.64	0.81	0.92	322.9	18.5	0.65	0.82	0.93	305.6	20.74	0.66	0.83	0.94
71°F	7200	345.2	14.39	0.47	0.58	0.69	330.5	16.29	0.46	0.57	0.7	315.5	18.4	0.44	0.57	0.71	299.6	20.65	0.43	0.58	0.71
	9000	363	14.54	0.46	0.6	0.73	346.9	16.49	0.45	0.61	0.75	330.6	18.59	0.45	0.6	0.76	313.2	20.85	0.44	0.61	0.77
	10800	374.7	14.63	0.47	0.62	0.78	357.9	16.6	0.46	0.63	0.79	340.7	18.72	0.46	0.64	0.8	322.7	21	0.46	0.65	0.81

## 30 TON HIGH EFFICIENCY LCT360H5V (4 COMPRESSORS - FULL LOAD) - VARIABLE AIR VOLUME

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		85°F					95°F					105°F					115°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	9600	383.1	24.11	0.74	0.86	0.95	363.6	27.05	0.74	0.88	0.96	344.7	30.4	0.75	0.89	0.98	323.2	33.91	0.77	0.9	0.99
	12000	404.7	24.34	0.8	0.91	1	384.7	27.35	0.81	0.93	1	362.5	30.6	0.82	0.94	1	340.6	34.21	0.84	0.96	1
	14400	420.8	24.53	0.84	0.96	1	400	27.56	0.86	0.97	1	377.5	30.85	0.87	0.99	1	353.8	34.43	0.89	1	1
67°F	9600	403.9	24.34	0.58	0.72	0.84	383.4	27.33	0.57	0.73	0.85	361.2	30.59	0.59	0.74	0.87	337.4	34.14	0.59	0.75	0.88
	12000	422	24.55	0.61	0.77	0.9	399.9	27.55	0.62	0.78	0.91	376.2	30.83	0.63	0.8	0.92	351	34.38	0.64	0.83	0.94
	14400	435	24.71	0.65	0.83	0.94	411.1	27.71	0.68	0.84	0.96	386.8	30.99	0.68	0.86	0.97	361.6	34.56	0.7	0.88	0.99
71°F	9600	429.1	24.63	0.43	0.56	0.69	407.3	27.65	0.43	0.56	0.7	383.8	30.94	0.42	0.57	0.71	358	34.49	0.44	0.58	0.73
	12000	446.7	24.84	0.45	0.6	0.75	422.5	27.87	0.44	0.61	0.77	396.8	31.15	0.45	0.62	0.79	370.8	34.71	0.45	0.64	0.81
	14400	458.2	24.98	0.47	0.65	0.81	432.7	28.02	0.48	0.66	0.83	406.2	31.29	0.48	0.67	0.85	379.8	34.86	0.49	0.7	0.86

# HUMIDITROL® DEHUMIDIFICATION SYSTEM RATINGS

## 25 TON HIGH EFFICIENCY LCT302H5M WITH HUMIDITROL® OPERATING (PART LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4000	78.6	8.24	0.48	0.72	0.94	57.1	8.89	0.37	0.71	1.00	35.4	9.59	0.12	0.69	1.00	13.6	10.40	-1.15	0.62	1.00
	5000	90.9	8.28	0.57	0.82	1.00	67.7	8.95	0.51	0.85	1.00	44.3	9.69	0.38	0.91	1.00	20.8	10.50	-0.12	1.00	1.00
	6000	100.5	8.31	0.65	0.91	1.00	75.7	9.00	0.62	0.97	1.00	50.8	9.75	0.56	1.00	1.00	25.9	10.58	0.33	1.00	1.00
67°F	4000	92.6	8.31	0.25	0.48	0.68	71.1	8.98	0.10	0.41	0.67	49.3	9.71	-0.17	0.27	0.64	27.4	10.53	-0.97	-0.10	0.59
	5000	105.8	8.33	0.32	0.57	0.78	82.5	9.02	0.21	0.53	0.79	59.0	9.78	0.00	0.44	0.81	35.1	10.62	-0.54	0.25	0.87
	6000	115.8	8.33	0.39	0.65	0.86	90.9	9.06	0.29	0.62	0.89	65.6	9.83	0.12	0.58	0.95	40.1	10.69	-0.30	0.48	1.00
71°F	4000	106.6	8.37	0.10	0.30	0.48	84.7	9.06	-0.07	0.20	0.43	63.0	9.82	-0.35	0.02	0.33	42.4	10.66	-0.95	-0.35	0.15
	5000	121.8	8.38	0.17	0.36	0.57	98.4	9.10	0.02	0.27	0.53	74.5	9.88	-0.23	0.14	0.48	50.1	10.73	-0.73	-0.13	0.37
	6000	131.7	8.37	0.19	0.42	0.63	106.9	9.11	0.06	0.35	0.62	81.4	9.91	-0.16	0.23	0.58	55.5	10.79	-0.61	0.02	0.53

## 25 TON HIGH EFFICIENCY LCT302H5M WITH HUMIDITROL® OPERATING (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	8000	235.5	14.49	0.58	0.75	0.89	203.2	16.18	0.56	0.76	0.91	168.4	18.08	0.53	0.77	0.95	135.0	20.16	0.49	0.79	1.00
	10,000	259.7	14.51	0.66	0.83	0.96	224.1	16.29	0.66	0.85	0.99	187.5	18.22	0.65	0.87	1.00	149.9	20.33	0.65	0.91	1.00
	12,000	276.6	14.57	0.73	0.89	1.00	240.3	16.37	0.73	0.91	1.00	201.8	18.32	0.73	0.95	1.00	163.7	20.42	0.75	1.00	1.00
67°F	8000	263.6	14.54	0.40	0.57	0.72	229.4	16.32	0.36	0.54	0.72	192.5	18.27	0.32	0.52	0.73	157.2	20.34	0.22	0.51	0.75
	10,000	282.2	14.59	0.46	0.64	0.80	244.1	16.40	0.43	0.63	0.82	206.7	18.35	0.39	0.63	0.83	167.2	20.51	0.33	0.62	0.86
	12,000	295.3	14.63	0.50	0.70	0.86	256.8	16.47	0.47	0.72	0.88	217.1	18.43	0.43	0.72	0.91	176.4	20.57	0.38	0.74	0.95
71°F	8000	293.3	14.63	0.25	0.41	0.55	258.3	16.44	0.20	0.36	0.54	221.3	18.40	0.13	0.32	0.51	183.5	20.54	0.03	0.27	0.49
	10,000	310.9	14.65	0.29	0.46	0.62	272.6	16.52	0.24	0.44	0.62	233.5	18.51	0.18	0.40	0.61	194.4	20.66	0.08	0.36	0.62
	12,000	323.4	14.67	0.33	0.51	0.69	283.6	16.59	0.27	0.48	0.69	242.5	18.59	0.21	0.46	0.70	202.5	20.77	0.09	0.43	0.70

## 30 TON HIGH EFFICIENCY LCT360H5M WITH HUMIDITROL® OPERATING (PART LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	4800	88.3	11.38	0.42	0.68	0.92	64.3	12.09	0.29	0.64	0.97	41.7	12.87	0.01	0.58	1.00	19.3	13.80	-1.06	0.37	1.00
	6000	99.7	11.61	0.53	0.80	1.00	74.4	12.31	0.44	0.82	1.00	49.0	13.15	0.27	0.84	1.00	25.2	14.08	-0.27	0.93	1.00
	7200	108.1	11.78	0.62	0.91	1.00	81.8	12.49	0.57	0.96	1.00	54.7	13.33	0.46	1.00	1.00	28.4	14.32	0.17	1.00	1.00
67°F	4800	103.7	11.63	0.21	0.44	0.65	80.0	12.34	0.04	0.34	0.62	56.1	13.19	-0.27	0.17	0.57	33.9	14.12	-1.06	-0.21	0.46
	6000	115.6	11.86	0.29	0.53	0.76	90.7	12.57	0.16	0.47	0.77	65.1	13.42	-0.11	0.36	0.77	38.8	14.42	-0.71	0.12	0.80
	7200	124.3	12.03	0.35	0.62	0.87	98.3	12.74	0.24	0.58	0.89	71.0	13.61	0.03	0.52	0.95	43.1	14.64	-0.47	0.37	1.00
71°F	4800	117.9	11.88	0.04	0.25	0.45	94.6	12.60	-0.14	0.13	0.37	70.5	13.45	-0.47	-0.07	0.26	46.7	14.43	-1.10	-0.48	0.04
	6000	130.8	12.10	0.10	0.33	0.53	105.4	12.82	-0.06	0.23	0.48	79.5	13.69	-0.34	0.07	0.41	52.9	14.74	-0.92	-0.27	0.27
	7200	139.8	12.26	0.15	0.39	0.61	113.0	13.00	-0.01	0.30	0.58	85.7	13.88	-0.25	0.17	0.54	56.9	14.94	-0.78	-0.10	0.46

## 30 TON HIGH EFFICIENCY LCT360H5M WITH HUMIDITROL® OPERATING (FULL LOAD)

Entering Wet Bulb Temperature	Total Air Volume	Outdoor Air Temperature Entering Outdoor Coil																			
		65°F					75°F					85°F					95°F				
		Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)			Total Cool Cap.	Comp. Motor Input	Sensible To Total Ratio (S/T)		
				Dry Bulb					Dry Bulb					Dry Bulb					Dry Bulb		
cfm	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	kBtuh	kW	75°F	80°F	85°F	
63°F	9600	264.2	20.32	0.58	0.77	0.91	218.5	22.08	0.57	0.80	0.96	172.7	24.09	0.56	0.84	1.00	127.1	26.40	0.54	0.90	1.00
	12,000	292.4	20.63	0.66	0.84	0.98	244.6	22.41	0.66	0.88	1.00	196.1	24.50	0.69	0.93	1.00	148.0	26.82	0.70	1.00	1.00
	14,400	314.3	20.86	0.73	0.91	1.00	263.8	22.69	0.74	0.96	1.00	213.3	24.80	0.77	1.00	1.00	163.1	27.13	0.84	1.00	1.00
67°F	9600	298.0	20.66	0.40	0.56	0.73	251.2	22.44	0.35	0.56	0.75	203.8	24.52	0.29	0.54	0.78	156.4	26.86	0.20	0.53	0.83
	12,000	322.1	20.93	0.45	0.64	0.81	272.0	22.76	0.42	0.64	0.84	222.0	24.88	0.38	0.65	0.88	171.4	27.20	0.30	0.67	0.94
	14,400	339.4	21.14	0.49	0.71	0.87	287.9	23.00	0.46	0.72	0.91	235.8	25.16	0.44	0.74	0.97	184.2	27.48	0.39	0.78	1.00
71°F	9600	334.8	21.01	0.24	0.40	0.55	287.0	22.87	0.18	0.36	0.53	239.4	25.02	0.10	0.32	0.53	190.3	27.35	-0.01	0.26	0.50
	12,000	358.8	21.28	0.27	0.45	0.61	308.3	23.16	0.23	0.44	0.62	256.9	25.36	0.14	0.39	0.64	206.3	27.69	0.04	0.34	0.64
	14,400	376.3	21.47	0.30	0.49	0.69	324.8	23.39	0.25	0.47	0.70	270.0	25.57	0.18	0.46	0.72	216.5	27.94	0.08	0.43	0.73

## BLOWER DATA

BLOWER TABLE INCLUDES RESISTANCE FOR BASE UNIT ONLY WITH DRY INDOOR COIL & AIR FILTERS IN PLACE FOR ALL UNITS ADD:

- 1 - Wet indoor coil air resistance of selected unit.
- 2 - Any factory installed options air resistance (electric heat, economizer, etc.)
- 3 - Any field installed accessories air resistance (electric heat, duct resistance, diffuser, etc.)

Then determine from blower table blower motor output and drive required.

See page 34 for wet coil and option/accessory air resistance data.

See page 34 for factory installed drive kit specifications.

### MINIMUM AIR VOLUME REQUIRED FOR USE WITH OPTIONAL ELECTRIC HEAT

All units require 10,500 cfm minimum air with electric heat.

Air Volume cfm	TOTAL STATIC PRESSURE - In. w.g.																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																						
	0.20		0.40		0.60		0.80		1.00		1.20		1.40		1.60		1.80		2.00		2.20		2.40		2.60																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																														
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
4000	372	0.26	433	0.65	497	0.99	565	1.27	630	1.54	687	1.79	738	2.04	784	2.30	824	2.56	861	2.82	897	3.10	932	3.40	968	3.68	1004	3.96	1040	4.24	1076	4.52	1112	4.80	1148	5.08	1184	5.36	1220	5.64	1256	5.92	1292	6.20	1328	6.48	1364	6.76	1400	7.04	1436	7.32	1472	7.60	1508	7.88	1544	8.16	1580	8.44	1616	8.72	1652	9.00	1688	9.28	1724	9.56	1760	9.84	1796	10.12	1832	10.40	1868	10.68	1904	10.96	1940	11.24	1976	11.52	2012	11.80	2048	12.08	2084	12.36	2120	12.64	2156	12.92	2232	13.52	2296	14.16	2360	14.80	2424	15.44	2488	16.08	2552	16.72	2616	17.36	2680	18.00	2744	18.64	2808	19.28	2872	19.92	2936	20.56	3000	21.20	3064	21.84	3128	22.48	3192	23.12	3256	23.76	3320	24.40	3384	25.04	3448	25.68	3512	26.32	3576	26.96	3640	27.60	3704	28.24	3768	28.88	3832	29.52	3896	30.16	3960	30.80	4024	31.44	4088	32.08	4152	32.72	4216	33.36	4280	34.00	4344	34.64	4408	35.28	4472	35.92	4536	36.56	4600	37.20	4664	37.84	4728	38.48	4792	39.12	4856	39.76	4920	40.40	4984	41.04	5048	41.68	5112	42.32	5176	42.96	5240	43.60	5304	44.24	5368	44.88	5432	45.52	5496	46.16	5560	46.80	5624	47.44	5688	48.08	5752	48.72	5816	49.36	5880	50.00	5944	50.64	6008	51.28	6072	51.92	6136	52.56	6200	53.20	6264	53.84	6328	54.48	6392	55.12	6456	55.76	6520	56.40	6584	57.04	6648	57.68	6712	58.32	6776	58.96	6840	59.60	6904	60.24	6968	60.88	7032	61.52	7096	62.16	7160	62.80	7224	63.44	7288	64.08	7352	64.72	7416	65.36	7480	66.00	7544	66.64	7608	67.28	7672	67.92	7736	68.56	7800	69.20	7864	69.84	7928	70.48	7992	71.12	8056	71.76	8120	72.40	8184	73.04	8248	73.68	8312	74.32	8376	74.96	8440	75.60	8504	76.24	8568	76.88	8632	77.52	8696	78.16	8760	78.80	8824	79.44	8888	80.08	8952	80.72	9016	81.36	9080	82.00	9144	82.64	9208	83.28	9272	83.92	9336	84.56	9400	85.20	9464	85.84	9528	86.48	9592	87.12	9656	87.76	9720	88.40	9784	89.04	9848	89.68	9912	90.32	9976	90.96	10040	91.60	10104	92.24	10168	92.88	10232	93.52	10296	94.16	10360	94.80	10424	95.44	10488	96.08	10552	96.72	10616	97.36	10680	98.00	10744	98.64	10808	99.28	10872	99.92	10936	100.56	11000	101.20	11064	101.84	11128	102.48	11192	103.12	11256	103.76	11320	104.40	11384	105.04	11448	105.68	11512	106.32	11576	106.96	11640	107.60	11704	108.24	11768	108.88	11832	109.52	11896	110.16	11960	110.80	12024	111.44	12088	112.08	12152	112.72	12216	113.36	12280	114.00	12344	114.64	12408	115.28	12472	115.92	12536	116.56	12600	117.20	12664	117.84	12728	118.48	12792	119.12	12856	119.76	12920	120.40	12984	121.04	13048	121.68	13112	122.32	13176	122.96	13240	123.60	13304	124.24	13368	124.88	13432	125.52	13496	126.16	13560	126.80	13624	127.44	13688	128.08	13752	128.72	13816	129.36	13880	130.00	13944	130.64	14008	131.28	14072	131.92	14136	132.56	14200	133.20	14264	133.84	14328	134.48	14392	135.12	14456	135.76	14520	136.40	14584	137.04	14648	137.68	14712	138.32	14776	138.96	14840	139.60	14904	140.24	14968	140.88	15032	141.52	15096	142.16	15160	142.80	15224	143.44	15288	144.08	15352	144.72	15416	145.36	15480	146.00	15544	146.64	15608	147.28	15672	147.92	15736	148.56	15800	149.20	15864	149.84	15928	150.48	16000	151.12	16064	151.76	16128	152.40	16192	153.04	16256	153.68	16320	154.32	16384	154.96	16448	155.60	16512	156.24	16576	156.88	16640	157.52	16704	158.16	16768	158.80	16832	159.44	16896	160.08	16960	160.72	17024	161.36	17088	162.00	17152	162.64	17216	163.28	17280	163.92	17344	164.56	17408	165.20	17472	165.84	17536	166.48	17600	167.12	17664	167.76	17728	168.40	17792	169.04	17856	169.68	17920	170.32	17984	170.96	18048	171.60	18112	172.24	18176	172.88	18240	173.52	18304	174.16	18368	174.80	18432	175.44	18496	176.08	18560	176.72	18624	177.36	18688	178.00	18752	178.64	18816	179.28	18880	179.92	18944	180.56	19008	181.20	19072	181.84	19136	182.48	19200	183.12	19264	183.76	19328	184.40	19400	185.04	19464	185.68	19528	186.32	19600	186.96	19664	187.60	19728	188.24	19792	188.88	19856	189.52	19920	190.16	19984	190.80	20048	191.44	20112	192.08	20176	192.72	20240	193.36	20304	194.00	20368	194.64	20432	195.28	20496	195.92	20560	196.56	20624	197.20	20688	197.84	20752	198.48	20816	199.12	20880	199.76	20944	200.40	21008	201.04	21072	201.68	21136	202.32	21200	202.96	21264	203.60	21328	204.24	21392	204.88	21456	205.52	21520	206.16	21584	206.80	21648	207.44	21712	208.08	21776	208.72	21840	209.36	21904	210.00	21968	210.64	22032	211.28	22096	211.92	22160	212.56	22224	213.20	22288	213.84	22352	214.48	22416	215.12	22480	215.76	22544	216.40	22608	217.04	22672	217.68	22736	218.32	22800	218.96	22864	219.60	22928	220.24	22992	220.88	23056	221.52	23120	222.16	23184	222.80	23248	223.44	23312	224.08	23376	224.72	23440	225.36	23504	226.00	23568	226.64	23632	227.28	23696	227.92	23760	228.56	23824	229.20	23888	229.84	23952	230.48	24016	231.12	24080	231.76	24144	232.40	24208	233.04	24272	233.68	24336	234.32	24400	234.96	24464	235.60	24528	236.24	24592	236.88	24656	237.52	24720	238.16	24784	238.80	24848	239.44	24912	240.08	24976	240.72	25040	241.36	25104	242.00	25168	242.64	25232	243.28	25296	243.92	25360	244.56	25424	245.20	25488	245.84	25552	246.48	25616	247.12	25680	247.76	25744	248.40	25808	249.04	25872	249.68	25936	250.32	26000	250.96	26064	251.60	26128	252.24	26192	252.88	26256	253.52	26320	254.16	26384	254.80	26448	255.44	26512	256.08	26576	256.72	26640	257.36	26704	258.00	26768	258.64	26832	259.28	26896	259.92	26960	260.56	27024	261.20	27088	261.84	27152	262.48	27216	263.12	27280	263.76	27344	264.40	27408	265.04	27472	265.68	27536	266.32	27600	266.96	27664	267.60	27728	268.24	27792	268.88	27856	269.52	27920	270.16	27984	270.80	28048	271.44	28112	272.08	28176	272.72	28240	273.36	28304	274.00	28368	274.64	28432	275.28	28496	275.92	28560	276.56	28624	277.20	28688	277.84	28752	278.48	28816	279.12	28880	279.76	28944	280.40	29008	281.04	29072	281.68	29136	282.32	29200	282.96	29264	283.60	29328	284.24	29392	284.88	29456	285.52	29520	286.16	29584	286.80	29648	287.44	29712	288.08	29776	288.72	29840	289.36	29904	290.00	29968	290.64	30032	291.28	30096	291.92	30160	292.56	30224	293.20	30288	293.84	30352	294.48	30416	295.12	30480	295.76	30544	296.40	30608	297.04	30672	297.68	30736	298.32	30800	298.96	30864	299.60	30928	300.24	30992	300.88	31056	301.52	31120	302.16	31184	302.80	31248	303.44	31312	304.08	31376	304.72	31440	305.36	31504	306.00	31568	306.64	31632	307.28	31696	307.92	31760	308.56	31824	309.20	31888	309.84	31952	310.48	32016	311.12	32080	311.76	32144	312.40	32208	313.04	32272	313.68	32336	314.32	32400	314.96	32464	315.60	32528	316.24	32592	316.88	32656	317.52	32720	318.16	32784	318.80	32848	319.44	32912	320.08	32976	320.72	33040	321.36	33104	322.00	33168	322.64	33232	323.28	33296	323.92	33360	324.56	33424	325.20	33488	325.84	33552	326.48	33616	327.12	33680	327.76	33744	328.40	33808	329.04	33872	329.68	33936	330.32	34000	330.96	34064	331.60	34128	332.24	34192	332.88	34256	333.52	34320	334.16	34384	334.80	34448	335.44	34512	336.08	34576	336.72	34640	337.36	34704	338.00	34768	338.64	34832	339.28	34896	339.92	34960	340.56	35024	341.20	35088	341.84	35152	342.48	35216	343.12	35280	343.76	

## BLOWER DATA

### DRIVE KIT SPECIFICATIONS

Motor Efficiency	Nominal HP	Maximum HP	Drive Kit Number	RPM Range
Standard	5	5.75	5	660 - 810
Standard	5	5.75	6	770 - 965
Standard	5	5.75	7	570 - 720
Standard	5	5.75	8	480 - 630
Standard	5	5.75	9	410 - 535
Standard	7.5	8.63	3	715 - 880
Standard	7.5	8.63	4	770 - 965
Standard	10	11.50	1	740 - 895
Standard	10	11.50	2	870 - 1045

#### NOTES

Using total air volume and system static pressure requirements determine from blower performance tables rpm and motor output required. Maximum usable output of motors furnished are shown. In Canada, nominal motor output is also maximum usable motor output. If motors of comparable output are used, be sure to keep within the service factor limitations outlined on the motor nameplate.

For VFD applications, nominal motor output is also maximum usable motor output.

### FACTORY INSTALLED OPTIONS/FIELD INSTALLED ACCESSORY AIR RESISTANCE

Air Volume cfm	Wet Indoor Coil in. w.g.	Reheat Coil in. w.g.	Electric Heat in. w.g.	Economizer in. w.g.	Filters			Horizontal Roof Curb in. w.g.
					MERV 8	MERV 13	MERV 16	
					in. w.g.	in. w.g.	in. w.g.	
4000	0.04	0.04	0.01	0.00	0.00	0.00	0.06	0.04
4500	0.04	0.04	0.01	0.00	0.00	0.00	0.07	0.05
5000	0.05	0.04	0.01	0.00	0.00	0.00	0.08	0.06
5500	0.06	0.06	0.02	0.01	0.00	0.01	0.09	0.07
6000	0.07	0.06	0.02	0.01	0.00	0.02	0.10	0.08
6500	0.08	0.08	0.02	0.01	0.01	0.02	0.11	0.09
7000	0.09	0.08	0.03	0.02	0.01	0.03	0.12	0.10
7500	0.10	0.10	0.03	0.02	0.01	0.04	0.13	0.11
8000	0.11	0.10	0.03	0.02	0.01	0.04	0.14	0.13
8500	0.12	0.10	0.04	0.03	0.01	0.04	0.15	0.15
9000	0.13	0.12	0.04	0.04	0.01	0.04	0.16	0.17
9500	0.14	0.14	0.05	0.04	0.02	0.06	0.17	0.19
10,000	0.15	0.16	0.05	0.05	0.02	0.06	0.18	0.21
10,500	0.16	0.17	0.06	0.06	0.02	0.06	0.19	0.24
11,000	0.18	0.18	0.06	0.07	0.02	0.07	0.20	0.27
11,500	0.19	0.19	0.07	0.08	0.02	0.08	0.22	0.30
12,000	0.20	0.20	0.07	0.10	0.02	0.08	0.23	0.33
12,500	0.21	0.22	0.08	0.11	0.03	0.10	0.24	0.37
13,000	0.23	0.23	0.08	0.13	0.03	0.10	0.25	0.40
13,500	0.24	0.25	0.09	0.14	0.03	0.11	0.26	0.44
14,000	0.26	0.26	0.10	0.16	0.03	0.12	0.27	0.49
14,500	0.27	0.27	0.10	0.18	0.04	0.13	0.28	0.53
15,000	0.29	0.29	0.11	0.21	0.04	0.13	0.29	0.58

## BLOWER DATA

### POWER EXHAUST PERFORMANCE - STANDARD STATIC

Return Duct Negative Static Pressure	Air Volume Exhausted
in. w.g.	cfm
0.00	12,800
0.05	12,200
0.10	11,500
0.15	10,800
0.20	9900
0.25	9000
0.30	7900
0.35	6750
0.40	5450
0.45	4150
0.50	2900

### POWER EXHAUST - HIGH STATIC

Air Volume cfm	Return Duct Negative Static Pressure - In. w.g.																					
	0		0.10		0.20		0.30		0.40		0.50		0.60		0.70		0.80		0.90		1.0	
	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP	RPM	BHP
8500	487	0.43	501	0.44	521	0.46	548	0.49	584	0.53	625	0.58	667	0.64	708	0.70	746	0.75	783	0.81	818	0.87
9000	515	0.51	528	0.52	547	0.54	570	0.57	601	0.61	638	0.66	678	0.71	717	0.77	755	0.83	791	0.90	826	0.96
9500	544	0.60	556	0.61	573	0.63	594	0.66	620	0.69	652	0.74	689	0.80	727	0.86	765	0.93	800	0.99	834	1.05
10,000	572	0.70	584	0.71	599	0.73	618	0.76	641	0.79	669	0.83	702	0.89	738	0.95	774	1.02	810	1.09	843	1.15
10,500	601	0.81	612	0.82	626	0.84	643	0.87	663	0.90	688	0.94	718	0.99	750	1.05	785	1.12	819	1.19	853	1.27
11,000	629	0.93	640	0.95	653	0.97	668	0.99	687	1.02	709	1.06	735	1.11	764	1.16	796	1.23	830	1.31	862	1.38
11,500	658	1.06	668	1.08	680	1.10	694	1.12	711	1.15	731	1.19	754	1.24	780	1.29	810	1.36	841	1.43	872	1.50
12,000	686	1.21	696	1.22	707	1.24	721	1.27	736	1.30	754	1.34	774	1.38	798	1.43	825	1.49	853	1.56	883	1.64

## BLOWER DATA

### CEILING DIFFUSER AIR RESISTANCE - in. w.g.

Air Volume cfm	Step-Down Diffuser			Flush Diffuser
	LARTD30/36S			LAFD30/36S
	2 Ends Open	1 Side/2 Ends Open	All Ends & Sides Open	
7500	0.37	0.31	0.25	0.29
8000	0.42	0.36	0.29	0.34
8500	0.48	0.41	0.34	0.39
9000	0.55	0.47	0.39	0.44
9500	0.62	0.53	0.45	0.51
10,000	0.70	0.60	0.51	0.57
10,500	0.78	0.68	0.58	0.65
11,000	0.87	0.76	0.65	0.72
11,500	0.97	0.85	0.73	0.81
12,000	1.08	0.94	0.82	0.9
12,500	1.19	1.04	0.91	0.99
13,000	1.30	1.15	1.00	1.10
13,500	1.43	1.26	1.10	1.20
14,000	1.56	1.38	1.20	1.31
14,500	1.69	1.50	1.31	1.43
15,000	1.84	1.63	1.43	1.56

### CEILING DIFFUSER AIR THROW DATA - ft.

Air Volume cfm	<sup>1</sup> Effective Throw Range - ft.	
	Step-Down	Flush
9000	40 - 47	29 - 35
9500	43 - 50	33 - 41
10,000	46 - 54	37 - 46
10,500	50 - 58	42 - 51
11,000	53 - 61	46 - 56
11,500	55 - 64	50 - 61
12,000	58 - 67	54 - 66
12,500	61 - 71	58 - 71
13,000	64 - 74	62 - 75
13,500	67 - 77	66 - 79

<sup>1</sup> Throw is the horizontal or vertical distance an airstream travels on leaving the outlet or diffuser before the maximum velocity is reduced to 50 ft. per minute. Four sides open.

**ELECTRICAL DATA**

**25 TON**

Model		LCT302H5M, LCT302H5V								
		208/230V - 3 Ph			460V - 3 Ph			575V - 3 Ph		
<sup>1</sup> Voltage - 60Hz										
Compressor 1 (Non-Inverter)	Rated Load Amps	22.4			9.1			7.2		
	Locked Rotor Amps	166			74.6			54		
Compressor 2 (Non-Inverter)	Rated Load Amps	22.4			9.1			7.2		
	Locked Rotor Amps	166			74.6			54		
Compressor 3 (Non-Inverter)	Rated Load Amps	22.4			9.1			7.2		
	Locked Rotor Amps	166			74.6			54		
Compressor 4 (Non-Inverter)	Rated Load Amps	22.4			9.1			7.2		
	Locked Rotor Amps	166			74.6			54		
Outdoor Fan Motors (6)	Full Load Amps (6 Non-ECM)	2.4			1.3			1		
	Total	14.4			7.8			6		
Standard Power Exhaust (3) 0.33 HP	Full Load Amps	2.4			1.3			1		
	Total	7.2			3.9			3		
High Static Power Exhaust (3) 2 HP	Full Load Amps	7.5			3.4			2.7		
	Total	22.5			10.2			8.1		
Service Outlet 115V GFI (amps)		15			15			20		
Indoor Blower Motor	HP	5	7.5	10	5	7.5	10	5	7.5	10
	Full Load Amps	16.7	24.2	30.8	7.6	11	14	6.1	9	11
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit Only	150	150	150	60	60	70	45	50	50
	With (3) 0.33 HP Standard Power Exhaust	150	150	175	60	70	70	50	50	60
	With High Static Power Exhaust (3) 2 HP	150	175	175	70	70	80	60	60	60
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit Only	127	135	143	55	58	62	43	47	49
	With (3) 0.33 HP Standard Power Exhaust	134	142	150	58	62	66	46	50	52
	With High Static Power Exhaust (3) 2 HP	149	157	165	65	69	72	51	55	57

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

**ELECTRIC HEAT DATA**

**25 TON**

Model			LCT302H5M, LCT302H5V											
<sup>1</sup> Voltage - 60Hz			208/230V - 3 Ph						460V - 3 Ph			575V - 3 Ph		
Indoor Blower Motor - HP			5		7.5		10		5	7.5	10	5	7.5	10
Electric Heat Voltage			208V	240V	208V	240V	208V	240V	480V	480V	480V	600V	600V	600V
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit+ Electric Heat	30 kW	150	150	150	150	150	150	60	70	60	45	50	50
		45 kW	<sup>4</sup> 150	175	<sup>4</sup> 150	175	175	175	90	90	80	70	70	70
		60 kW	<sup>4</sup> 150	175	175	175	<sup>4</sup> 175	200	90	90	90	70	70	80
		90 kW	<sup>4</sup> 225	250	<sup>4</sup> 225	250	<sup>4</sup> 250	<sup>4</sup> 300	125	150	125	100	100	110
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit+ Electric Heat	30 kW	127	127	135	135	143	143	59	63	55	44	48	50
		45 kW	139	157	148	166	156	174	82	86	78	62	66	68
		60 kW	146	166	156	175	164	183	86	90	82	66	69	72
		90 kW	209	238	218	247	227	256	123	126	118	95	98	101
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit+ Electric Heat and Standard Power Exhaust (3) 0.33 HP	30 kW	150	150	150	150	175	175	70	70	60	50	60	60
		45 kW	<sup>4</sup> 150	175	175	175	<sup>4</sup> 175	200	90	100	90	70	70	80
		60 kW	175	175	<sup>4</sup> 175	200	<sup>4</sup> 175	200	100	100	90	70	80	80
		90 kW	<sup>4</sup> 225	250	<sup>4</sup> 250	<sup>4</sup> 300	<sup>4</sup> 250	<sup>4</sup> 300	150	150	125	100	110	110
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit+ Electric Heat and Standard Power Exhaust (3) 0.33 HP	30 kW	134	134	142	142	150	150	64	68	60	48	52	54
		45 kW	148	166	157	175	165	183	87	91	83	66	70	72
		60 kW	155	175	165	184	173	192	91	95	87	70	73	76
		90 kW	218	247	227	256	236	265	127	131	123	98	102	105
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit+ Electric Heat and High Static Power Exhaust (3) 2 HP	30 kW	150	150	175	175	175	175	70	80	80	60	60	60
		45 kW	<sup>4</sup> 175	200	200	200	<sup>4</sup> 200	225	90	100	100	80	80	80
		60 kW	<sup>4</sup> 175	200	<sup>4</sup> 200	225	<sup>4</sup> 200	225	100	100	110	80	80	90
		90 kW	<sup>4</sup> 250	<sup>4</sup> 300	<sup>4</sup> 250	<sup>4</sup> 300	300	<sup>4</sup> 300	150	150	150	110	110	125
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit+ Electric Heat and High Static Power Exhaust (3) 2 HP	30 kW	149	149	157	157	165	165	68	72	76	54	58	60
		45 kW	167	185	176	194	184	202	90	95	98	72	76	79
		60 kW	175	194	184	203	192	211	95	99	103	76	80	82
		90 kW	237	266	247	275	255	284	131	135	139	105	108	111

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

<sup>4</sup> Factory installed circuit breaker not available.

**ELECTRICAL DATA**

**30 TON**

Model		LCT360H5M, LCT360H5V								
		208/230V - 3 Ph			460V - 3 Ph			575V - 3 Ph		
<sup>1</sup> Voltage - 60Hz										
Compressor 1 (Non-Inverter)	Rated Load Amps	27.7			11.5			9		
	Locked Rotor Amps	179			103			78		
Compressor 2 (Non-Inverter)	Rated Load Amps	27.7			11.5			9		
	Locked Rotor Amps	179			103			78		
Compressor 3 (Non-Inverter)	Rated Load Amps	27.7			11.5			9		
	Locked Rotor Amps	179			103			78		
Compressor 4 (Non-Inverter)	Rated Load Amps	27.7			11.5			9		
	Locked Rotor Amps	179			103			78		
Outdoor Fan Motors (6)	Full Load Amps (6 Non-ECM)	14.4 (2.4)			7.8 (1.3)			6 (1)		
	Total	14.4			7.8			6		
Standard Power Exhaust (3) 0.33 HP	Full Load Amps	2.4			1.3			1		
	Total	7.2			3.9			3		
High Static Power Exhaust (3) 2 HP	Full Load Amps	7.5			3.7			2.7		
	Total	22.5			10.2			8.1		
Service Outlet 115V GFI (amps)		15			15			20		
Indoor Blower Motor	HP	5	7.5	10	5	7.5	10	5	7.5	10
	Full Load Amps	16.7	24.2	30.8	7.6	11	14	6.1	9	11
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit Only	175	175	175	70	70	80	60	60	60
	With (3) 0.33 HP Standard Power Exhaust	175	175	200	70	80	80	60	60	60
	With High Static Power Exhaust (3) 2 HP	175	200	200	80	80	90	60	70	70
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit Only	149	157	164	65	68	72	51	54	56
	With (3) 0.33 HP Standard Power Exhaust	157	164	171	69	72	76	54	57	59
	With High Static Power Exhaust (3) 2 HP	172	179	187	75	78	82	59	62	64

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.

<sup>2</sup> HACR type breaker or fuse.

<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.

**ELECTRIC HEAT DATA**

**30 TON**

Model			LCT360H5M, LCT360H5V											
<sup>1</sup> Voltage - 60Hz			208/230V - 3 Ph						460V - 3 Ph			575V - 3 Ph		
Indoor Blower Motor - HP			5		7.5		10		5	7.5	10	5	7.5	10
Electric Heat Voltage			208V	240V	208V	240V	208V	240V	480V	480V	480V	600V	600V	600V
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit+ Electric Heat	30 kW	175	175	175	175	175	175	70	80	70	60	60	60
		45 kW	175	175	175	175	175	175	80	90	80	70	70	70
		60 kW	175	175	175	175	<sup>4</sup> 175	200	90	90	90	70	70	80
		90 kW	<sup>4</sup> 225	250	<sup>4</sup> 225	250	<sup>4</sup> 250	<sup>4</sup> 300	125	150	125	100	100	110
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit+ Electric Heat	30 kW	149	149	157	157	164	164	65	72	65	51	54	56
		45 kW	149	157	157	166	164	174	78	86	78	62	66	68
		60 kW	149	166	157	175	164	183	82	90	82	66	69	72
		90 kW	209	238	218	247	227	256	118	126	118	95	98	101
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit+ Electric Heat and Standard Power Exhaust (3) 0.33 HP	30 kW	175	175	175	175	200	200	70	80	70	60	60	60
		45 kW	175	175	175	175	200	200	90	100	90	70	70	80
		60 kW	175	175	<sup>4</sup> 175	200	200	200	90	100	90	70	80	80
		90 kW	<sup>4</sup> 225	250	<sup>4</sup> 250	<sup>4</sup> 300	<sup>4</sup> 250	<sup>4</sup> 300	125	150	125	100	110	110
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit+ Electric Heat and Standard Power Exhaust (3) 0.33 HP	30 kW	157	157	164	164	171	171	69	76	69	54	57	59
		45 kW	157	166	164	175	171	183	83	91	83	66	70	72
		60 kW	157	175	165	184	173	192	87	95	87	70	73	76
		90 kW	218	247	227	256	236	265	123	131	123	98	102	105
<sup>2</sup> Maximum Overcurrent Protection (MOCP)	Unit+ Electric Heat and High Static Power Exhaust (3) 2 HP	30 kW	175	175	200	200	200	200	80	80	90	60	70	70
		45 kW	<sup>4</sup> 175	200	200	200	<sup>4</sup> 200	225	90	100	100	80	80	80
		60 kW	<sup>4</sup> 175	200	<sup>4</sup> 200	225	<sup>4</sup> 200	225	100	100	110	80	80	90
		90 kW	<sup>4</sup> 250	<sup>4</sup> 300	<sup>4</sup> 250	<sup>4</sup> 300	300	<sup>4</sup> 300	150	150	150	110	110	125
<sup>3</sup> Minimum Circuit Ampacity (MCA)	Unit+ Electric Heat and High Static Power Exhaust (3) 2 HP	30 kW	172	172	179	179	187	187	75	78	82	59	62	64
		45 kW	172	185	179	194	187	202	90	95	98	72	76	79
		60 kW	175	194	184	203	192	211	95	99	103	76	80	82
		90 kW	237	266	247	275	255	284	131	135	139	105	108	111

<sup>1</sup> Extremes of operating range are plus and minus 10% of line voltage.  
<sup>2</sup> HACR type breaker or fuse.  
<sup>3</sup> Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements.  
<sup>4</sup> Factory installed circuit breaker not available.

## ELECTRIC HEAT CAPACITIES

Volts Input	30 kW			45 kW			60 kW			90 kW		
	kW Input	Btuh Output	Stages									
208	22.5	76,800	1	33.8	115,300	2	45.0	153,600	2	67.6	230,700	2
220	25.2	86,000	1	37.8	129,000	2	50.4	172,000	2	75.6	258,000	2
230	27.5	93,900	1	41.3	141,000	2	55.1	188,000	2	82.7	282,200	2
240	30.0	102,400	1	45.0	153,600	2	60.0	204,800	2	90.0	307,100	2
440	25.2	86,000	1	37.8	129,000	2	50.4	172,000	2	75.6	258,000	2
460	27.5	93,900	1	41.3	141,000	2	55.1	188,000	2	82.7	282,200	2
480	30.0	102,400	1	45.0	153,600	2	60.0	204,800	2	90.0	307,100	2
550	25.2	86,000	1	37.8	129,000	2	50.4	172,000	2	75.6	258,000	2
575	27.5	93,900	1	41.3	141,000	2	55.1	188,000	2	82.7	282,200	2
600	30.0	102,400	1	45.0	153,600	2	60.0	204,800	2	90.0	307,100	2

**ELECTRICAL ACCESSORIES**

**25 TON**

Model		LCT302H5								
Voltage - 60Hz - 3 phase		208/230V			460V			575V		
Indoor Blower Motor	HP	5	7.5	10	5	7.5	10	5	7.5	10
Disconnect	Unit Only	54W86	54W87	54W87	54W85	54W85	54W85	54W85	54W85	54W85
	Unit+ Electric Heat and Standard Power Exhaust (3) 0.33 HP	0 kW	54W86	54W87	54W87	54W85	54W85	54W85	54W85	54W85
	30 kW	54W86	54W87	54W87	54W85	54W85	54W85	54W85	54W85	54W85
	45 kW	54W87	54W87	54W87	54W85	54W85	54W86	54W85	54W85	54W85
	60 kW	54W87	54W87	54W87	54W86	54W86	54W86	54W85	54W86	54W86
	90 kW	N/A	N/A	N/A	54W86	54W86	54W86	54W86	54W86	54W86
	Unit+ Electric Heat and High Static Power Exhaust (3) 2 HP	0 kW	54W87	54W87	54W87	54W85	54W86	54W86	54W85	54W85
	30 kW	54W87	54W87	54W87	54W85	54W86	54W86	54W85	54W85	54W85
	45 kW	54W87	54W87	54W87	54W86	54W86	54W86	54W85	54W85	54W85
	60 kW	54W87	54W87	54W87	54W86	54W86	54W86	54W86	54W86	54W86
90 kW	N/A	N/A	N/A	54W86	54W86	54W87	54W86	54W86	54W86	

Disconnects - 54W85 - 80A  
 54W86 - 150A  
 54W87 - 250A

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

**ELECTRICAL ACCESSORIES**

**30 TON**


Model		LCT360H5								
Voltage - 60Hz - 3 phase		208/230V			460V			575V		
Indoor Blower Motor	HP	5	7.5	10	5	7.5	10	5	7.5	10
Disconnect	Unit Only	54W87	54W87	54W87	54W85	54W86	54W86	54W85	54W85	54W85
	Unit+ Electric Heat and Standard Power Exhaust (3) 0.33 HP	0 kW	54W87	54W87	54W87	54W85	54W86	54W86	54W85	54W85
	30 kW	54W87	54W87	54W87	54W85	54W86	54W86	54W85	54W85	54W85
	45 kW	54W87	54W87	54W87	54W85	54W86	54W86	54W85	54W85	54W85
	60 kW	54W87	54W87	54W87	54W86	54W86	54W86	54W85	54W86	54W86
	90 kW	N/A	N/A	N/A	54W86	54W86	54W86	54W86	54W86	54W86
	Unit+ Electric Heat and High Static Power Exhaust (3) 2 HP	0 kW	54W87	54W87	54W87	54W86	54W86	54W86	54W85	54W85
	30 kW	54W87	54W87	54W87	54W86	54W86	54W86	54W85	54W85	54W85
	45 kW	54W87	54W87	54W87	54W86	54W86	54W86	54W85	54W85	54W85
	60 kW	54W87	54W87	54W87	54W86	54W86	54W86	54W86	54W86	54W86
90 kW	N/A	N/A	N/A	54W86	54W86	54W87	54W86	54W86	54W86	

Disconnects - 54W85 - 80A  
 54W86 - 150A  
 54W87 - 250A

NOTE - All units have a minimum Short Circuit Current Rating (SCCR) of 5000 amps.

# UNIT CLEARANCES

## Unit With Economizer

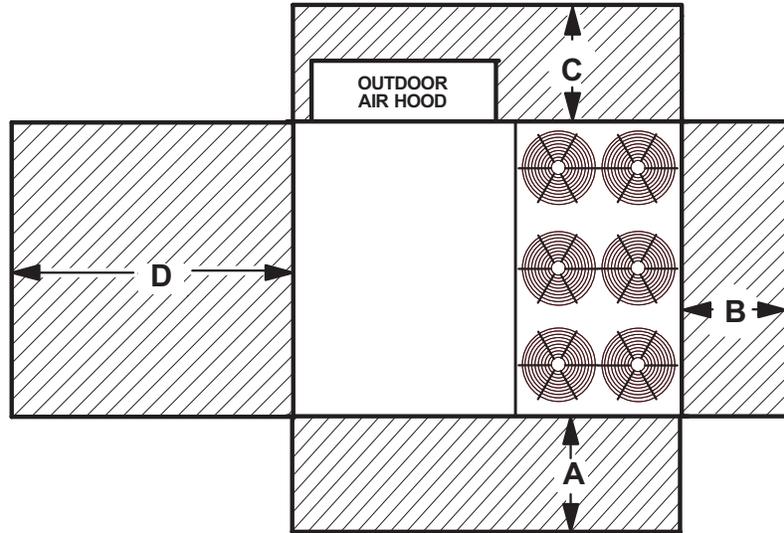


1 Unit Clearance	A		B		C		D		Top Clearance
	in.	mm	in.	mm	in.	mm	in.	mm	
<b>Service Clearance</b>	60	1524	36	914	36	914	66	1676	Unobstructed
<b>Minimum Operation Clearance</b>	45	1143	36	914	36	914	41	1041	

NOTE - Entire perimeter of unit base requires support when elevated above the mounting surface.

<sup>1</sup> Service Clearance - Required for removal of serviceable parts.

Minimum Operation Clearance - Required clearance for proper unit operation.

## Unit With High Static Power Exhaust Fans

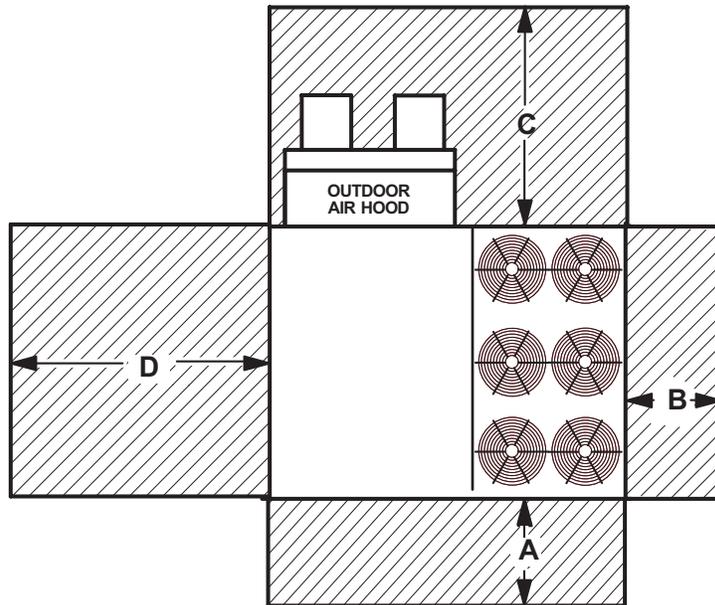

1 Unit Clearance	A		B		C		D		Top Clearance
	in.	mm	in.	mm	in.	mm	in.	mm	
<b>Service Clearance</b>	60	1524	36	914	80	2032	66	1676	Unobstructed
<b>Minimum Operation Clearance</b>	45	1143	36	914	80	2032	41	1041	

NOTE - Entire perimeter of unit base requires support when elevated above the mounting surface.

<sup>1</sup> Service Clearance - Required for removal of serviceable parts.


Minimum Operation Clearance - Required clearance for proper unit operation.

# UNIT CLEARANCES

## Unit With Horizontal Barometric Relief Dampers

**NOTE** Allow adequate clearance for duct and barometric relief damper installation.

**NOTE** Dampers may be installed on each side of return air duct or end to end on one side of return air duct.

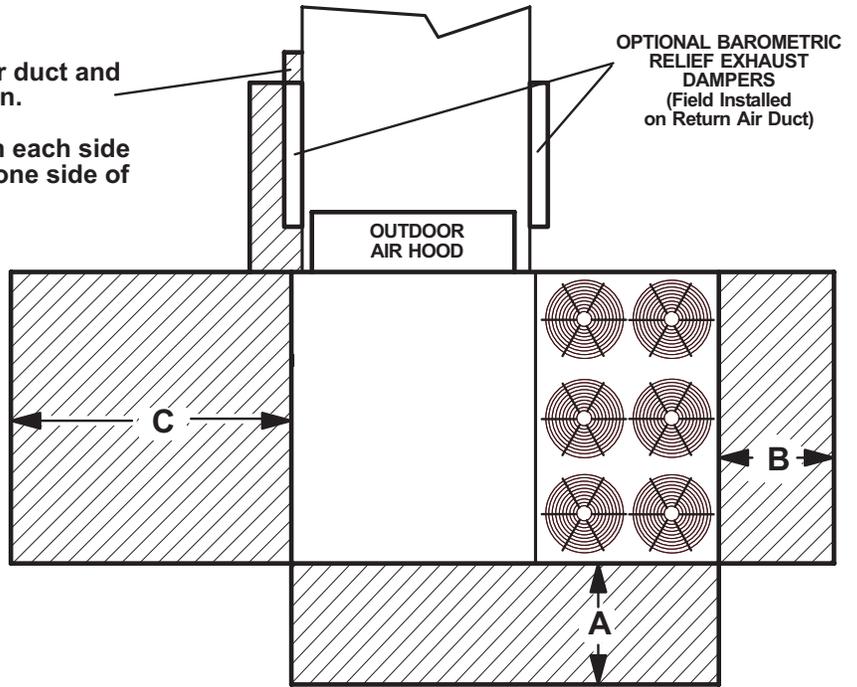

<sup>1</sup> Unit Clearance	A		B		C		Top Clearance
	in.	mm	in.	mm	in.	mm	
<b>Service Clearance</b>	60	1524	36	914	66	1676	Unobstructed
<b>Minimum Operation Clearance</b>	45	1143	36	914	41	1041	

NOTE - Entire perimeter of unit base requires support when elevated above the mounting surface.

<sup>1</sup> Service Clearance - Required for removal of serviceable parts.

Minimum Operation Clearance - Required clearance for proper unit operation.

## OUTDOOR SOUND DATA

Size	Octave Band Sound Power Levels dBA, re 10 <sup>-12</sup> Watts - Center Frequency - Hz							<sup>1</sup> Sound Rating Number (dBA)
	125	250	500	1000	2000	4000	8000	
302, 360	84	85	90	90	85	80	72	95

Note - The octave band sound power data does not include tonal corrections.

<sup>1</sup> Tested according to AHRI Standard 370-2001 test conditions (includes pure tone penalty).

Sound Rating Number is the overall A-Weighted Sound Power Level, (LWA), dB (100 Hz to 10,000 Hz).

## WEIGHT DATA

Size	Net		Shipping	
	lbs.	kg	lbs.	kg
302 Base Unit	2997	1359	3207	1455
302 Max. Unit	3509	1592	3719	1687
360 Base Unit	2997	1359	3207	1455
360 Max. Unit	3509	1592	3719	1687

## FACTORY / FIELD INSTALLED OPTIONS AND ACCESSORIES - NET WEIGHTS




Description	lbs.	kg
<b>ECONOMIZER / OUTDOOR AIR / EXHAUST</b>		
<b>Economizer</b>	138	63
<b>Barometric Relief</b>		
Downflow Barometric Relief Dampers	45	20
Horizontal Barometric Relief Dampers	20	9
<b>Outdoor Air Dampers</b>		
Damper Section (downflow) Motorized	72	33
Damper Section (downflow) Manual	68	31
<b>Outdoor Air Hood (downflow)</b>	76	34
<b>Power Exhaust</b>		
Standard Static	99	45
High Static with or without VFD	525	238
<b>ELECTRIC HEAT</b>		
30 KW	59	27
45 KW	76	34
60 KW	76	34
90 KW	84	38
<b>COMBINATION COIL/HAIL GUARDS</b>		
All models	63	29
<b>ROOF CURBS</b>		
<b>Hybrid Roof Curbs, Downflow</b>		
14 in. height	205	93
18 in. height	235	107
24 in. height	270	123
<b>Standard Curbs, Horizontal</b>		
30 in. height	495	225
41 in. height	575	261
<b>Insulation Kit for Horizontal Curbs</b>		
30 in. height	45	21
41 in. height	55	25
<b>CEILING DIFFUSERS</b>		
Step-Down LARTD30/36S	625	283
Flush LAFD30/36S	625	283
Transitions LASRT30/36	85	39
<b>HUMIDITROL® DEHUMIDIFICATION SYSTEM</b>		
Humiditrol® Dehumidification Option	100	45

# DIMENSIONS - UNIT


CORNER WEIGHTS									CENTER OF GRAVITY			
Model	AA		BB		CC		DD		EE		FF	
	lbs.	kg	lbs.	kg	lbs.	kg	lbs.	kg	in.	mm	in.	mm
LCT302 Base Unit	610	277	612	278	880	399	895	406	60	1524	37	940
LCT302 Max. Unit	693	315	696	316	1001	454	1018	462	60	1524	37	940
LCT360 Base Unit	610	277	612	278	880	399	895	406	60	1524	37	940
LCT360 Max. Unit	693	315	696	316	1001	454	1018	462	60	1524	37	940

Base Unit - The unit with NO INTERNAL OPTIONS.


Max. Unit - The unit with ALL INTERNAL OPTIONS Installed. (Economizer, Standard Static Power Exhaust, Controls, etc.). Does not include accessories external to unit or high static power exhaust.

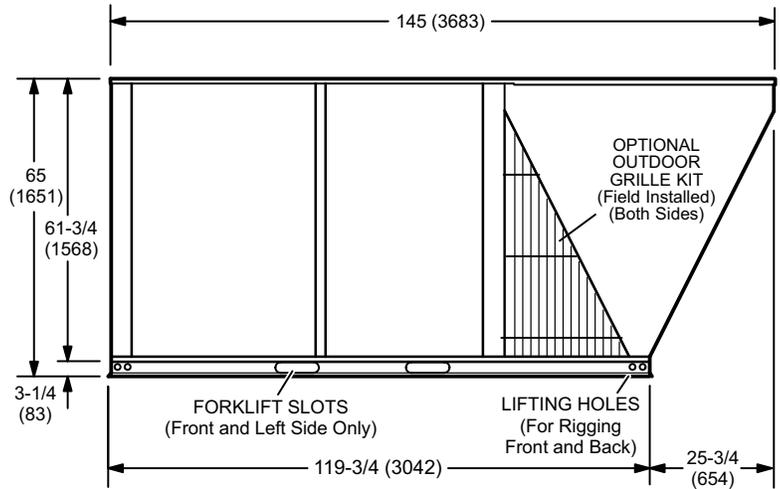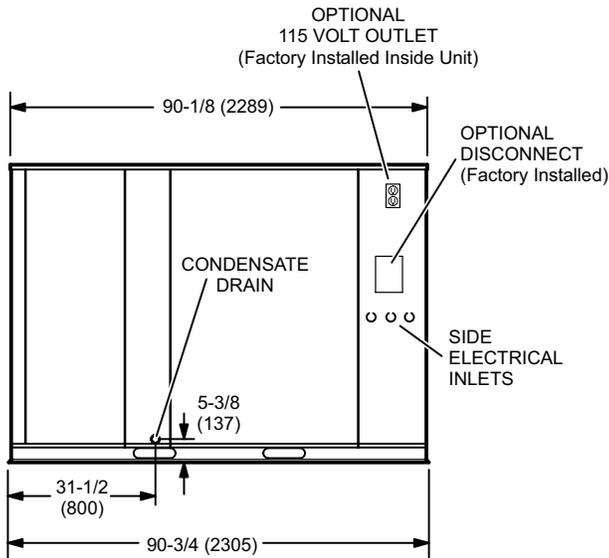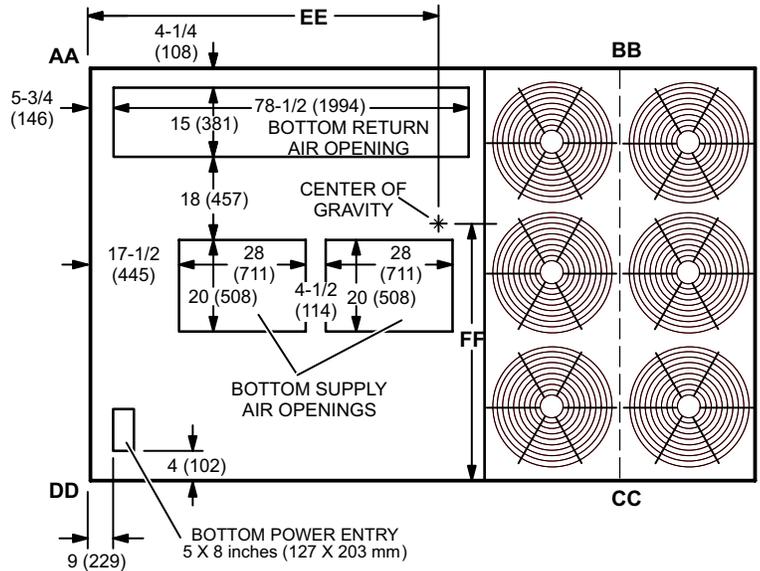

**OUTDOOR AIR HOOD DETAIL**

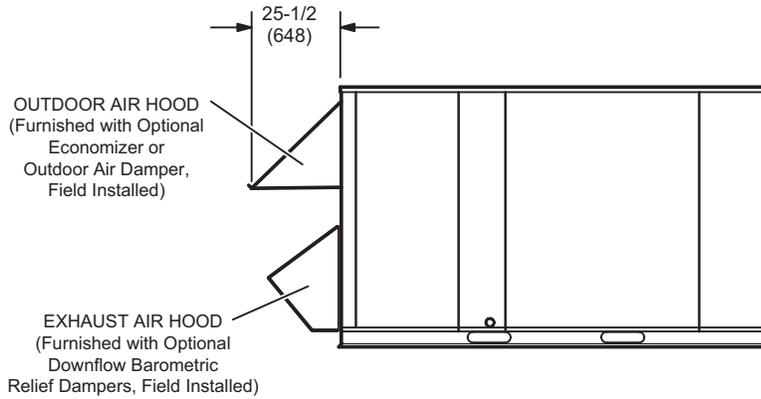


**OPTIONAL HIGH STATIC POWER EXHAUST FANS DETAIL**

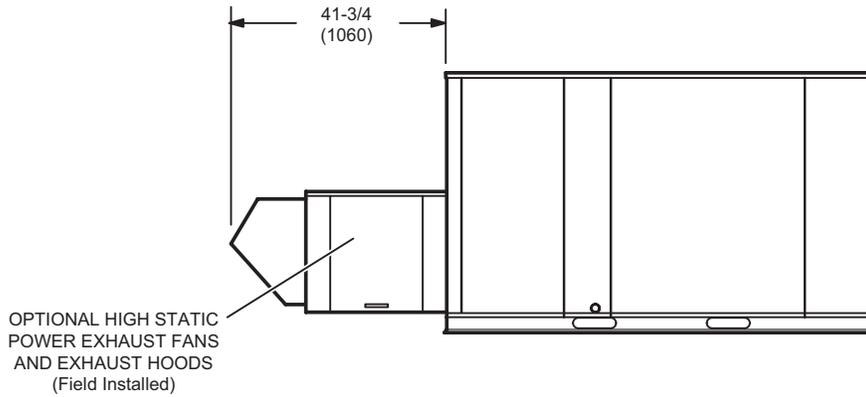

**OPTIONAL HORIZONTAL BAROMETRIC RELIEF DAMPERS WITH HOOD**

(Field installed in horizontal return air duct adjacent to unit)

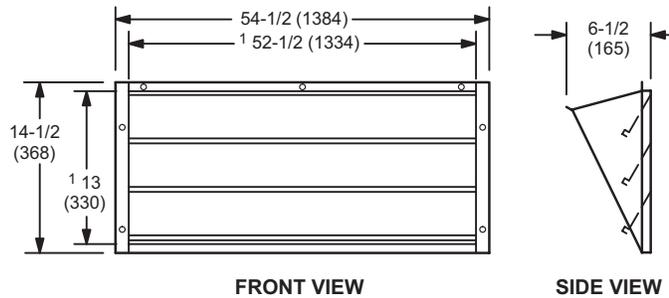


NOTE - Two furnished per order no.


<sup>1</sup> NOTE - Opening size required in return air duct.

# DIMENSIONS - ACCESSORIES


## HYBRID ROOF CURBS - DOUBLE DUCT OPENING

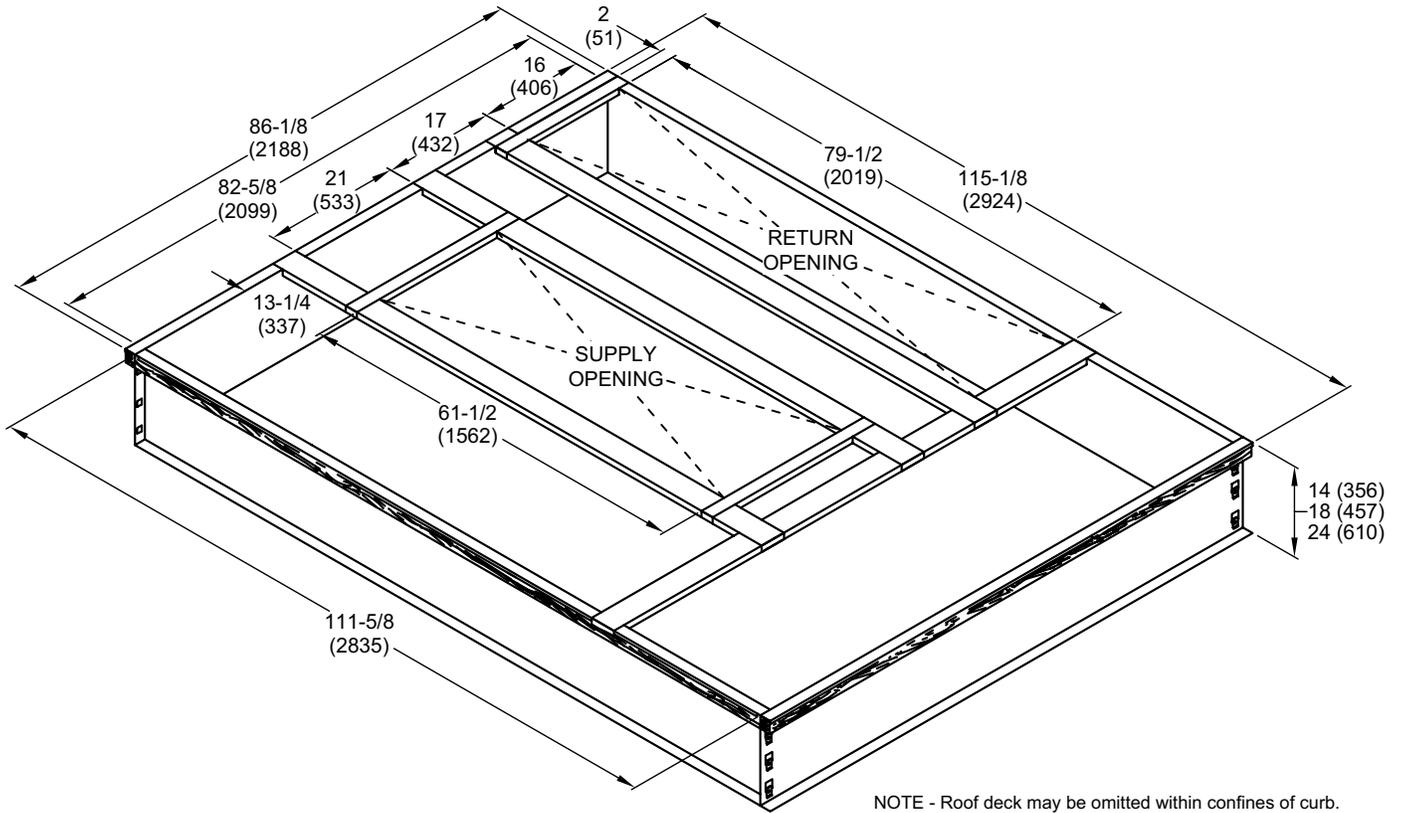



**TYPICAL FLASHING DETAIL FOR ROOF CURB**

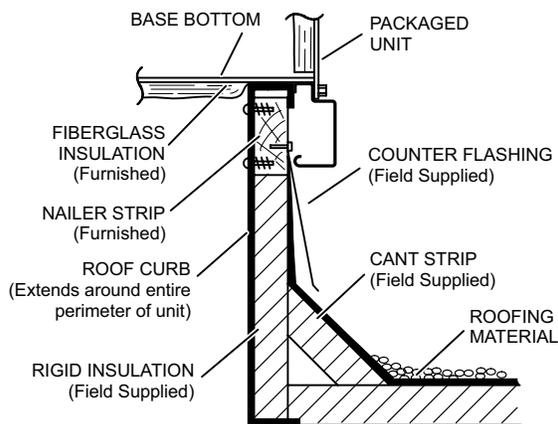

**DETAIL ROOF CURB**

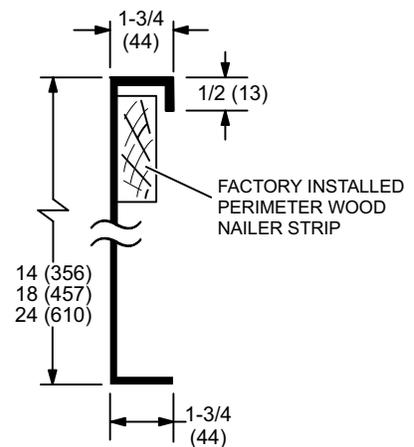


**ROOF CURBS WITH SUPPLY & RETURN AIR TRANSITIONS FOR CEILING DIFFUSERS**

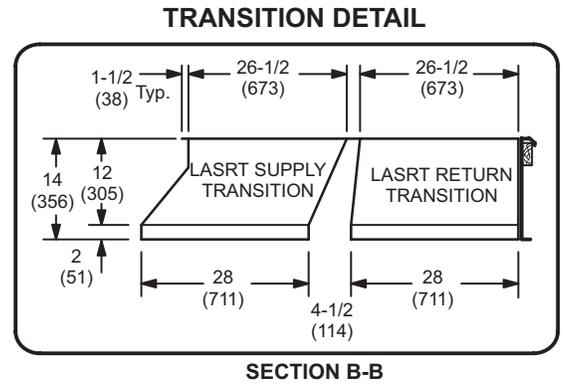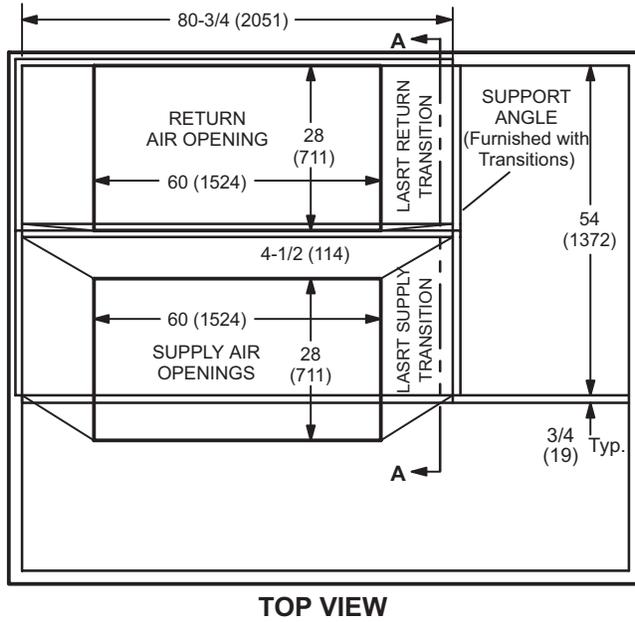




# DIMENSIONS - ACCESSORIES

## HORIZONTAL ROOF CURBS – Requires Optional Horizontal Return Air Panel Kit

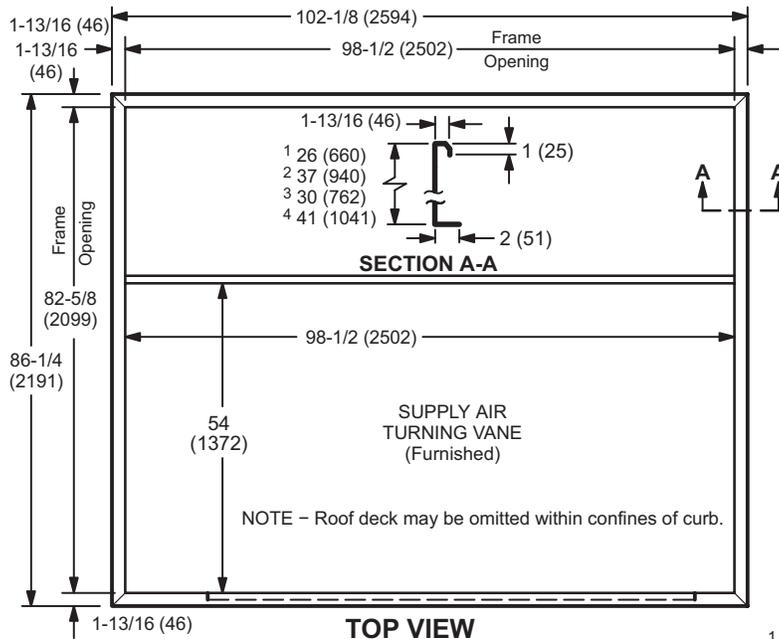

NOTE - 30 in. (762 mm) height Curb is designed for horizontal discharge when unit is mounted on a slab.  
41 in. (1041 mm) height Curb is designed for horizontal discharge when unit is mounted on a rooftop.


PANEL TO COVER RETURN AIR OPENING IN BOTTOM OF UNIT (Furnished With Optional Horizontal Return Air Panel Kit)

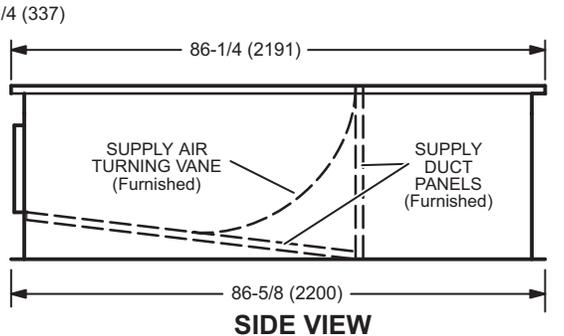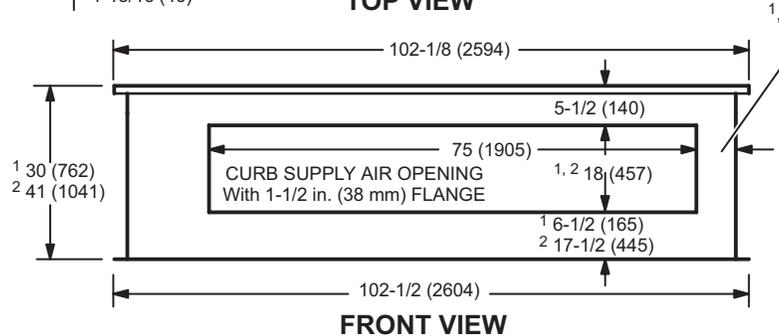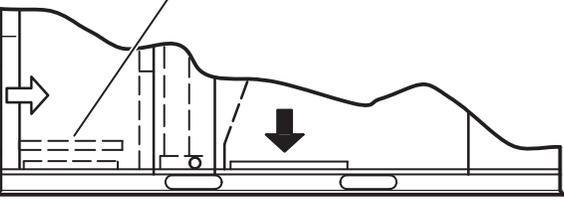

<sup>1</sup> Slab Applications <sup>2</sup> Rooftop Applications

## HORIZONTAL SUPPLY AND RETURN AIR OPENINGS ROOFTOP UNIT WITH HORIZONTAL ROOF CURB

<sup>1</sup> Slab Applications  
<sup>2</sup> Rooftop Applications

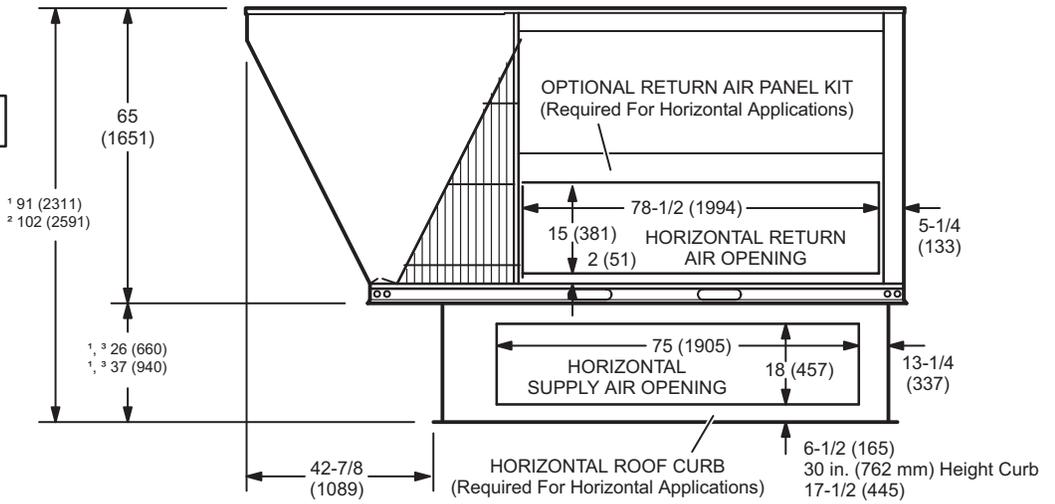


<sup>3</sup> NOTE - Top of Curb extends 4 inch (102 mm) inside bottom of unit base. See Typical Flashing Detail.


## DIMENSIONS - ACCESSORIES

### COMBINATION CEILING SUPPLY AND RETURN DIFFUSERS

#### STEP-DOWN CEILING DIFFUSER

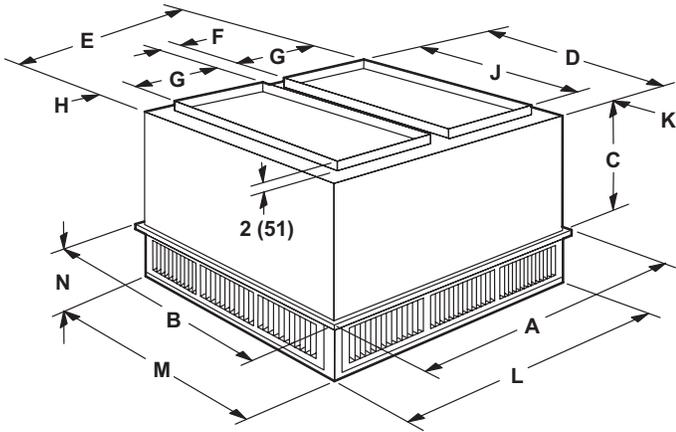

#### FLUSH CEILING DIFFUSER

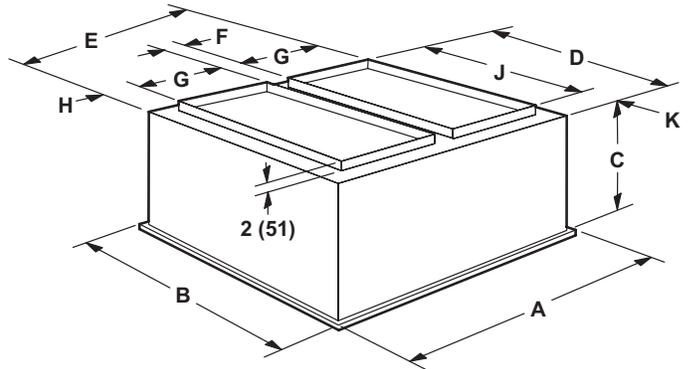

Model		LARTD30/36S
A	in.	65-5/8
	mm	1667
B	in.	65-5/8
	mm	1667
C	in.	40-1/2
	mm	1029
D	in.	63-1/2
	mm	1613
E	in.	63-1/2
	mm	1613
F	in.	4-1/2
	mm	114
G	in.	28
	mm	711
H	in.	1-1/2
	mm	38
J	in.	60
	mm	1524
K	in.	1-3/4
	mm	44
L	in.	63-1/2
	mm	1613
M	in.	63-1/2
	mm	1613
N	in.	12-1/8
	mm	308
Duct Size	in.	28 x 60
	mm	711 x 1524

Model		LAFD30/36S
A	in.	65-5/8
	mm	1667
B	in.	65-5/8
	mm	1667
C	in.	40
	mm	1016
D	in.	63-1/2
	mm	1613
E	in.	63-1/2
	mm	1613
F	in.	4-1/4
	mm	108
G	in.	28
	mm	711
H	in.	1-5/8
	mm	32
J	in.	60
	mm	1524
K	in.	1-3/4
	mm	44
Duct Size	in.	28 x 60
	mm	711 x 1524

## REVISIONS

Sections	Description of Change
Options / Accessories	Updated CO <sub>2</sub> Sensor Catalog Numbers.



Visit us at [www.Lennox.com](http://www.Lennox.com)

For the latest technical information, [www.LennoxCommercial.com](http://www.LennoxCommercial.com)

Contact us at 1-800-4-LENNOX

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

©2026 Lennox Industries, Inc.