


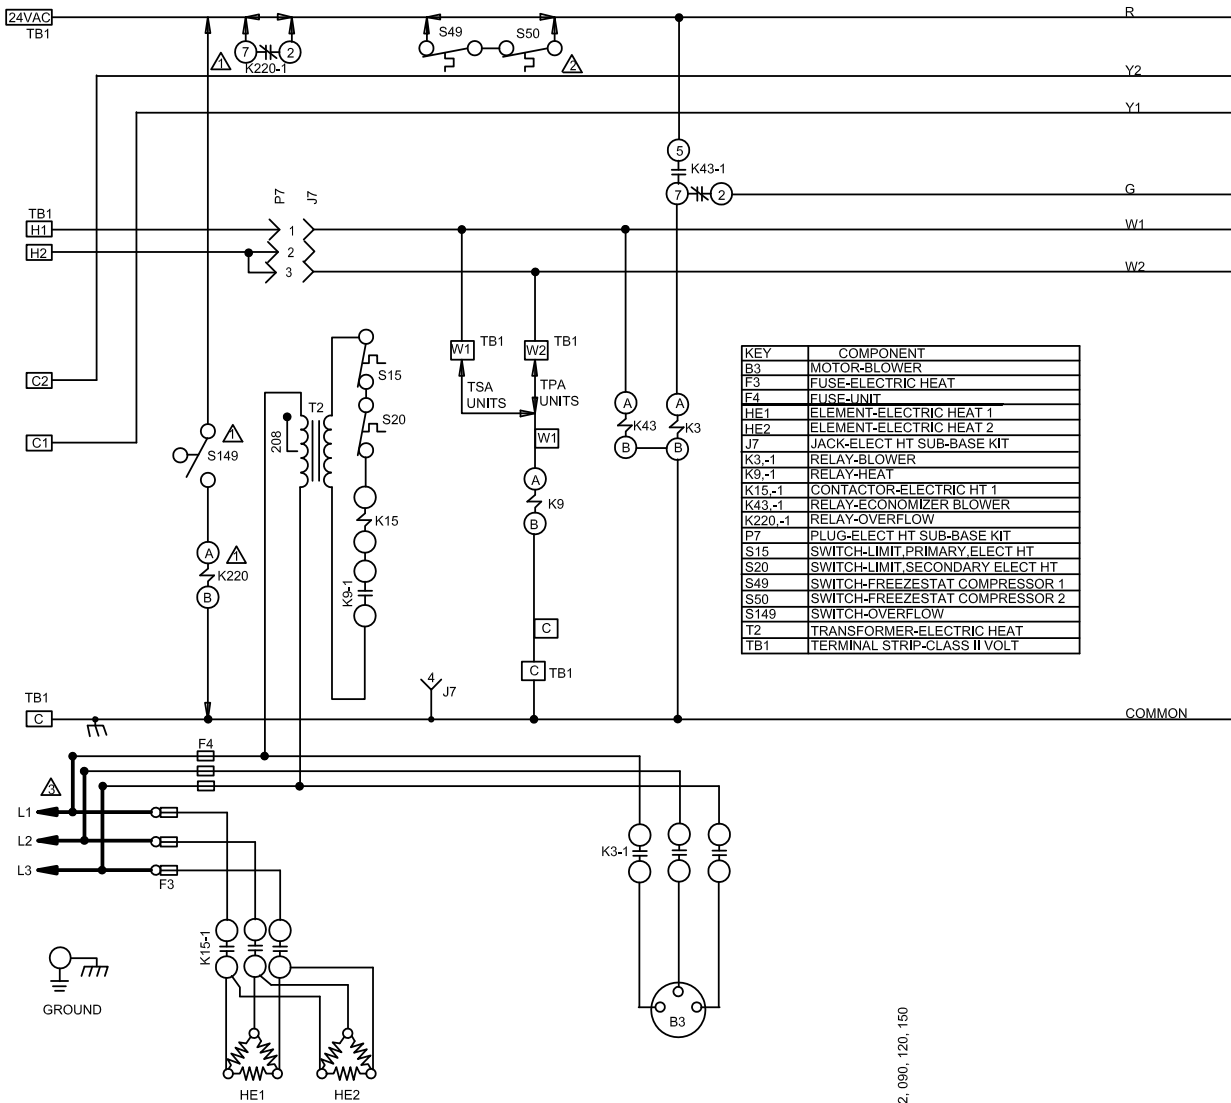

IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING

- ⚠ S149 SWITCH AND K220 RELAY MAY BE FIELD SUPPLIED OR USE AVAILABLE KIT
- ⚠ S50 USED ON TWO STAGE UNITS
- ⚠ USE COPPER CONDUCTORS ONLY

01/12	WIRING DIAGRAM	01/12
537524-01		
HEATING - ELECTRIC		
T3EH - TAA 072 - 150 UNITS - Y		
10,15 KW		
SECTION B3		REV 0
Supersedes	New Form No.	
537171-01	537524-01	

© 2012 Lennox Commercial