


INSTALLATION INSTRUCTIONS FOR M2-0 INTEGRATED MODULAR CONTROLLER ENERGENCE DISPLAY KIT USED WITH ENERGENCE™ E-BOX ROOFTOP UNITS

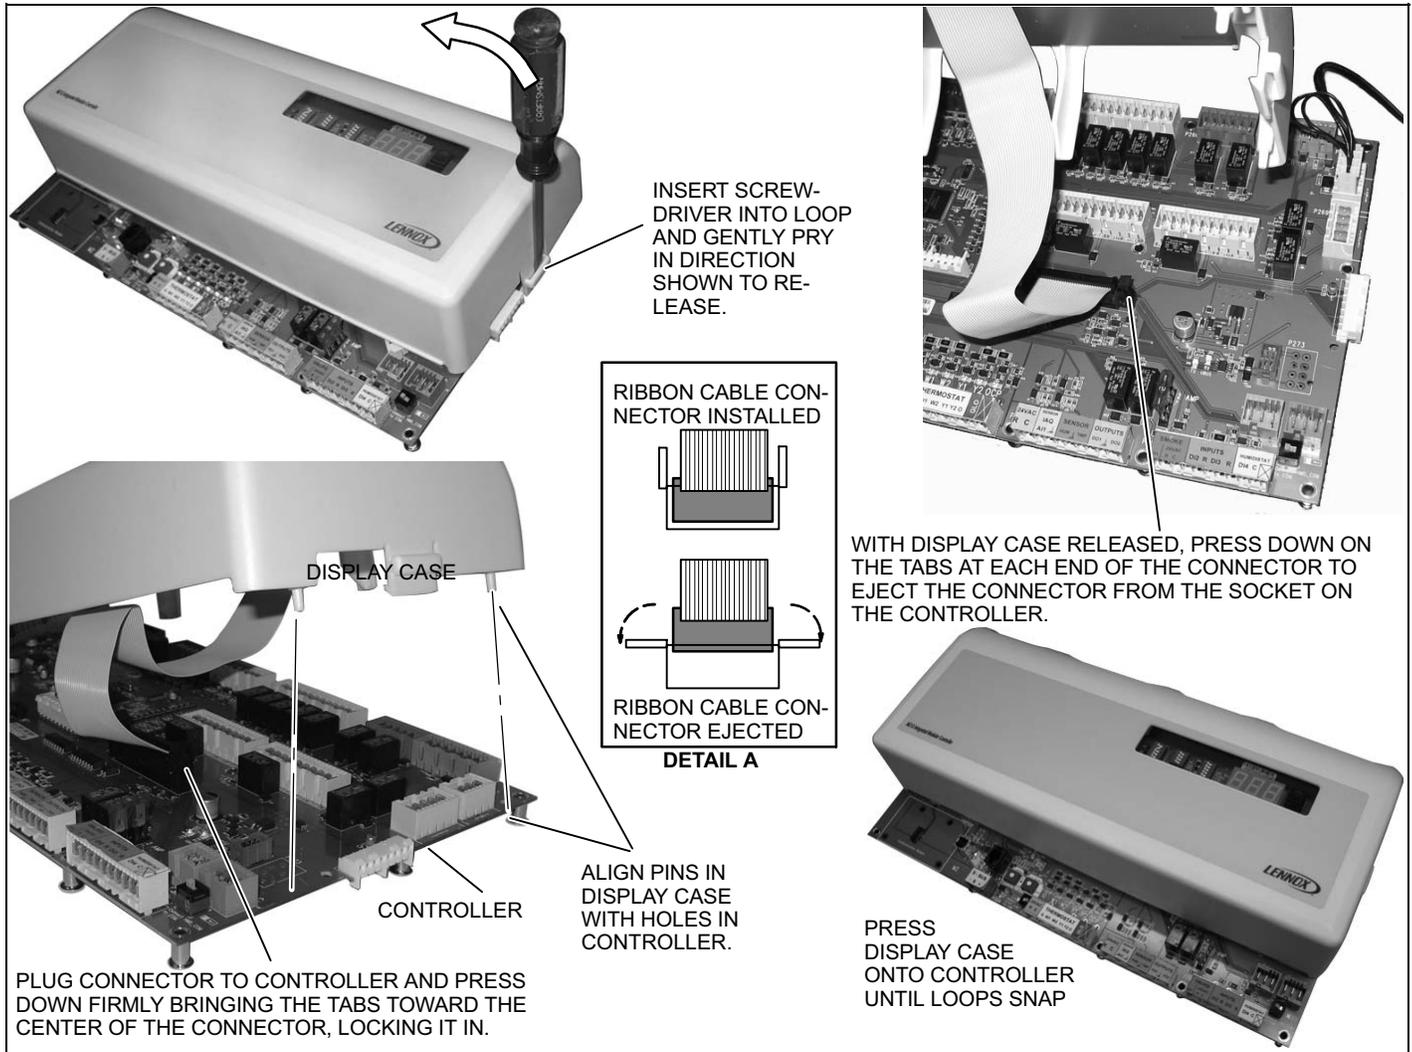

Shipping and Packing List

Package 1 of 1 contains:

- 1- M2 Energence™ Display (DB1-1)
- 1- Installation Instructions (this document)

Removing the Display

⚠ WARNING



Electric shock hazard. Can cause injury or death. Before attempting to perform any service or maintenance, turn the electrical power to unit OFF at disconnect switch(es). Unit may have multiple power supplies.

1. Power down the rooftop unit.

2. Insert a flat screwdriver into the loops located on the side edges of the display and gently pry tabs out to release the display from the M2-0 Integrated Modular Controller.
3. Press down on the tabs (see detail A) to eject the ribbon connector and disconnect the cable from the M2-0 Integrated Modular Controller.

Installing new Display

1. Connect the display ribbon cable to the M2-0 Integrated Modular Controller. Press down until tabs swing into vertical position (see detail A).
2. Insert alignment pins into corresponding holes on the M2-0 Integrated Modular Controller; evenly press display onto the M2 until both tabs latch onto the M2-0 Integrated Modular Controller.
3. Power up the rooftop unit.

