Cut Size: 6-1/2”wide x 8-1/2” tall

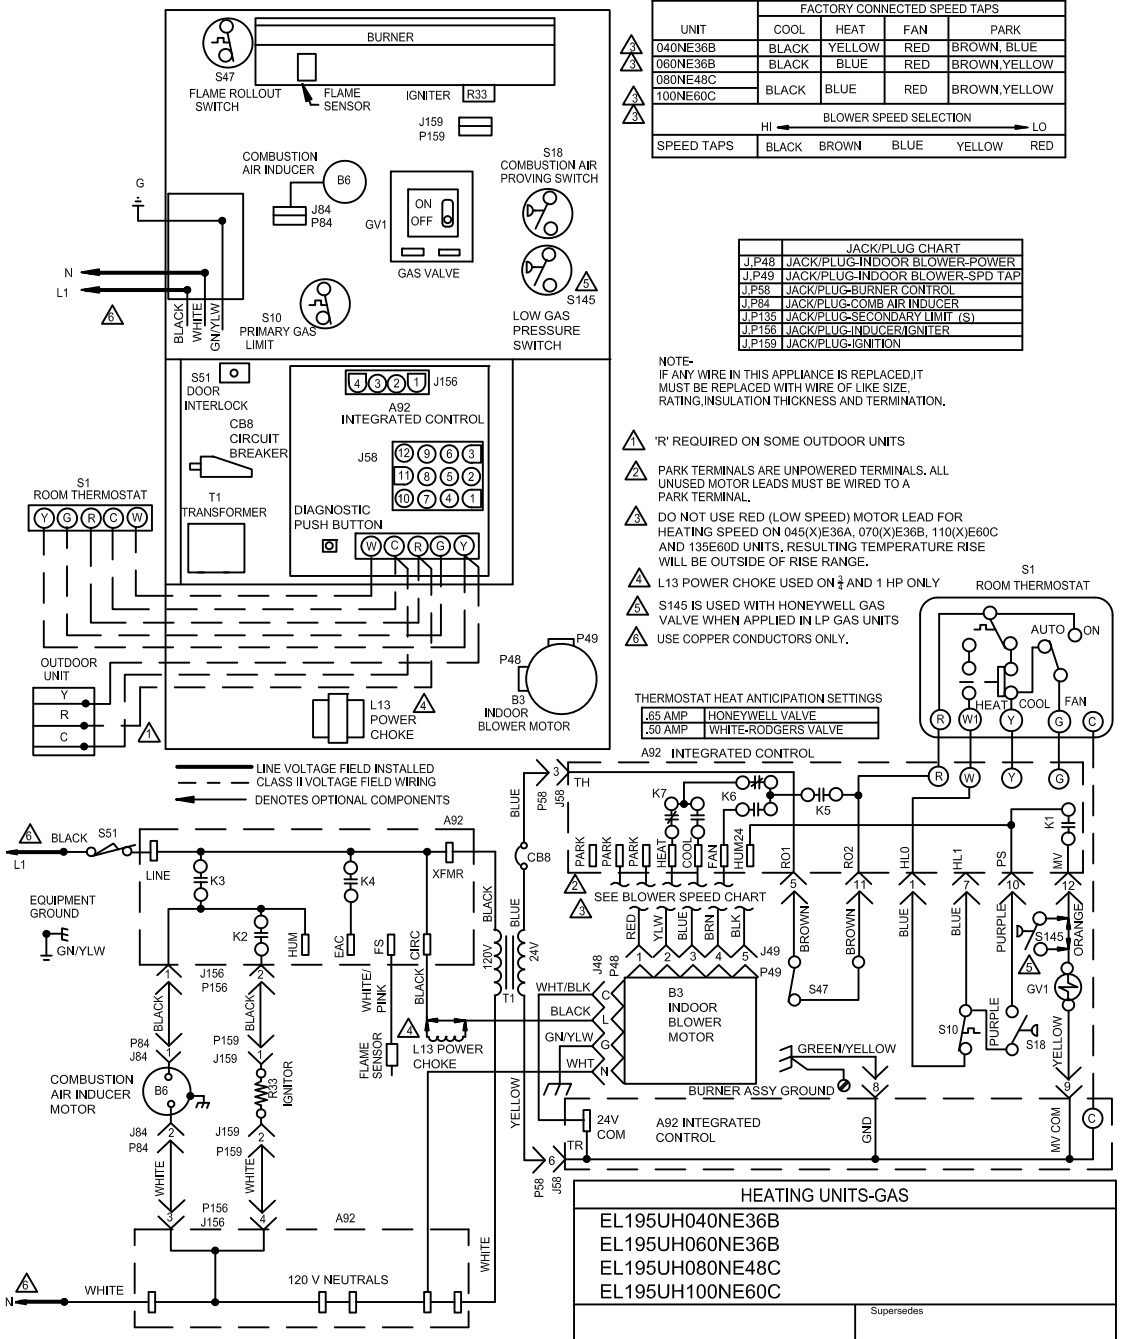


| | BLOWER SPEED CHART | | | |
|---|---|---|---|---|
| | FACTORY CONNECTED SPEED TAPS | | | |
| UNIT | COOL | HEAT | FAN | PARK |
| 040NE36B | BLACK | YELLOW | RED | BROWN, BLUE |
| 060NE36B | BLACK | BLUE | RED | BROWN,YELLOW |
| 080NE48C / 100NE60C | BLACK | BLUE | RED | BROWN,YELLOW |
| BLOWER SPEED SELECTION | | | | |
| | HI ← | | | → LO |
| SPEED TAPS | BLACK | BROWN | BLUE | YELLOW RED |

| | JACK/PLUG CHART |
|---|---|
| J,P48 | JACK/PLUG-INDOOR BLOWER-POWER |
| J,P49 | JACK/PLUG-INDOOR BLOWER-SPD TAP |
| J,P58 | JACK/PLUG-BURNER CONTROL |
| J,P84 | JACK/PLUG-COMB AIR INDUCER |
| J,P135 | JACK/PLUG-SECONDARY LIMIT (S) |
| J,P156 | JACK/PLUG-INDUCER/IGNITER |
| J,P159 | JACK/PLUG-IGNITION |

NOTE-
IF ANY WIRE IN THIS APPLIANCE IS REPLACED,IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING,INSULATION THICKNESS AND TERMINATION.

1. 'R' REQUIRED ON SOME OUTDOOR UNITS
2. PARK TERMINALS ARE UNPOWERED TERMINALS. ALL UNUSED MOTOR LEADS MUST BE WIRED TO A PARK TERMINAL.
3. DO NOT USE RED (LOW SPEED) MOTOR LEAD FOR HEATING SPEED ON 045(X)E36A, 070(X)E36B, 110(X)E60C AND 135E60D UNITS. RESULTING TEMPERATURE RISE WILL BE OUTSIDE OF RISE RANGE.
4. L13 POWER CHOKE USED ON ¾ AND 1 HP ONLY
5. S145 IS USED WITH HONEYWELL GAS VALVE WHEN APPLIED IN LP GAS UNITS
6. USE COPPER CONDUCTORS ONLY.

| THERMOSTAT HEAT ANTICIPATION SETTINGS | |
|---|---|
| .65 AMP | HONEYWELL VALVE |
| .50 AMP | WHITE-RODGERS VALVE |

WARNING-
ELECTRIC SHOCK HAZARD.CAN CAUSE INJURY OR DEATH,UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES.

HEATING UNITS-GAS

EL195UH040NE36B
EL195UH060NE36B
EL195UH080NE48C
EL195UH100NE60C

Supersedes

0519

Form No.
537916-02

© 2011

Litho U.S.A.