
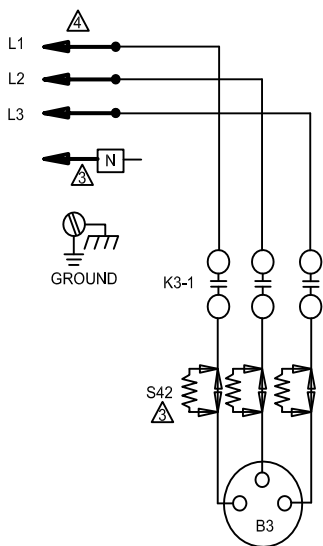


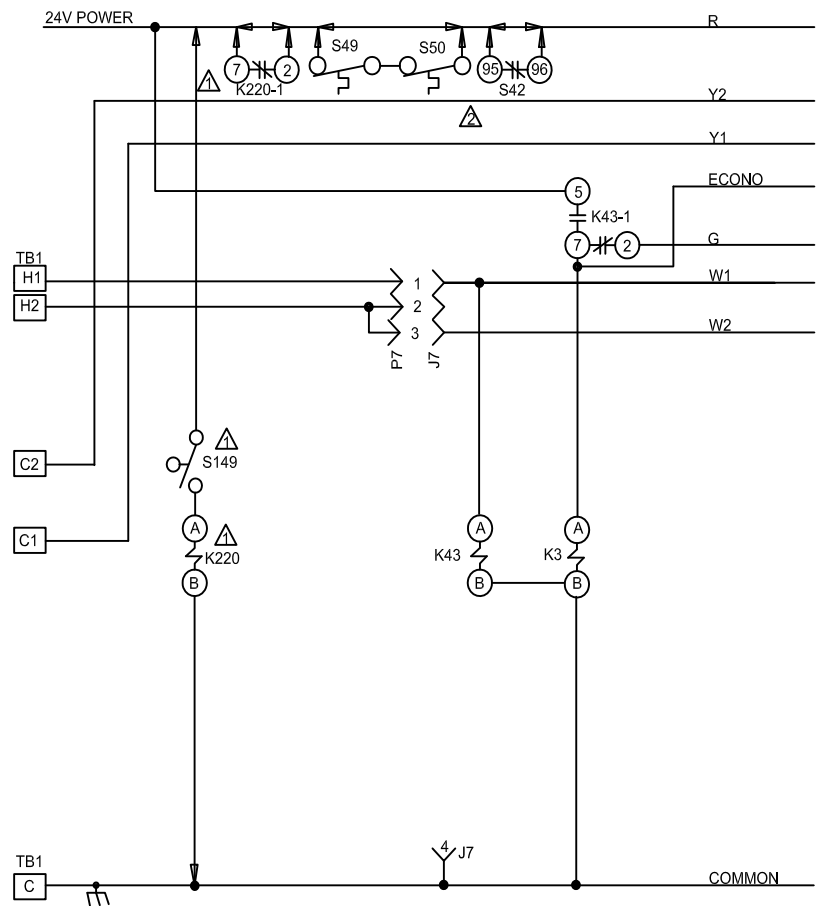

KEY	COMPONENT
B3	MOTOR-BLOWER
J7	JACK-ELECT HT SUB-BASE KIT
K3-1	RELAY-BLOWER
K43-1	RELAY-ECONOMIZER BLOWER
K220-1	RELAY-OVERFLOW
P7	PLUG - ELECT HT SUB BASE KIT
S42	RELAY-OVERLOAD,BLOWER MTR
S49	SWITCH-FREEZESTAT COMPRESSOR 1
S50	SWITCH-FREEZESTAT COMPRESSOR 2
S149	SWITCH-OVERFLOW
TB1	TERMINAL STRIP-CLASS II VOLT

IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING

← DENOTES OPTIONAL COMPONENTS

- ⚠ S149 SWITCH AND K220 RELAY MAY BE FIELD SUPPLIED OR USE AVAILABLE KIT
- ⚠ S50 USED ON TWO STAGE UNITS
- ⚠ "M" VOLTAGE UNITS ONLY
- ⚠ FOR USE WITH COPPER CONDUCTORS ONLY

01/12		WIRING DIAGRAM	01/12
	537530-01		
BLOWER			
TAA 072 - 240 - G,J,M,Y			
SECTION B1			REV 0
Supersedes		New Form No. 537530-01	