


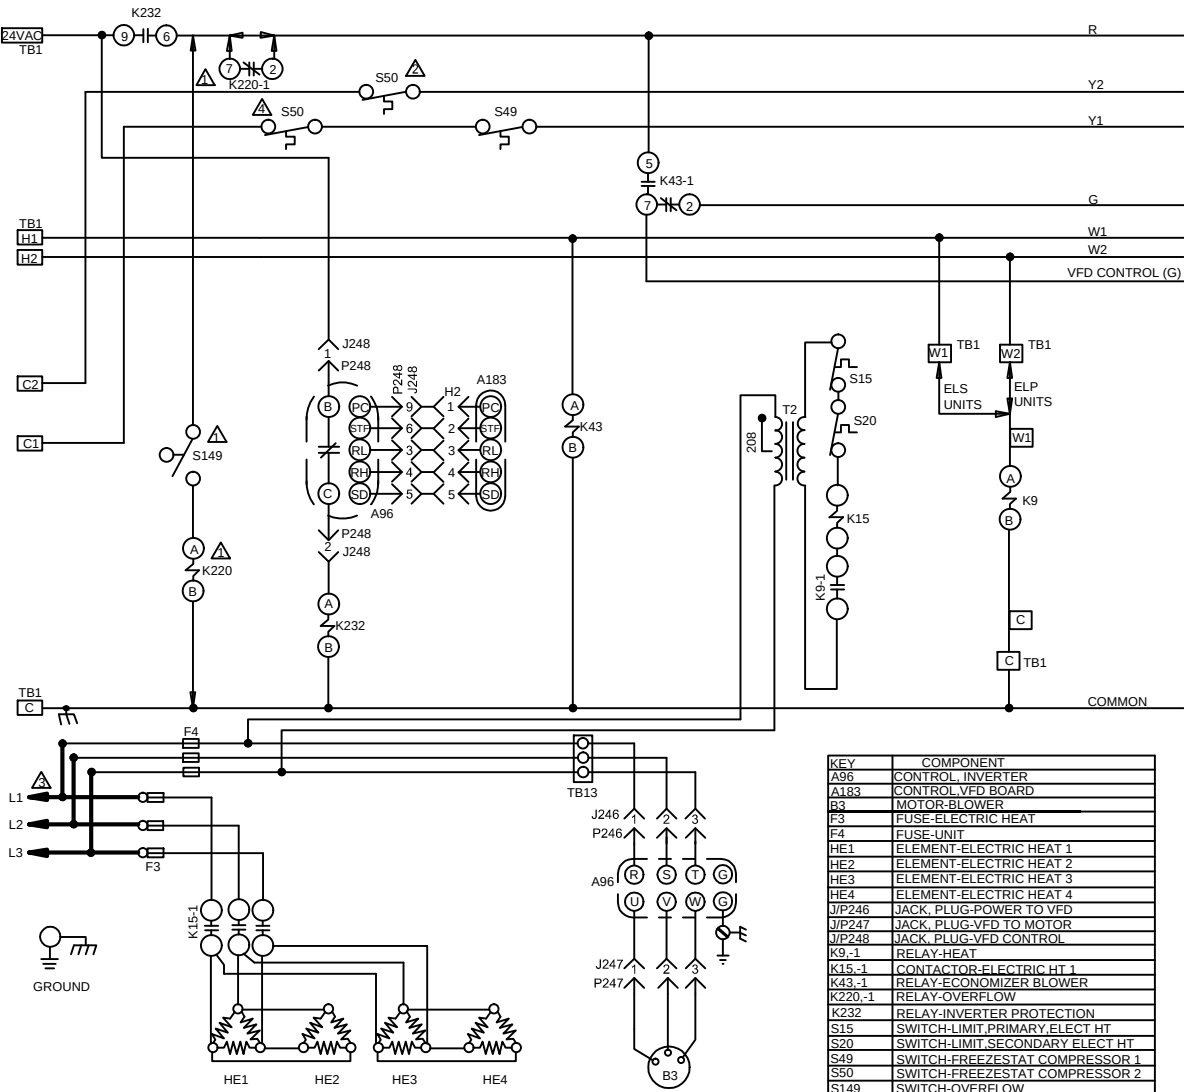

IF ANY WIRE IN THIS APPLIANCE IS REPLACED, IT MUST BE REPLACED WITH WIRE OF LIKE SIZE, RATING, INSULATION THICKNESS AND TERMINATION

WARNING-ELECTRIC SHOCK HAZARD, CAN CAUSE INJURY OR DEATH. UNIT MUST BE GROUNDED IN ACCORDANCE WITH NATIONAL AND LOCAL CODES

DISCONNECT ALL POWER BEFORE SERVICING

- ⚠ S149 SWITCH AND K220 RELAY MAY BE FIELD SUPPLIED OR USE AVAILABLE KIT
- ⚠ S50 LOCATION ON UNITS WITH TWO SINGLE SPEED COMPRESSORS
- ⚠ USE COPPER CONDUCTORS ONLY
- ⚠ S50 LOCATION ON UNITS WITH ONE DUAL SPEED COMPRESSOR

180, 240	KW	HE1	HE2	HE3	HE4
20	5	5	5	5	

— LINE VOLTAGE FIELD INSTALLED
— DENOTES OPTIONAL COMPONENTS

10/17		WIRING DIAGRAM	10/17
		537929-01	
		HEATING - ELECTRIC	
		T3EH - ELA 180,240 UNITS - Y 20KW	
SECTION B3		REV 0	
Supersedes		New Form No. 537929-01	