

Job: _____
 Location: _____
 Schedule No.: _____
 System Designation: _____

Engineer: _____
 Architect: _____
 Location: _____
 Date: _____

For: Reference Approval Review Construction

Heat Recovery Outdoor Unit

FEATURES

- Split coil heat exchanger
- Dual hinged electrical boxes for ease of maintenance
- High-efficiency vapor injection inverter compressors - Each Module
- Intelligent Duty Cycle operation
- Night Silent operation
- Hinged service doors
- Built-in service console
- Built-in base pan heater
- Low Ambient Cooling

WARRANTY

- Compressor - 10-year limited warranty
 - All other components - 10-year limited warranty
- *See warranty for details

SPECIFICATIONS

| PERFORMANCE | | |
|--|--------------------|---------|
| Cooling Capacity ¹ (Btu/h) | Nominal | 288,000 |
| | Rated ² | 276000 |
| EER | Ducted | 10.2 |
| | Non-Ducted | 10.6 |
| IEER | Ducted | 18.9 |
| | Non-Ducted | 19.3 |
| Simultaneous Heating and Cooling Efficiency (SCHE) | Ducted | 27.6 |
| | Non-Ducted | 29.7 |
| Heating Capacity ¹ (Btu/h) | | 308,000 |
| | COP47 | |
| | Ducted | 3.42 |
| | Non-Ducted | 3.46 |
| COP17 | Ducted | 2.3 |
| | Non-Ducted | 2.33 |

| ELECTRICAL DATA | |
|------------------------------------|---------------------|
| Power Supply (Volts/Phase/Hertz) | 460/3/60 |
| Minimum Circuit Ampacity (A) | 39 + 29.5 |
| Maximum Overcurrent Protection (A) | 40 + 30 |
| Compressor RLA (A) | 15.5/15 + 21 |
| Number of Compressors | 2 + 1 |
| Outdoor Fan Power Input (W) | 1200/1200 + 820/930 |
| Outdoor Fan FLA (A) | 2.2/2.4 + 1.5/1.7 |

| GENERAL DATA | |
|--|-------------|
| Connection Ratio | 50% to 130% |
| Maximum Number of Indoor Units | 53 |
| Refrigerant Type | R-410A |
| Factory Refrigerant Charge (each unit) | 23.8 lbs. |

NOTES

1. Cooling and Heating capacity data is rated at the following conditions:
 Cooling: 80°FDB / 67°FWB Indoor, 95°FDB Outdoor
 Heating: 70°FDB Indoor, 47°FDB / 43°FWB Outdoor
2. Complies with AHRI 1230-2014 testing standards
3. Operating Voltage Range 410V to 525V
4. To achieve cooling lower than 5°F a Low ambient hood must be installed. This is purchased as an accessory.
5. A local 115V power outlet is available as an accessory to provide local power for maintenance.





| DIMENSIONS | | VRB168 | VRB120 |
|--|--------|--------|--------|
| Unit | Height | 72 | 64-3/8 |
| Dimensions (in) | Width | 68-1/2 | 52-3/4 |
| | Depth | 32-5/8 | 31-1/2 |
| Main System Piping (in) | | | |
| Liquid Pipe Connection | | 3/4 | 5/8 |
| High Pressure Gas Pipe | | 1-3/8 | 1-1/8 |
| Low Pressure Gas Pipe | | 1-3/8 | 1-1/8 |
| Balancing Pipework between Modules (in) | | | |
| Gas Balance Pipe Connection | | 3/4 | 3/4 |
| Oil Balance Pipe Connection | | 1/4 | 1/4 |
| Unit Net Weight (lb) | | 1118 | 794 |

DIMENSIONAL DRAWINGS - INCHES (MM)

VRB168

| CORNER WEIGHTS | | | | | | | | CENTER OF GRAVITY | | | |
|----------------|----|------|-----|------|-----|------|-----|-------------------|-----|-----|-----|
| AA | | BB | | CC | | DD | | EE | | FF | |
| lbs. | kg | lbs. | kg | lbs. | kg | lbs. | kg | in. | mm | in. | mm |
| 172 | 78 | 264 | 120 | 330 | 150 | 321 | 146 | 37-3/4 | 953 | 12 | 305 |

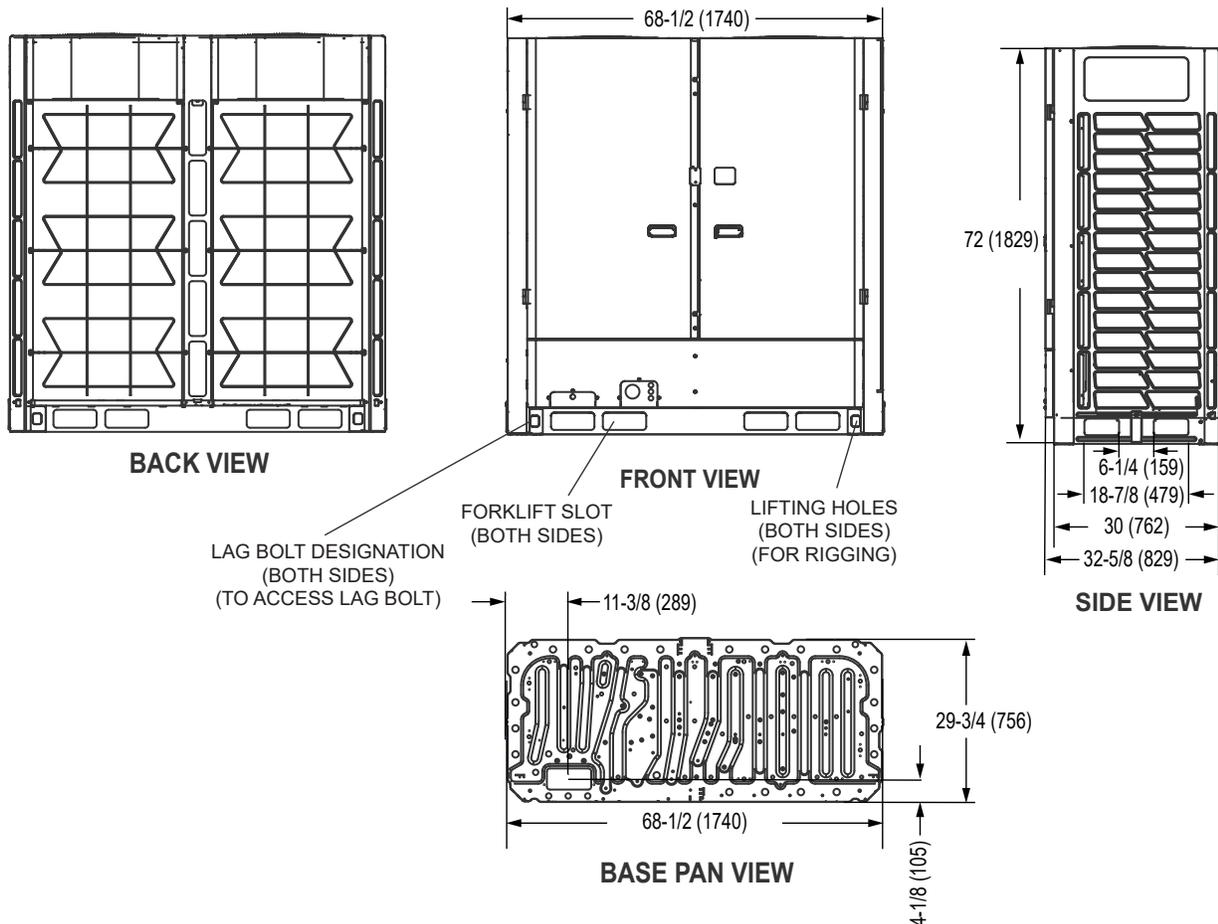
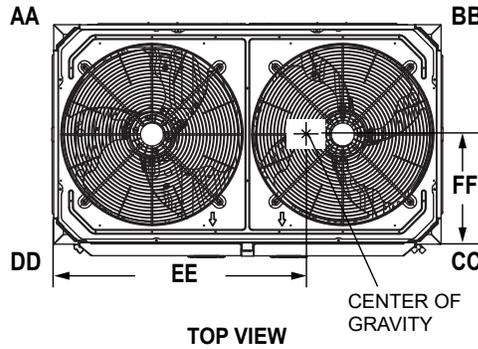


NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

DIMENSIONAL DRAWINGS - INCHES (MM)

VRB120


| CORNER WEIGHTS | | | | | | | | CENTER OF GRAVITY | | | |
|----------------|----|------|----|------|----|------|-----|-------------------|-----|--------|-----|
| AA | | BB | | CC | | DD | | EE | | FF | |
| lbs. | kg | lbs. | kg | lbs. | kg | lbs. | kg | in. | mm | in. | mm |
| 121 | 55 | 203 | 92 | 211 | 96 | 251 | 114 | 27-3/4 | 705 | 12-1/4 | 311 |

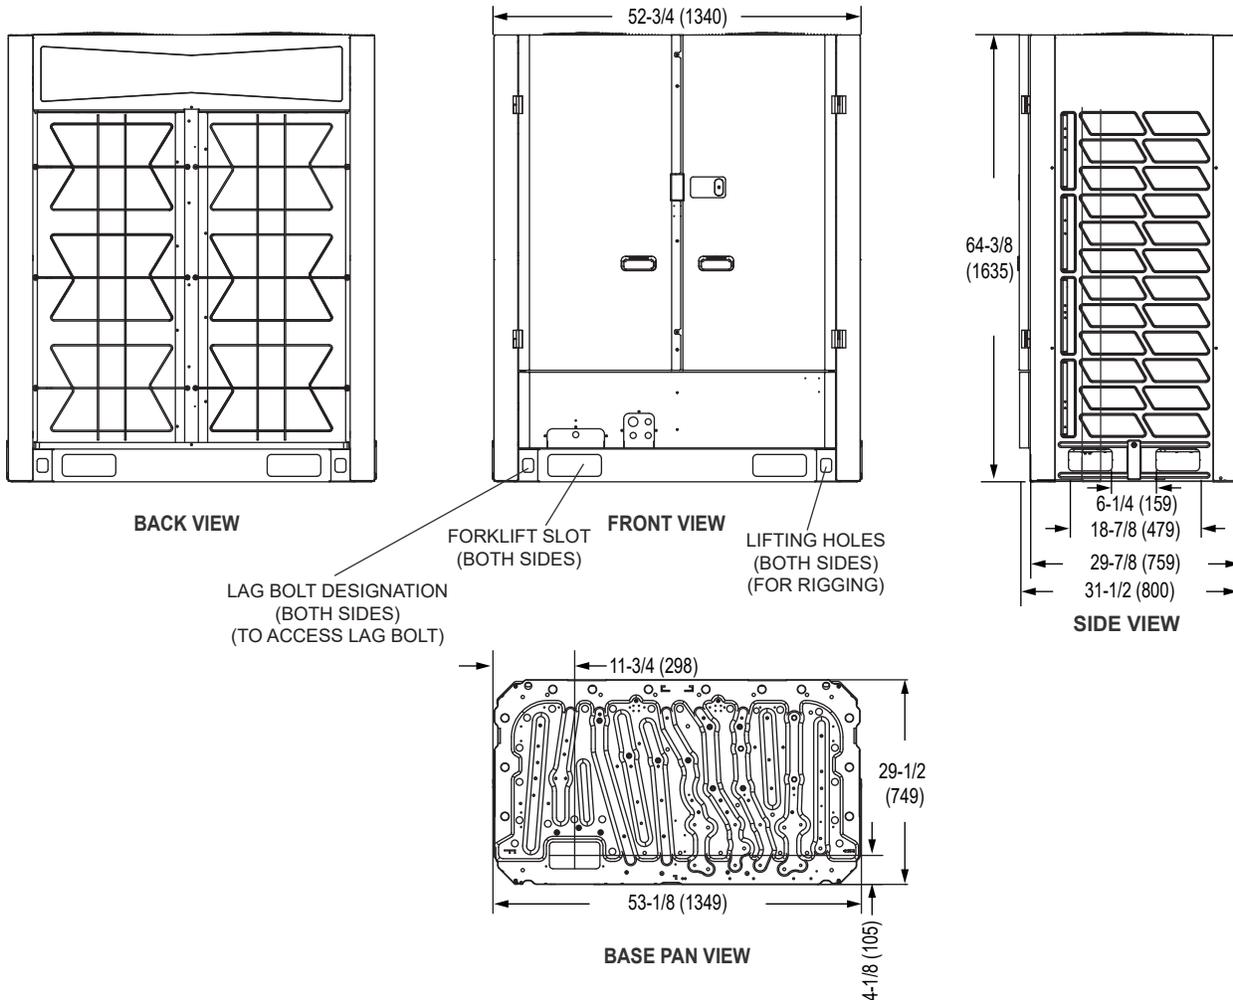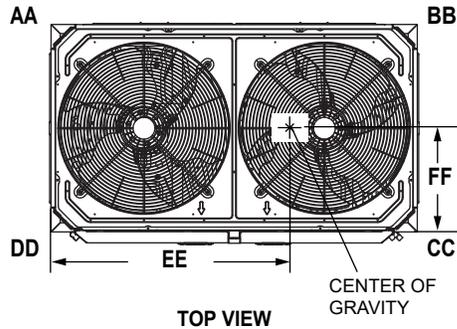

NOTE - Due to Lennox' ongoing commitment to quality, Specifications, Ratings and Dimensions subject to change without notice and without incurring liability. Improper installation, adjustment, alteration, service or maintenance can cause property damage or personal injury. Installation and service must be performed by a qualified installer and servicing agency.

MULTI-MODULE INFORMATION


Multi-Module Dimensions

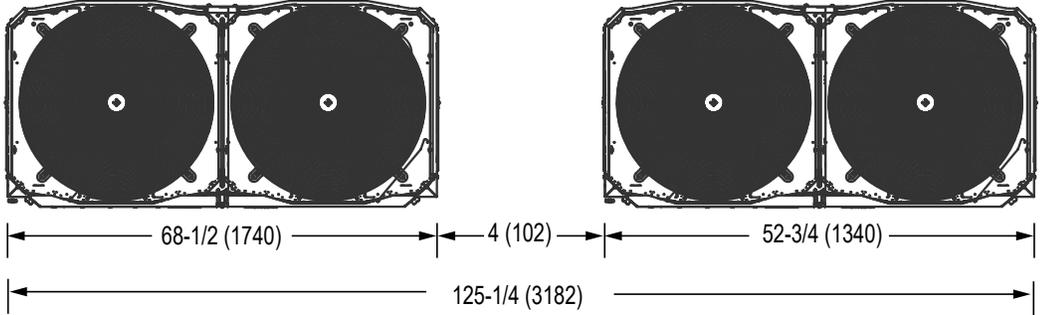

TOP VIEW

NOTE - All the outdoor units manifolded together should be installed at the same elevation.

Multi-Module Power

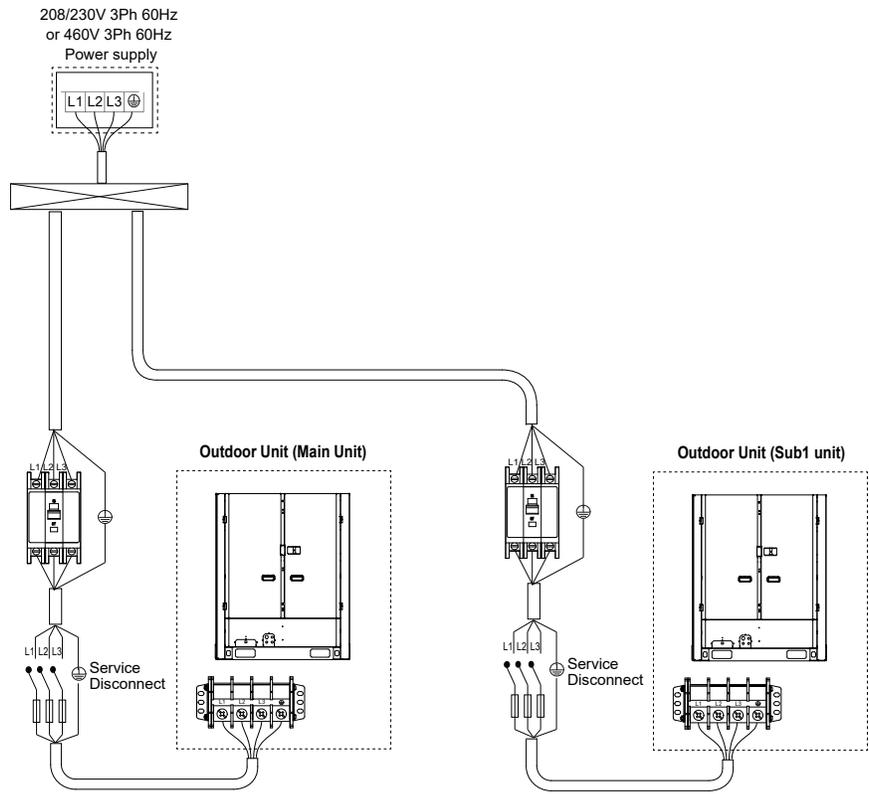

See page 1 for electrical data.
 Total system MCA is calculated by adding the MCA value of each module together to get the total system MCA.
 Total system MOP is calculated by adding the MOP value of each module together to get the total system MCA.

