


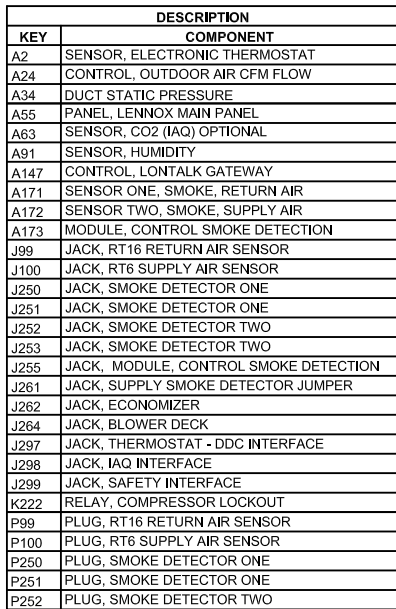

- ⚠ FOR MOTORS WITH S42 AND S135 EXTERNAL OVERLOAD
- 2 REMOTE LOCATION OF RT6
- 3 P298-B IS SERVICE RELAY OUTPUT (24VAC) IF USED CONNECT TO AN INDICATOR LIGHT
- 4 PRODIGY SETTINGS MUST BE MODIFIED WHEN K222, S42, S52, S135, S149 OR S179 ARE INSTALLED
- 5 S179, OVERFLOW SWITCH USED ON LGH/LCH 420-600 UNITS ONLY
- 6 CONNECT A172 SENSOR TO J261 ON SUPPLY AIR SMOKE DETECTOR ONLY
- 7 A63, A34 & A24 ARE MUTUALLY EXCLUSIVE

05/16		WIRING DIAGRAM	05/16
		537113-02	
ACCESSORIES			
CONTROL FOR ENERGENCE Lon TALK MODULE			
SECTION C			REV 2
Supersedes		New Form No. 537113-02	